


Kennedy St
Pipe burst from Wildhurst + Kennedy

Installed by FOP - Joseph Rowan
Start Date - 8/20/18
Completion Date - 9/3/18

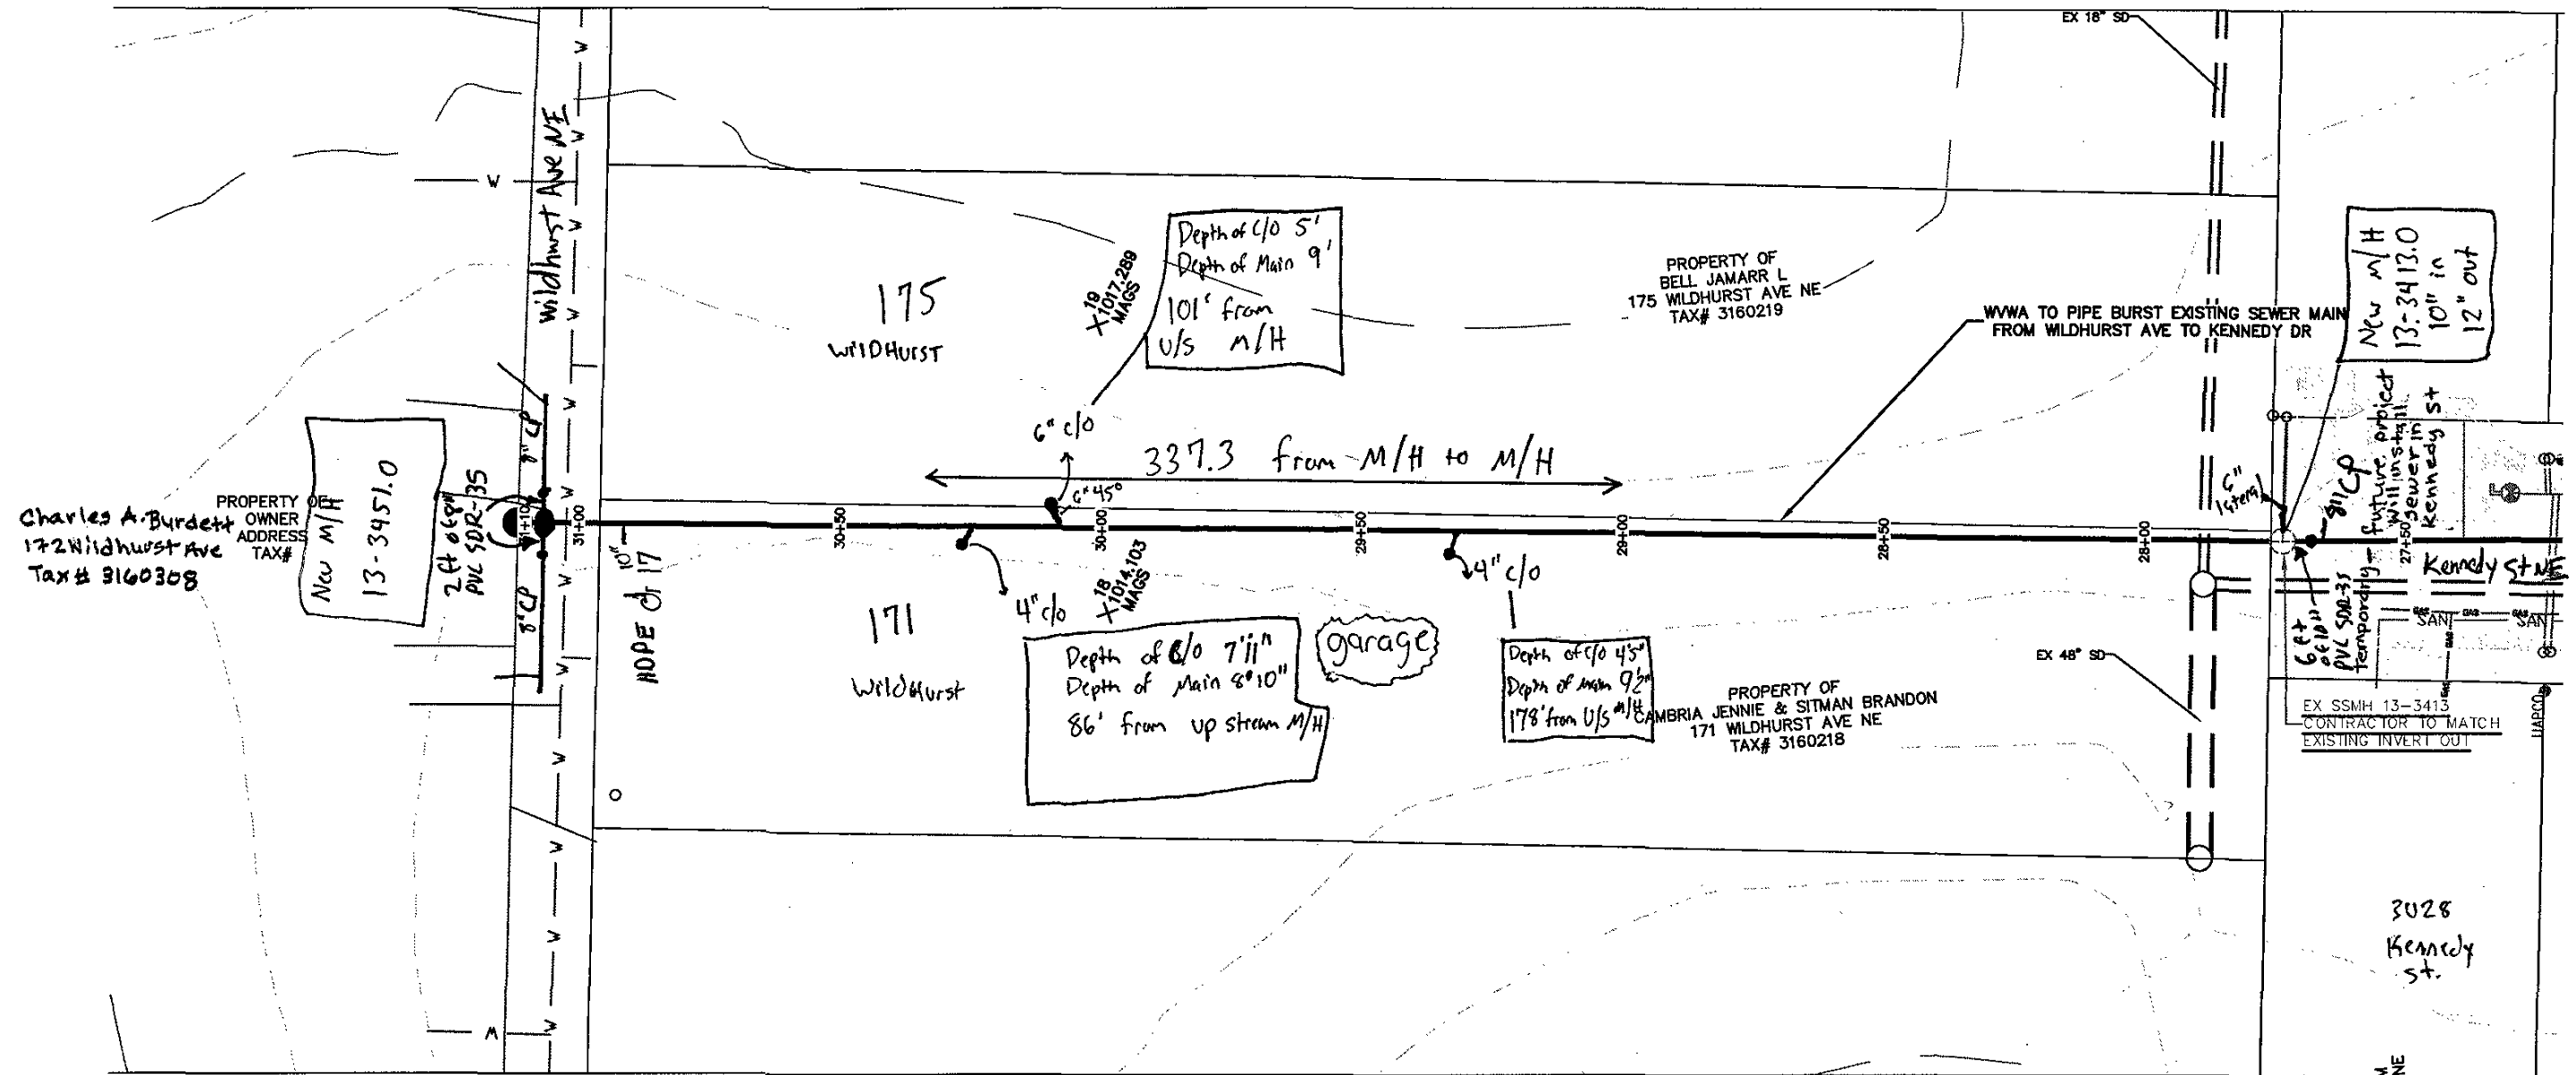

Pipe) 6" CRESLINE sch 40
4" National pipe sch 40 / lateral
10" HDPE DR17 DISCOPIEX - Main

M/H) CSI = Manufacturer
US Foundry = Frame & Cover Manufacturer
Water tight frame & cover