


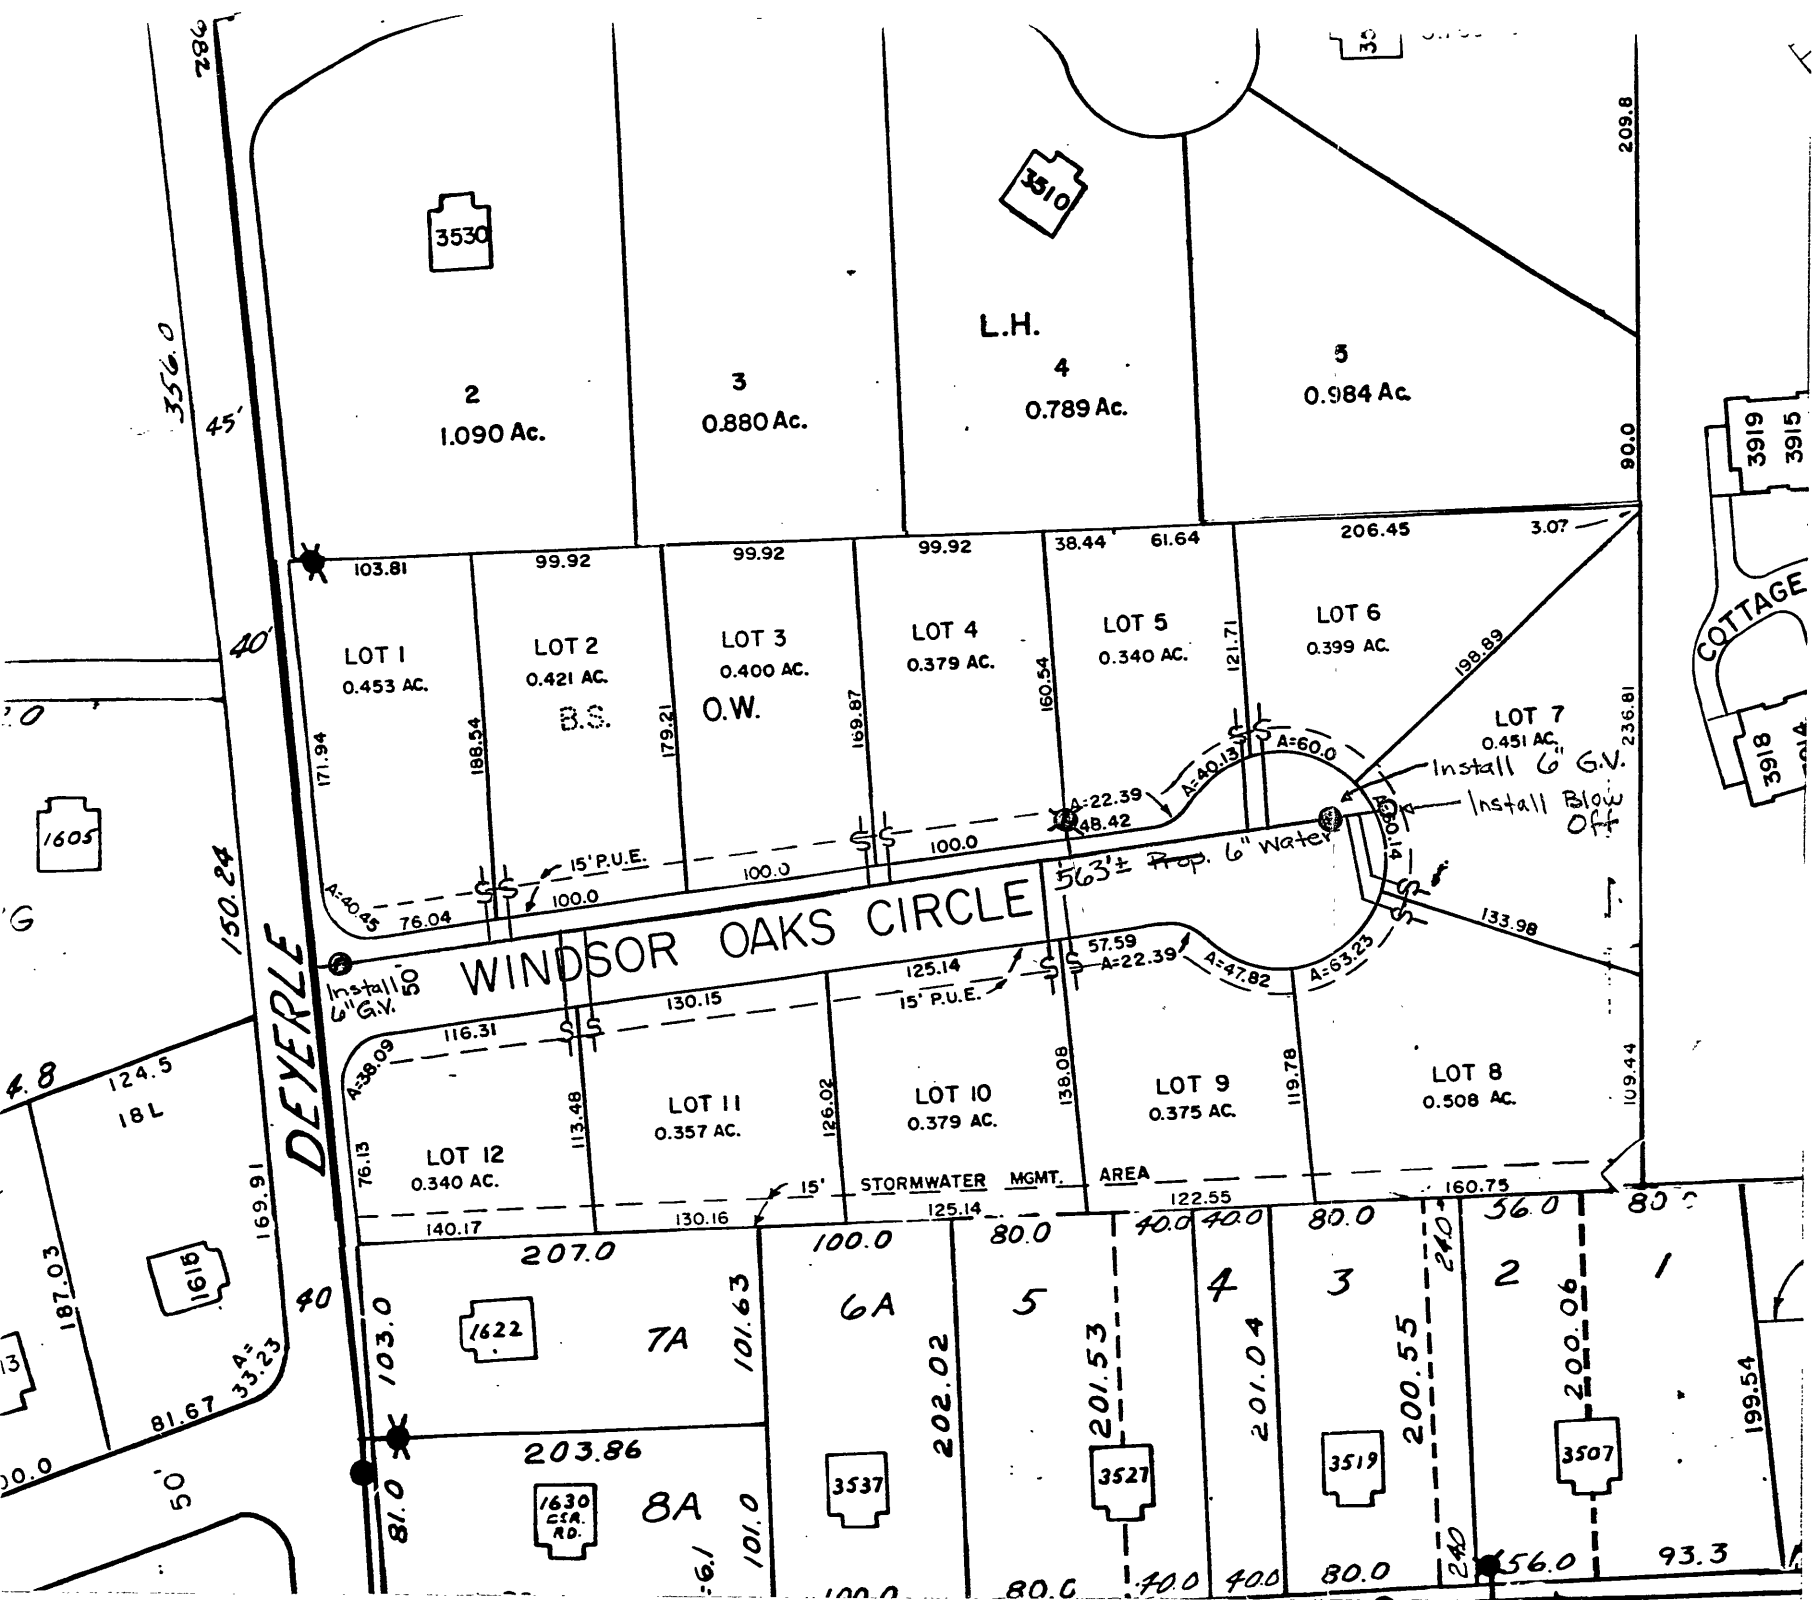

DATE STARTED 3/31/1995				
DATE COMP. 4/4/1995				
FEET MAIN	SIZE	VALVE	VAULT	BOX
563'	6"	2	2	
Blowoff		1		
F.H. COMP. 1 #1				
F.H. STUB ONLY				
SERV. INS. BY: J.P. Turner - Contractor				
MAIN INS. BY: J.P. Turner - Contractor				
NO. 3/4" SERV. INS. 12				
CITY OR CO. City				
DEPT. INSP. Dan Conner - City Engineering				

NOTE: ALL EXIST. UTILITIES SHALL BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION.

James H. P...
MANAGER UTILITY LINE SERVICES

WATER DEPARTMENT

ROANOKE VIRGINIA

WINDSOR OAKS CIRCLE

SW

SCALE: 1"=100'	<i>Est B. L.</i> 10/13/95
DATE: 10/4/95	DIRECTOR UTILITIES & OPERATIONS DATE
DIST. MAP: 518	<i>William J. Clark</i> 10/12/95
PLAN NO.: 95-09	DIRECTOR OF PUBLIC WORKS DATE