


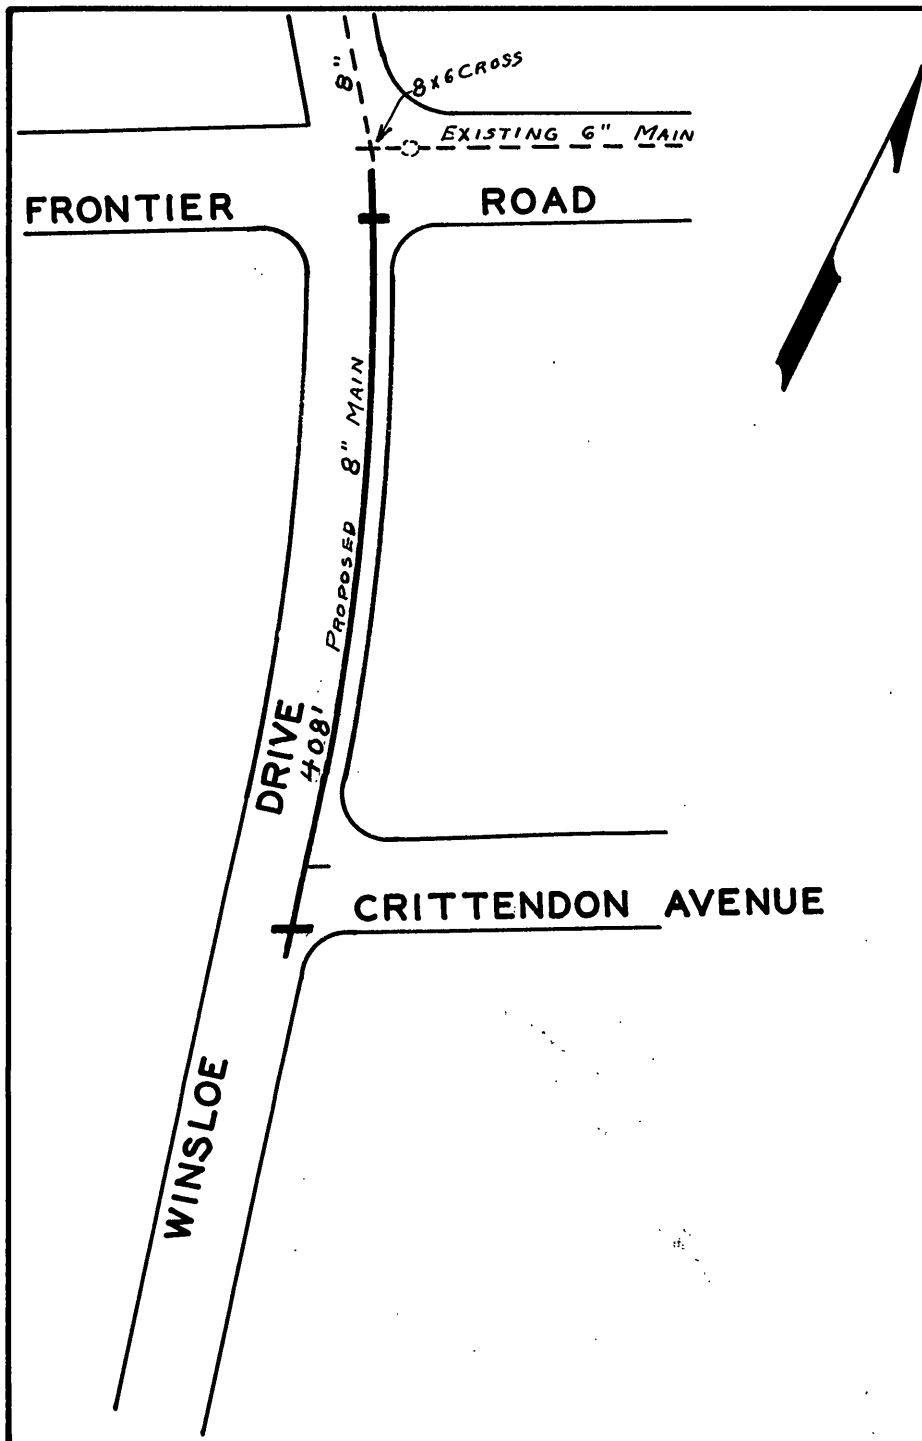

DATE STARTED		JUL 31 1964		
DATE COMP.		AUG 5 1964		
FEET MAIN	SIZE	VALVE	VAULT	BOX
408'	8"	2	2	
F. H. COMP.				
F. H. STUB ONLY				
SERV. INS. BY:				
MAINS INS. BY: R. W. D.				
NO. 3/4" SERV. INS.				
CITY OR CO.		CITY		
DEPT. INSP.		B. R. H.		

WATER DEPARTMENT
CITY OF ROANOKE, VA.

WINSLOE DRIVE

SCALE - 1"=100'

DRAWN BY E.L.A. JUNE 15, 1964