


STORMWATER MANAGEMENT COST ESTIMATE


ALL COSTS GIVEN ARE COMPLETE IN PLACE

DESCRIPTION	UNIT	QUANTITY	UNIT COST	TOTAL COST
CLEARING & GRUBBING	LS		\$	\$
EXCAVATION	CY			
EMBANKMENT	CY			
FENCING	LF			
STRUCTURES				
ACCESS ROAD				
AS-BUILTS				
SUB-TOTAL			\$	
10% CONTINGENCY			\$	
TOTAL PROJECT COST			\$	


SEDIMENT BASIN SCHEMATIC ELEVATIONS

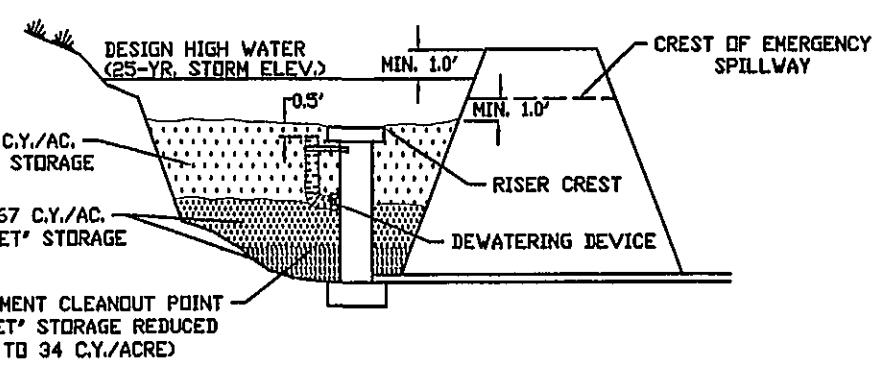

DESIGN ELEVATIONS WITH
EMERGENCY SPILLWAY

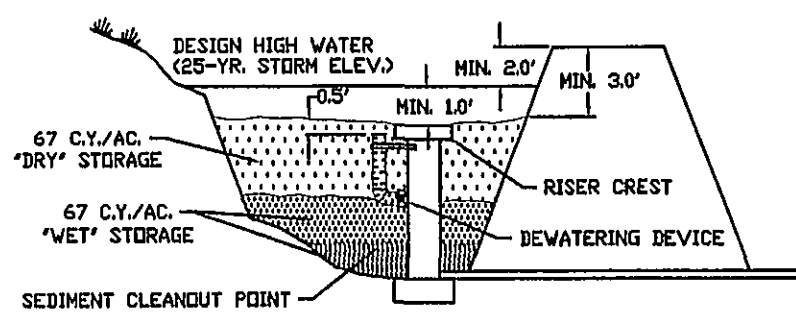

DESIGN ELEVATIONS WITHOUT
EMERGENCY SPILLWAY
(RISER PASSES 25-YR. EVENT)

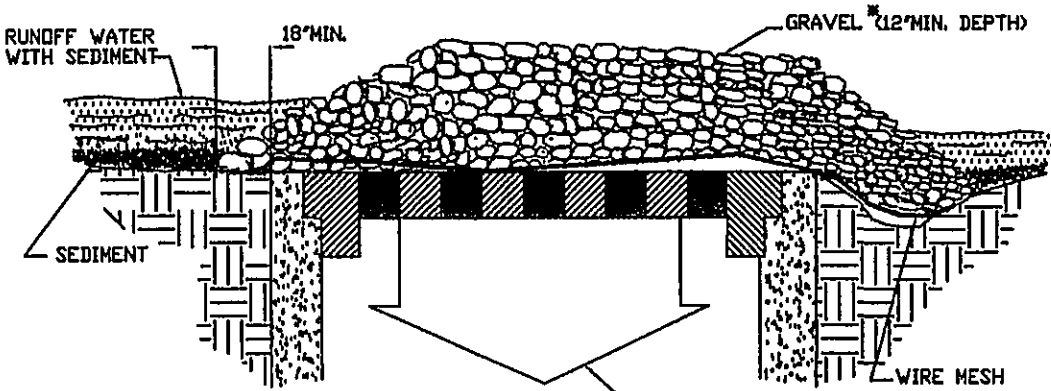

SPECIFIC APPLICATION

This method of inlet protection is applicable where heavy concentrated flows are expected, but not where ponding around the structure might cause excessive inconvenience or damage to adjacent structures and unprotected areas.

* Gravel shall be VDOT #3, #357 or #5 coarse aggregate.

(IP) GRAVEL AND WIRE MESH DROP INLET SEDIMENT FILTER

GENERAL NOTES

- DESIGN OF DETENTION BASINS SHALL CONFORM TO THE REQUIREMENTS OF THE COUNTY OF ROANOKE DRAINAGE STANDARDS (REF. SECTIONS 503.02, 503.03, AND 505.05). THE DESIGN OF THE FACILITY AND PREPARATION OF AS-BUILT PLANS SHALL BE BY A CERTIFIED PROFESSIONAL ENGINEER LICENSED TO PRACTICE IN THE COMMONWEALTH OF VIRGINIA.
- ACCESS TO THE FACILITY MUST BE PROVIDED IN ACCORDANCE WITH THE COUNTY OF ROANOKE DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION.
- IF THE FACILITY IS OVER FOUR (4) FEET DEEP, TAKES OVER TWO (2) HOURS TO DRAIN, OR THE INTERIOR SLOPE EXCEEDS 3 (H) : 1 (V), PERMANENT FENCING MAY BE REQUIRED. ADDITIONALLY, IF THE FACILITY IS IN A CONGESTED AREA OR WILL IN ANY WAY POSE A HAZARD TO THE GENERAL PUBLIC, FENCING MAY BE REQUIRED. FENCING SHALL BE A MINIMUM OF SIX (6) FEET HIGH, A MINIMUM OF STANDARD NINE GAUGE LINK FENCE, AND MUST HAVE ONE OR MORE LOCKING DOUBLE GATES (MINIMUM TEN FEET WIDE) FOR ACCESS.
- DETENTION PONDS SHALL BE BONDED IN ACCORDANCE WITH THE ROANOKE COUNTY BONDING POLICY FOR SUBDIVISION AND SITE DEVELOPMENT. A SEPARATE BOND FOR THE DETENTION FACILITY WILL BE REQUIRED AND ADMINISTERED APART FROM THE SUBDIVISION DEVELOPMENT BOND. REFERENCE ESTIMATE - THIS SHEET.
- REFERENCE THE COUNTY OF ROANOKE DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION, FOR ACCEPTANCE AND MAINTENANCE OF THE FACILITY. CERTIFIED AS-BUILTS ARE REQUIRED AND MUST INCLUDE:
 - DIMENSIONS OF THE FACILITY
 - VOLUME & MAXIMUM DEPTH
 - ELEVATIONS OF STRUCTURES, SPILLWAYS, AND TOP
 - MATERIALS VERIFICATION INCLUDING RESULTS OF DENSITY TESTS CONDUCTED BY AN INDEPENDENT SOIL TESTING LABORATORY
 - LOCATION AND ELEVATION OF BENCHMARK
- ONE FOOT MINIMUM FREEBOARD REQUIRED FOR THE 100 YR WATER SURFACE ELEVATION.

CONSTRUCTION NOTES


- SITE PREPARATION SHALL BE IN ACCORDANCE WITH THE COUNTY OF ROANOKE DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION.
- SLOPES STEEPER THAN 3 TO 1 (HORIZONTAL TO VERTICAL) SHALL BE BENCHED OR STEPPED PRIOR TO PLACING FILL ON THEM.
- ON-SITE FILL MATERIAL OR BORROW FILL MATERIAL MAY BE UTILIZED. FILL MATERIAL SOILS, IN GENERAL:
 - SHALL BE COMPACTABLE
 - SHALL BE WITHIN AN ACCEPTABLE RANGE OF MOISTURE CONTENT WHICH IS READILY CONTROLLED
 - SHALL NOT BE HIGHLY SUSCEPTIBLE TO VOLUME CHANGE (SHRINKAGE OR SWELL) OR SETTLEMENT
- FILL MATERIALS CONTAINING ROCKS LARGER THAN SIX (6) INCHES (15.2 CM) SHALL NOT BE USED. THE UPPERMOST TWO (2) FEET (61 CM) SHALL NOT HAVE ANY ROCK LARGER THAN TWO (2) INCHES (5.1 CM) IN DIAMETER.
- THE APPROVED FILL SHALL BE PLACED IN EIGHT (8) INCH (20 CM) LOOSE LIFTS. EACH LIFT SHALL BE SPREAD IN UNIFORM LAYERS. FILL SOIL SHALL BE UTILIZED ONLY WITHIN A MOISTURE RANGE OF +/- 5% OF THE OPTIMUM MOISTURE CONTENT. COMPACTION OF THE FILL SHALL BE PERFORMED WITH APPROVED EQUIPMENT. COMPACTION OF THE LAYERS SHALL BE CONTINUOUS AND UNIFORM.
- EMBANKMENT MATERIAL IN FILL AREAS SHALL BE PLACED IN LIFTS NOT EXCEEDING EIGHT (8) INCHES AND SHALL BE COMPACTED TO A MINIMUM 95% DENSITY IN ACCORDANCE WITH SECTION 503 OF THE VIRGINIA DEPARTMENT OF TRANSPORTATION ROAD AND BRIDGE SPECIFICATIONS.
- FIELD DENSITY TESTS ARE TO BE CONDUCTED BY AN INDEPENDENT SOILS TESTING LABORATORY UNDER THE DIRECTION OF A QUALIFIED GEOTECHNICAL ENGINEER. THE RESULTS OF THESE TESTS SHALL BE SUBMITTED TO THE COUNTY OF ROANOKE WITH AS-BUILT PLANS AS A CONDITION OF ACCEPTANCE OF THE FACILITY BY THE COUNTY. FIELD DENSITY TESTS, AS DIRECTED BY THE ENGINEER SHALL BE PERFORMED PERIODICALLY TO DETERMINE THE DEGREE OF COMPACTION. ANY AREAS FAILING TO MEET THE ABOVE REQUIREMENTS SHALL BE REWORKED AND/OR RECOMPACTED UNTIL THE REQUIRED DEGREE OF COMPACTION IS ACHIEVED.
- ANTI-SLEEP COLLARS SHALL BE INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.
- ALL DISTURBED AREAS SHALL BE COVERED WITH FOUR (4) INCHES OF TOPSOIL AND SEEDED.
- THE MINIMUM SLOPE OF THE BASIN FLOOR SHALL BE ONE (1) PERCENT GRADED TO DRAIN TO THE PRINCIPAL SPILLWAY.

SPECIFIC APPLICATION

This method of inlet protection is applicable where heavy flows are expected and where an overflow capability and ease of maintenance are desirable.



NO.	TITLE	KEY	SYMBOL	NO.	TITLE	KEY	SYMBOL
3.01	SAFETY FENCE	(SAF)		3.20	ROCK CHECK DAMS	(CD)	
3.02	TEMPORARY GRAVEL CONSTRUCTION ENTRANCE	(CE)		3.21	LEVEL SPREADER	(LS)	
3.03	CONSTRUCTION ENTRANCE STABILIZATION	(CRS)		3.22	VEGETATIVE STREAMBANK STABILIZATION	(VSS)	
3.04	STRAW BALE BARRIER	(STB)		3.23	STRUCTURAL STREAMBANK STABILIZATION	(SSS)	
3.05	SILT FENCE	(SF)		3.24	TEMPORARY VEHICULAR STREAM CROSSING	(VSD)	
3.06	BRUSH BARRIER	(BB)		3.25	UTILITY STREAM CROSSING	(USC)	
3.07	STORM DRAIN INLET PROTECTION	(IP)		3.26	DEWATERING STRUCTURE	(DS)	
3.08	CULVERT INLET PROTECTION	(CIP)		3.27	TURBIDITY CURTAIN	(TC)	
3.09	TEMPORARY DIVERSION DIKE	(DD)		3.28	SUBSURFACE DRAIN	(SD)	
3.10	TEMPORARY FILL DIVERSION	(FD)		3.29	SURFACE ROUGHENING	(SR)	
3.11	TEMPORARY RIGHT-OF-WAY DIVERSION	(RWD)		3.30	TOPSOILING	(TD)	
3.12	DIVERSION	(DV)		3.31	TEMPORARY SEEDING	(TS)	
3.13	TEMPORARY SEDIMENT TRAP	(ST)		3.32	PERMANENT SEEDING	(PS)	
3.14	TEMPORARY SEDIMENT BASIN	(SB)		3.33	SODDING	(SD)	
3.15	TEMPORARY SLOPE DRAIN	(TSD)		3.34	BERMUDA GRASS AND ZOYSIAURASS ESTABLISHMENT	(BZ)	
3.16	PAVED FLUME	(PF)		3.35	MULCHING	(ML)	
3.17	STORMWATER CONVEYANCE CHANNEL	(SCC)		3.36	SOIL STABILIZATION BLANKETS AND MATTING	(SSB)	
3.18	OUTLET PROTECTION	(OP)		3.37	TREES, SHRUBS, VINES AND GROUND COVERS	(VEG)	
3.19	RIPRAP	(RR)		3.38	TREE PRESERVATION AND PROTECTION	(TP)	
3.39	DUST CONTROL	(DC)					

2 ACRES OR LESS OF DRAINAGE AREA:

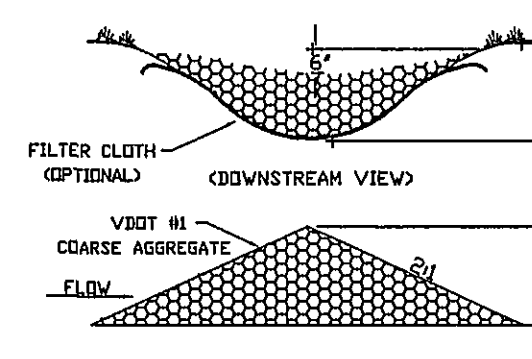

(CD) ROCK CHECK DAM

2-10 ACRES OF DRAINAGE AREA:

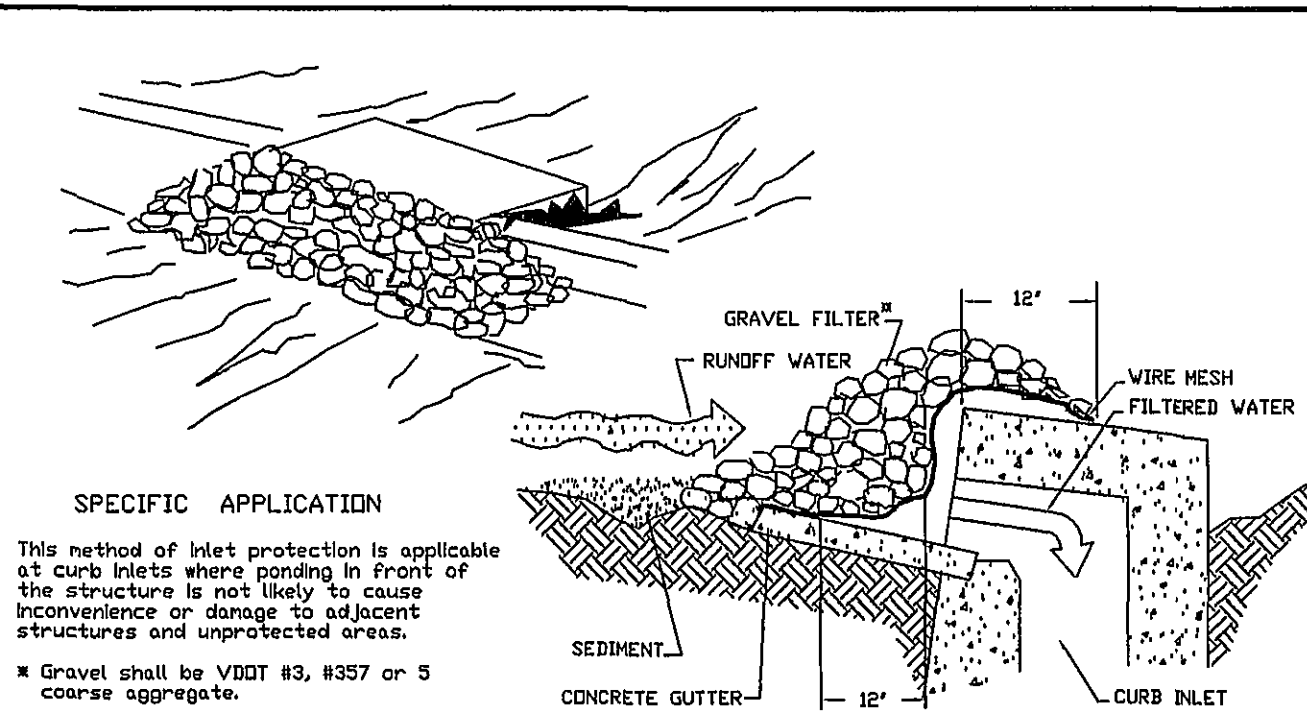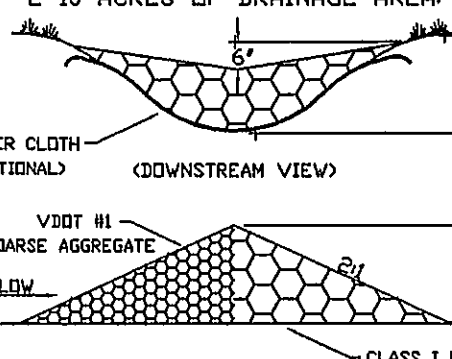


SPECIFIC APPLICATION


This method of inlet protection is applicable at curb inlets where ponding in front of the structure is not likely to cause inconvenience or damage to adjacent structures and unprotected areas.

* Gravel shall be VDOT #3, #357 or #5 coarse aggregate.

(IP) GRAVEL CURB INLET SEDIMENT FILTER

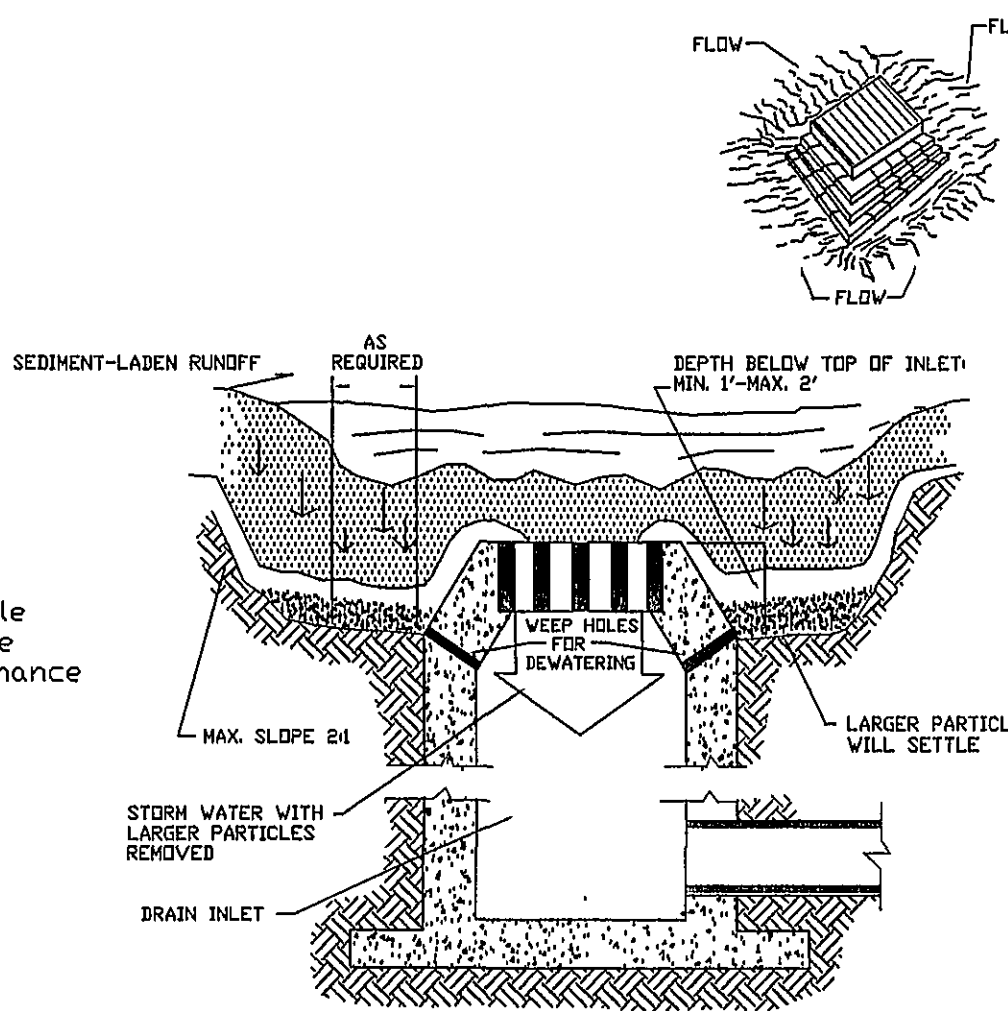


(IP) EXCAVATED DROP INLET SEDIMENT TRAP

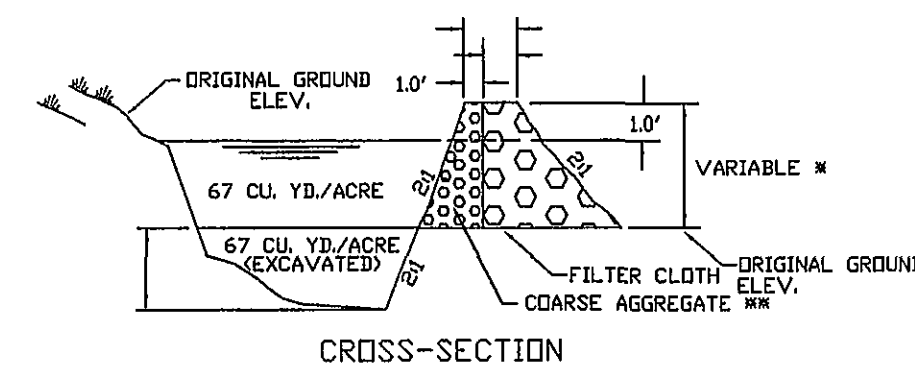

CROSS-SECTION

* SEE PLATE 313-1

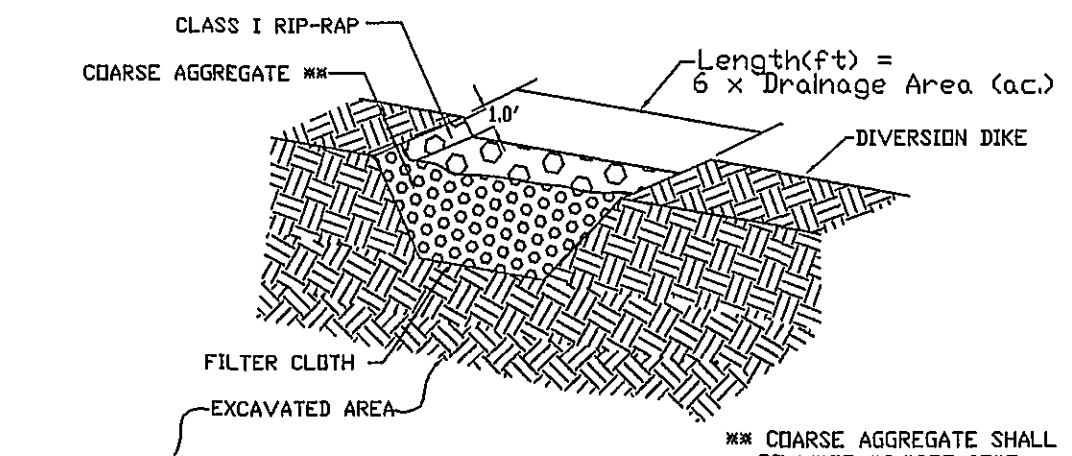


(ST) SEDIMENT TRAP


NOTE:
FOR AREAS LESS THAN 3.0 ACRES. FOR AREAS LARGER THAN 3.0 ACRES A SEDIMENT BASIN IS REQUIRED. SEE DETAIL THIS SHEET.

TEMPORARY SEDIMENT TRAP DATA


STRUCTURE	DRAINAGE AREA (ACRES)	STORAGE (CY)		WEIR LENGTH (FT.)	WEIR HEIGHT (FT.)	BERM HEIGHT (FT.)
		REQ'D	DESIGN			
ST1	2.96	399.0	404.0	17.9	1.75	2.75
		WET	BOTTOM	50x35	TOP	60x45
		DRY	BOTTOM	60x45	TOP	67x52
ST2	2.98	399.0	404.0	17.9	1.75	2.75
		WET	BOTTOM	50x35	TOP	60x45
		DRY	BOTTOM	60x45	TOP	67x52
ST3	1.5	201.0	210.0	9.0	1.5	2.5
		WET	BOTTOM	70x10	TOP	80x20
		DRY	BOTTOM	80x20	TOP	86x26

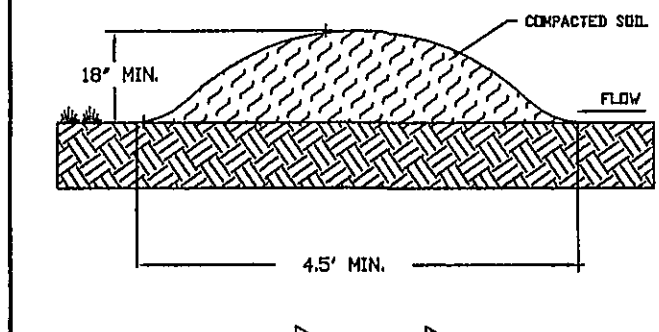


- (DD) TEMPORARY DIVERSION DIKE
- (FD) TEMPORARY FILL DIVERSION
- (RWD) TEMPORARY RIGHT-OF-WAY DIVERSION
- (DV) DIVERSION

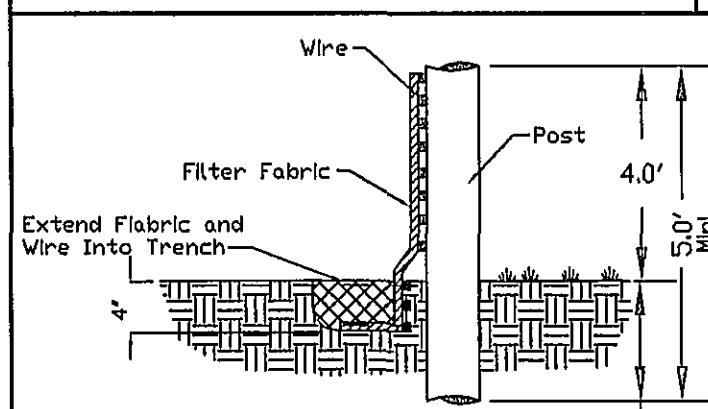

(SF) CONSTRUCTION OF A SILT FENCE

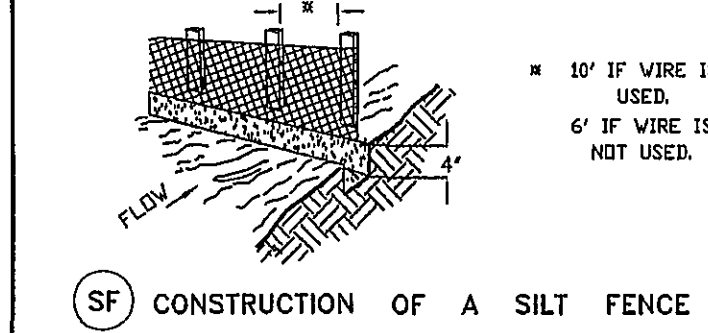


(SF) CONSTRUCTION OF A SILT FENCE

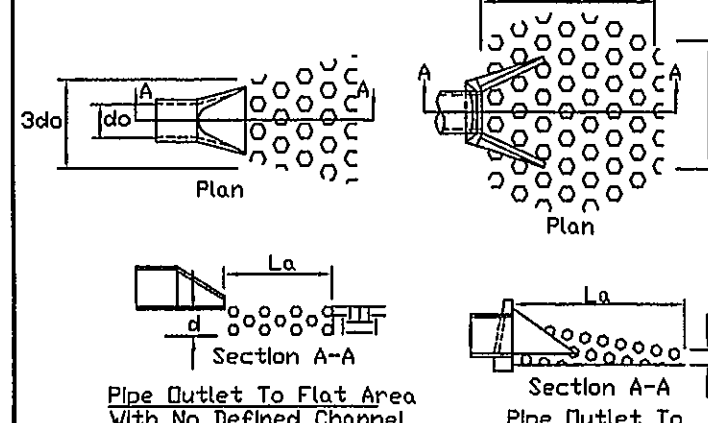


(OP) OUTLET PROTECTION


- NOTES
- Apron lining may be rip-rap, grouted rip-rap, or concrete.
 - La is the length of the rip-rap apron as calculated using plates 136d and 136e.
 - d = 1.5 times the maximum stone diameter, but not less than 6'.

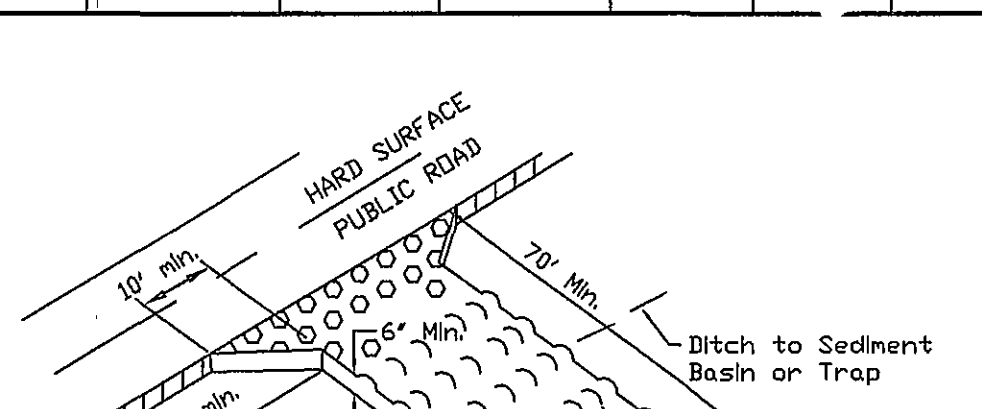


(PS) PERMANENT SEEDING MIXTURE

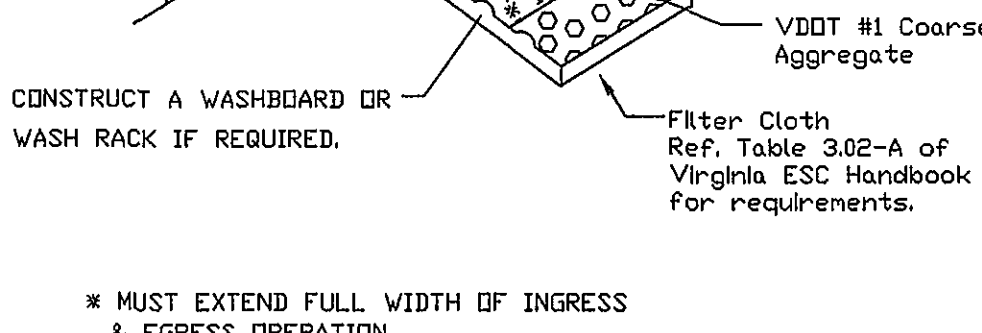

(PS) PERMANENT SEEDING MIXTURE

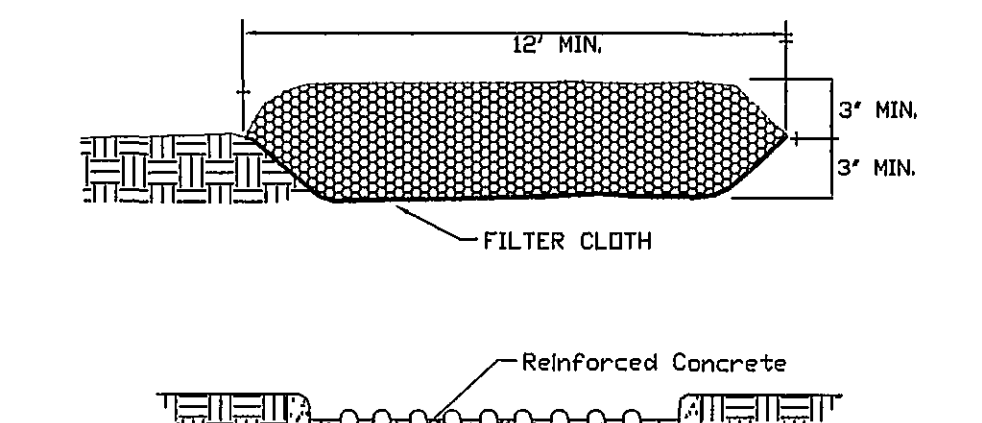

(PS) PERMANENT SEEDING MIXTURE

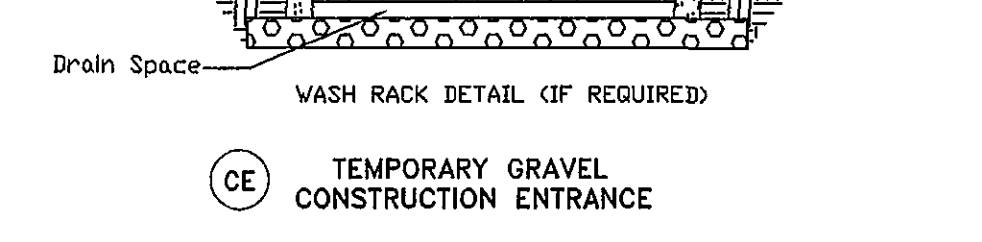

(PS) PERMANENT SEEDING MIXTURE

EROSION-SILTATION CONTROL COST ESTIMATE

ALL COSTS GIVEN ARE COMPLETE IN PLACE

DESCRIPTION	UNIT	QUANTITY	UNIT COST	TOTAL COST
CONSTRUCTION ENTRANCE	EA	1	700.00	\$ 700.00
SILT FENCE	LF	1,575	3.00	4,725.00
INLET PROTECTION	EA	15	50.00	750.00
TEMPORARY DIVERSION DIKE	LF	2,305	2.00	4,610.00
TEMPORARY FILL DIVERSION	LF			
SEDIMENT TRAP	EA	3	2000.00	6,000.00
CHECK DAM	EA	1	1000.00	1,000.00
PERMANENT SEEDING	ACRE	1.0	1,200.00	1,200.00
OUTLET PROTECTION	EA	2	100.00	200.00
SEDIMENT BASIN	EA			
SUB-TOTAL				\$ 19,185.00
10% CONTINGENCY				\$ 1,965.00
TOTAL PROJECT COST				\$ 21,150.00

GENERAL EROSION AND SEDIMENT CONTROL NOTES

- ALL SOIL EROSION & SEDIMENT CONTROL MEASURES SHALL BE ACCOMPLISHED IN STRICT ACCORDANCE WITH THE STANDARDS AND SPECIFICATIONS CONTAINED IN THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.
- THE APPROVING AUTHORITY MAY ADD TO, DELETE, RELOCATE, CHANGE, OR OTHERWISE MODIFY CERTAIN EROSION AND SEDIMENT CONTROL MEASURES WHERE FIELD CONDITIONS ARE ENCOUNTERED THAT WARRANT SUCH MODIFICATIONS.
- ALL SOIL EROSION AND SEDIMENT CONTROL MEASURES AS SHOWN ON THE PLAN SHALL BE PLACED IN ADVANCE OF THE WORK BEING PERFORMED, AS FAR AS PRACTICAL.
- IN NO CASE DURING CONSTRUCTION SHALL WATER RUNOFF BE DIVERTED OR ALLOWED TO FLOW TO LOCATIONS WHERE ADEQUATE PROTECTION HAS NOT BEEN PROVIDED.
- IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO LEAVE THE SITE ADEQUATELY PROTECTED AGAINST EROSION, SEDIMENTATION, OR ANY DAMAGE TO ANY ADJACENT PROPERTY AT THE END OF EACH DAY'S WORK.
- FOR THE EROSION CONTROL KEY SYMBOLS SHOWN ON THE PLANS, REFER TO THE VIRGINIA UNIFORM CODING SYSTEM FOR EROSION AND SEDIMENT CONTROL PRACTICES CONTAINED IN THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION. THESE SYMBOLS AND KEYS ARE TO BE UTILIZED ON ALL EROSION CONTROL PLANS SUBMITTED TO ROANOKE COUNTY.

(PS) PERMANENT SEEDING MIXTURE

- TYPE A**
- 15 OCTOBER TO 1 FEBRUARY
K-31 FESCUE @ 5 LB / 1000 SF
BORZY WINTER RYE @ 1/2 LB / 1000 SF
- 1 FEBRUARY TO 1 JUNE
K-31 FESCUE @ 5 LB / 1000 SF
ANNUAL RYE @ 1/2 LB / 1000 SF
1 JUNE TO 1 SEPTEMBER
K-31 FESCUE @ 5 LB / 1000 SF
GERMAN MILLET @ 1/2 LB / 1000 SF
- 1 SEPTEMBER TO 15 OCTOBER
K-31 FESCUE @ 5 LB / 1000 SF
ANNUAL RYE @ 1/2 LB / 1000 SF
- TYPE B (SLOPES 3:1 OR STEEPER)**
- 15 MARCH TO 1 MAY
CROWN VETCH @ 1/2 LB / 1000 SF
PERENNIAL RYEGRASS @ 1/2 LB / 1000 SF
RED TOP @ 1/8 LB / 1000 SF
- 15 AUGUST TO 1 OCTOBER
CROWN VETCH @ 1/2 LB / 1000 SF
PERENNIAL RYEGRASS @ 1/2 LB / 1000 SF
RED TOP @ 1/8 LB / 1000 SF
- LIME:** 140 LB / 1000 SF PULVERIZED AGRICULTURAL LIMESTONE
- FERTILIZER:** 5-20-10 @ 25 LB / 1000 SF
30-0-0 @ 7 LB / 1000 SF
- MULCH:** IF REQUIRED, SHALL BE USED OVER ALL SEEDING AREAS AND SHALL BE APPLIED IN ACCORDANCE WITH SECTION 175 OF THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.
- SOIL CONDITIONING:** INCORPORATION OF LIME AND FERTILIZER, SELECTION OF CERTIFIED SEED, MULCHING, MAINTENANCE OF NEW SEEDINGS, AND RESEEDING SHALL BE IN ACCORDANCE WITH SPECIFICATIONS CONTAINED WITHIN THE VIRGINIA SOIL EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION. ADDITIONAL SEEDING TO BE PERFORMED AS REQUIRED BY THE INSPECTOR.
- SEED APPLICATION:** APPLY SEED UNIFORMLY WITH A CYCLONE SEEDER, DRILL, CULTIPACKER SEEDER, OR HYDROSEEDER ON A FIRM, FRIABLE, SEEDBED. MAXIMUM SEEDING DEPTH SHALL BE 1/4 INCH.
- TOTAL DISTURBED AREA = 7.78 AC.