
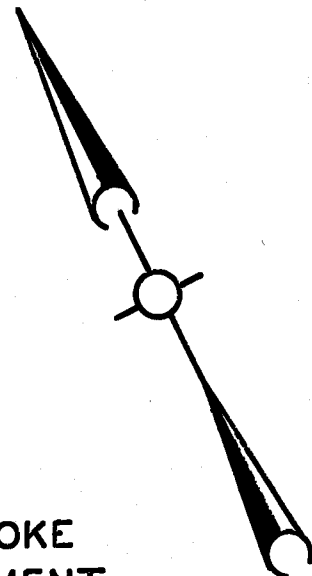


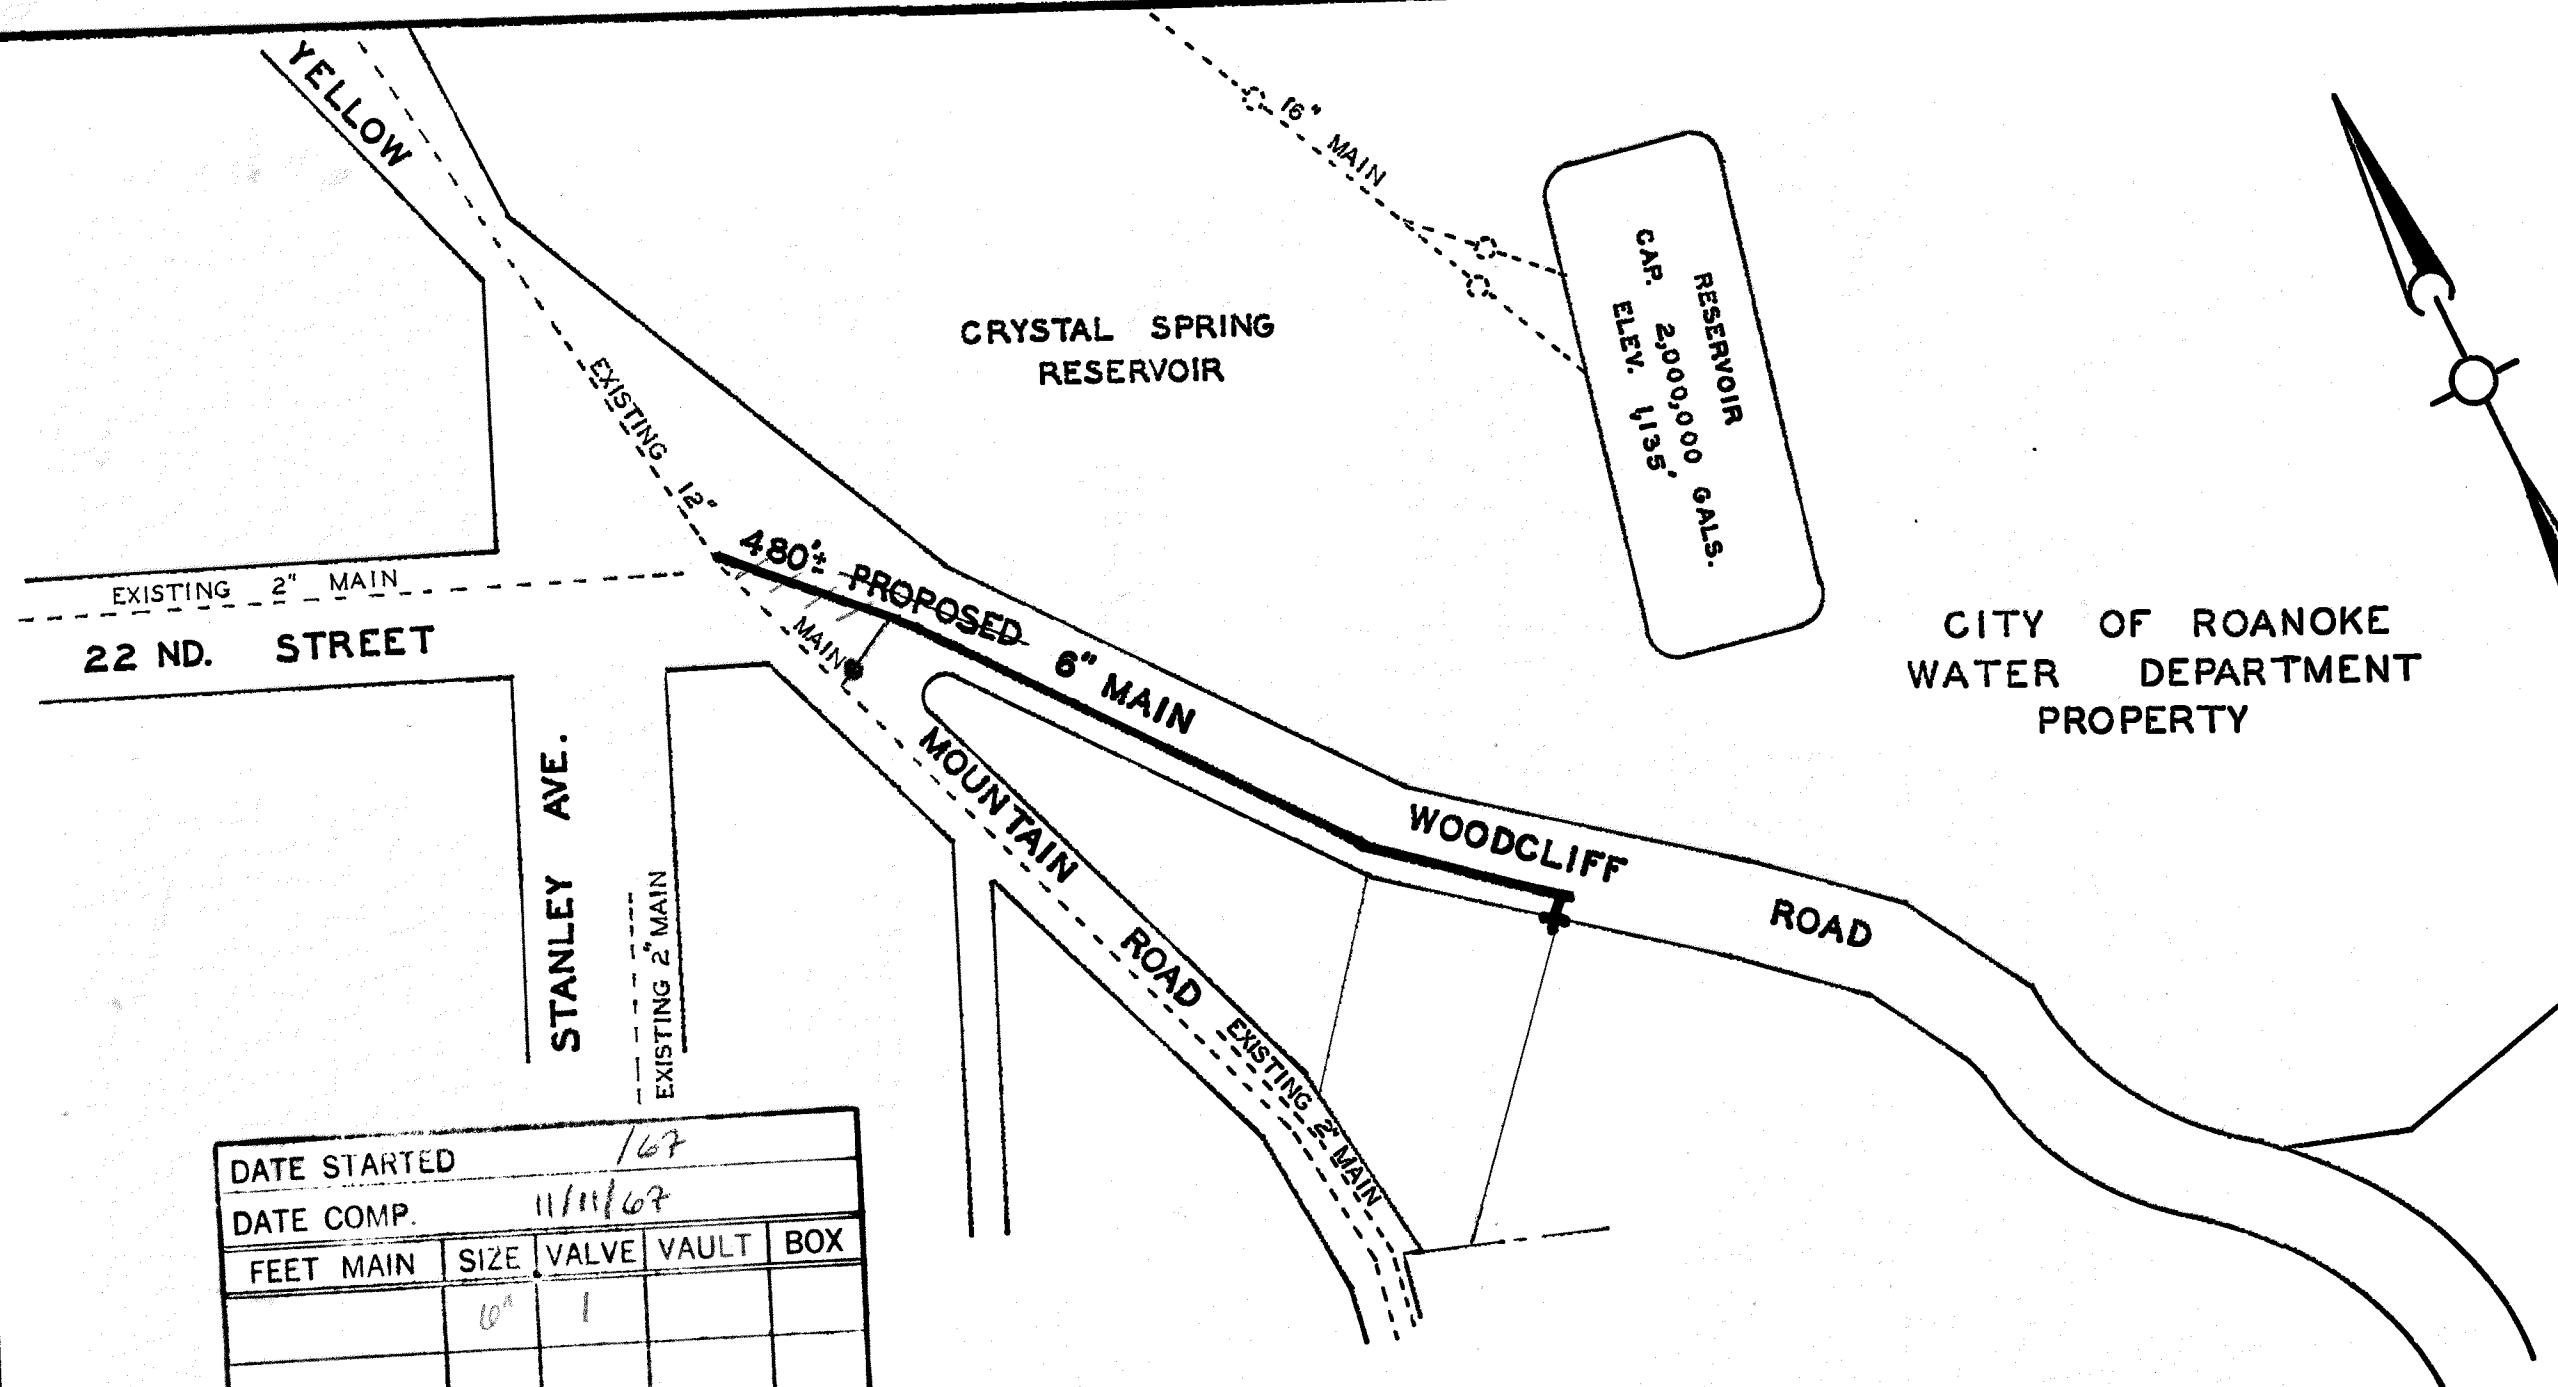

DATE STARTED 1/67				
DATE COMP. 11/11/67				
FEET MAIN	SIZE	VALVE	VAULT	BOX
	6"	1		
F. H. COMP.	1			
F. H. STUB ONLY				
SERV. INS. BY:				
MAINS INS. BY:				
NO. 3/4" SERV. INS.				
CITY OR CO.				
DEPT. INSP.				

WATER DEPARTMENT
CITY OF ROANOKE, VA.
WOODCLIFF ROAD S.E.

SCALE 1"=100'
DRAWN BY- C.G.C OCTOBER 27, 1967