


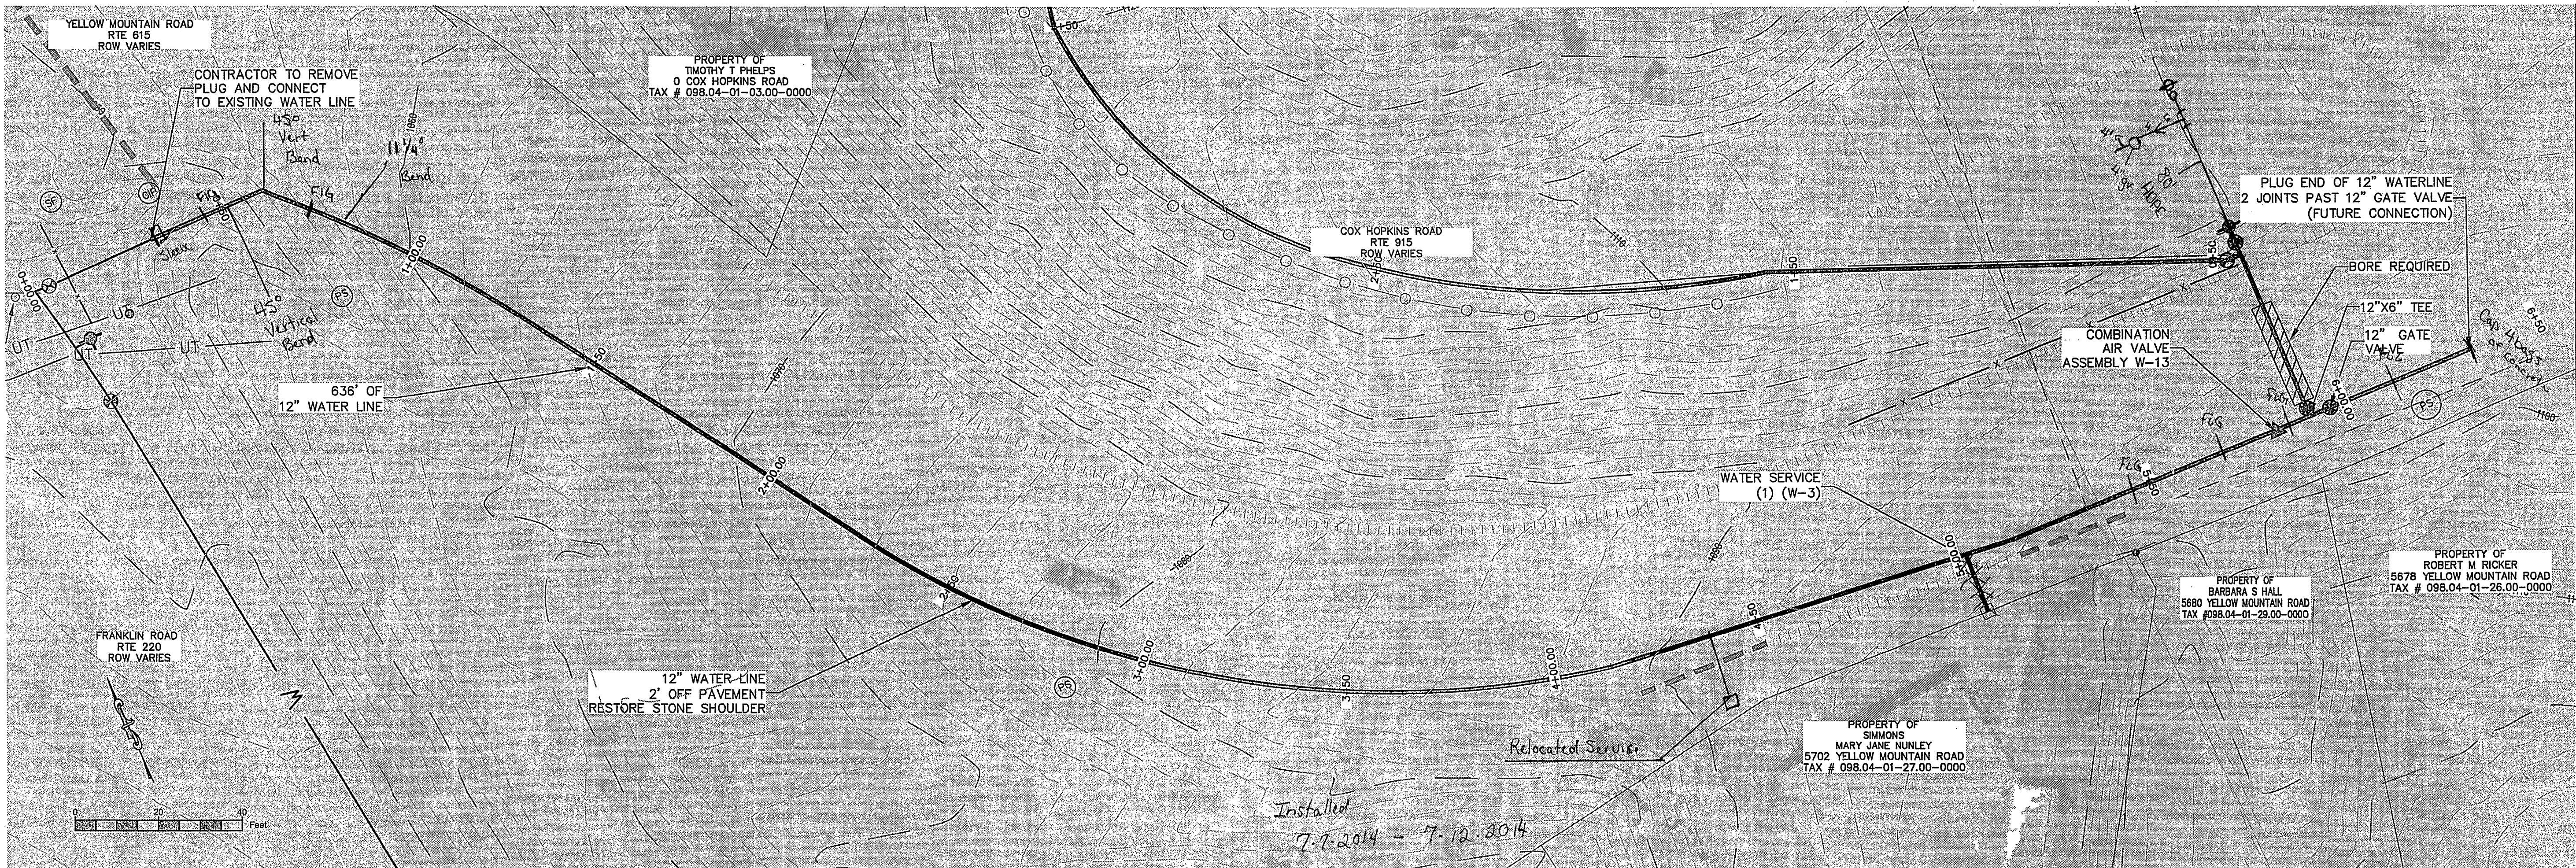


CONTRACTOR NOTES


1. CONTRACTOR TO COORDINATE LOCATION OF SERVICE LINE & METER WITH PROPERTY OWNERS PRIOR TO INSTALLATION.
2. MAXIMUM WORKING PRESSURE 155 PSI.

VDOT NOTE

- Found Leak
Tried testing 7-15-2014 (would hold 400) P.S.I.
1. ANY EXISTING ROADSIDE DITCHES THAT ARE DISTURBED DURING WATER LINE INSTALLATION SHALL BE RESTORED TO EXISTING CONDITIONS.
 2. CONTRACTOR TO INSTALL WORK ZONE PROTECTION AS SHOWN IN DETAILS FROM VIRGINIA WORK AREA PROTECTION MANUAL DETAIL TTC-23 (SEE SHEET 4).

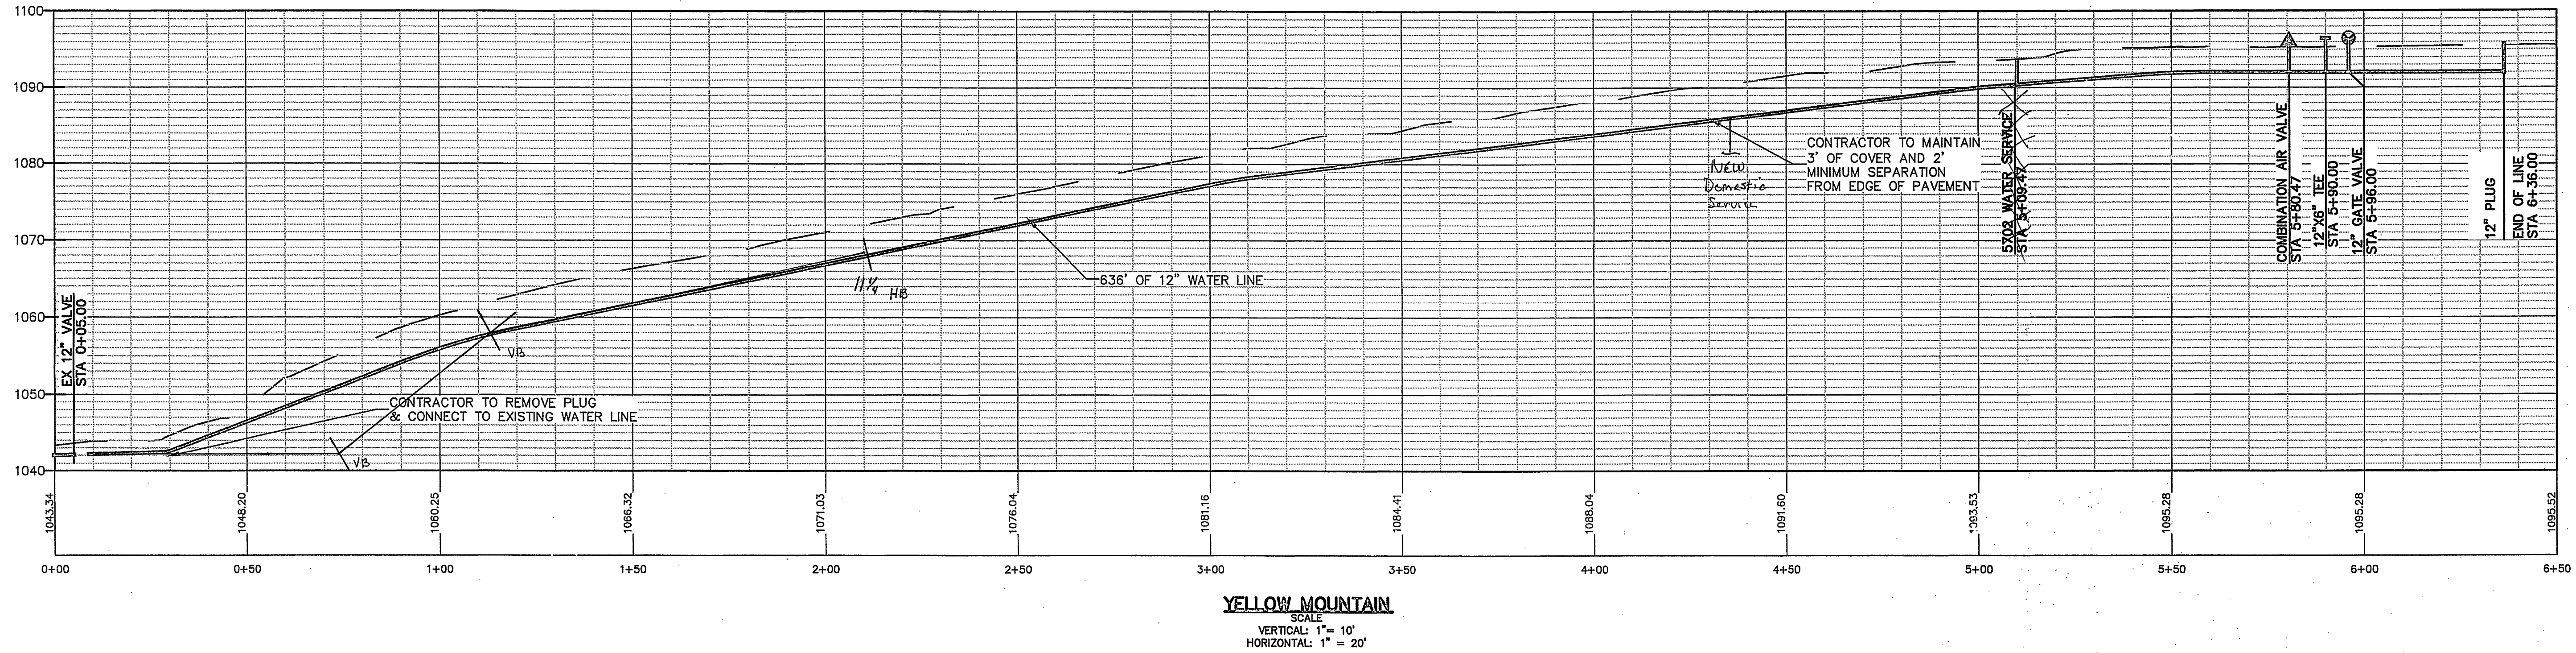

WESTERN VIRGINIA
WATER AUTHORITY
ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5641 or 540-853-5770

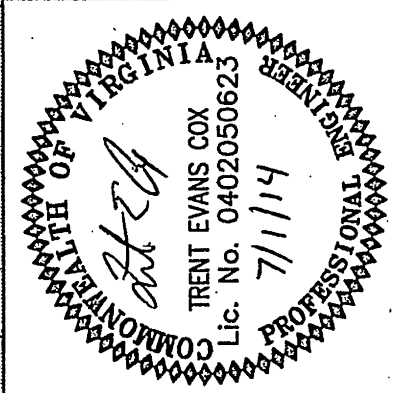

YELLOW MOUNTAIN WATER

YELLOW MOUNTAIN
PLAN & PROFILE

Rev	Description	Date	By
1.	YELLOW MT ROAD BORE REQUIRED	6-21-13	
2.	VALUE ENGINEERING CHANGES BY OWNER	6-12-14	
3.	VDOT TRAFFIC DETAILS	7-1-14	

Designed: AAS
Drawn: AAS
Checked: RRB
Approved: RRB
Date: 6-3-13
Project: