


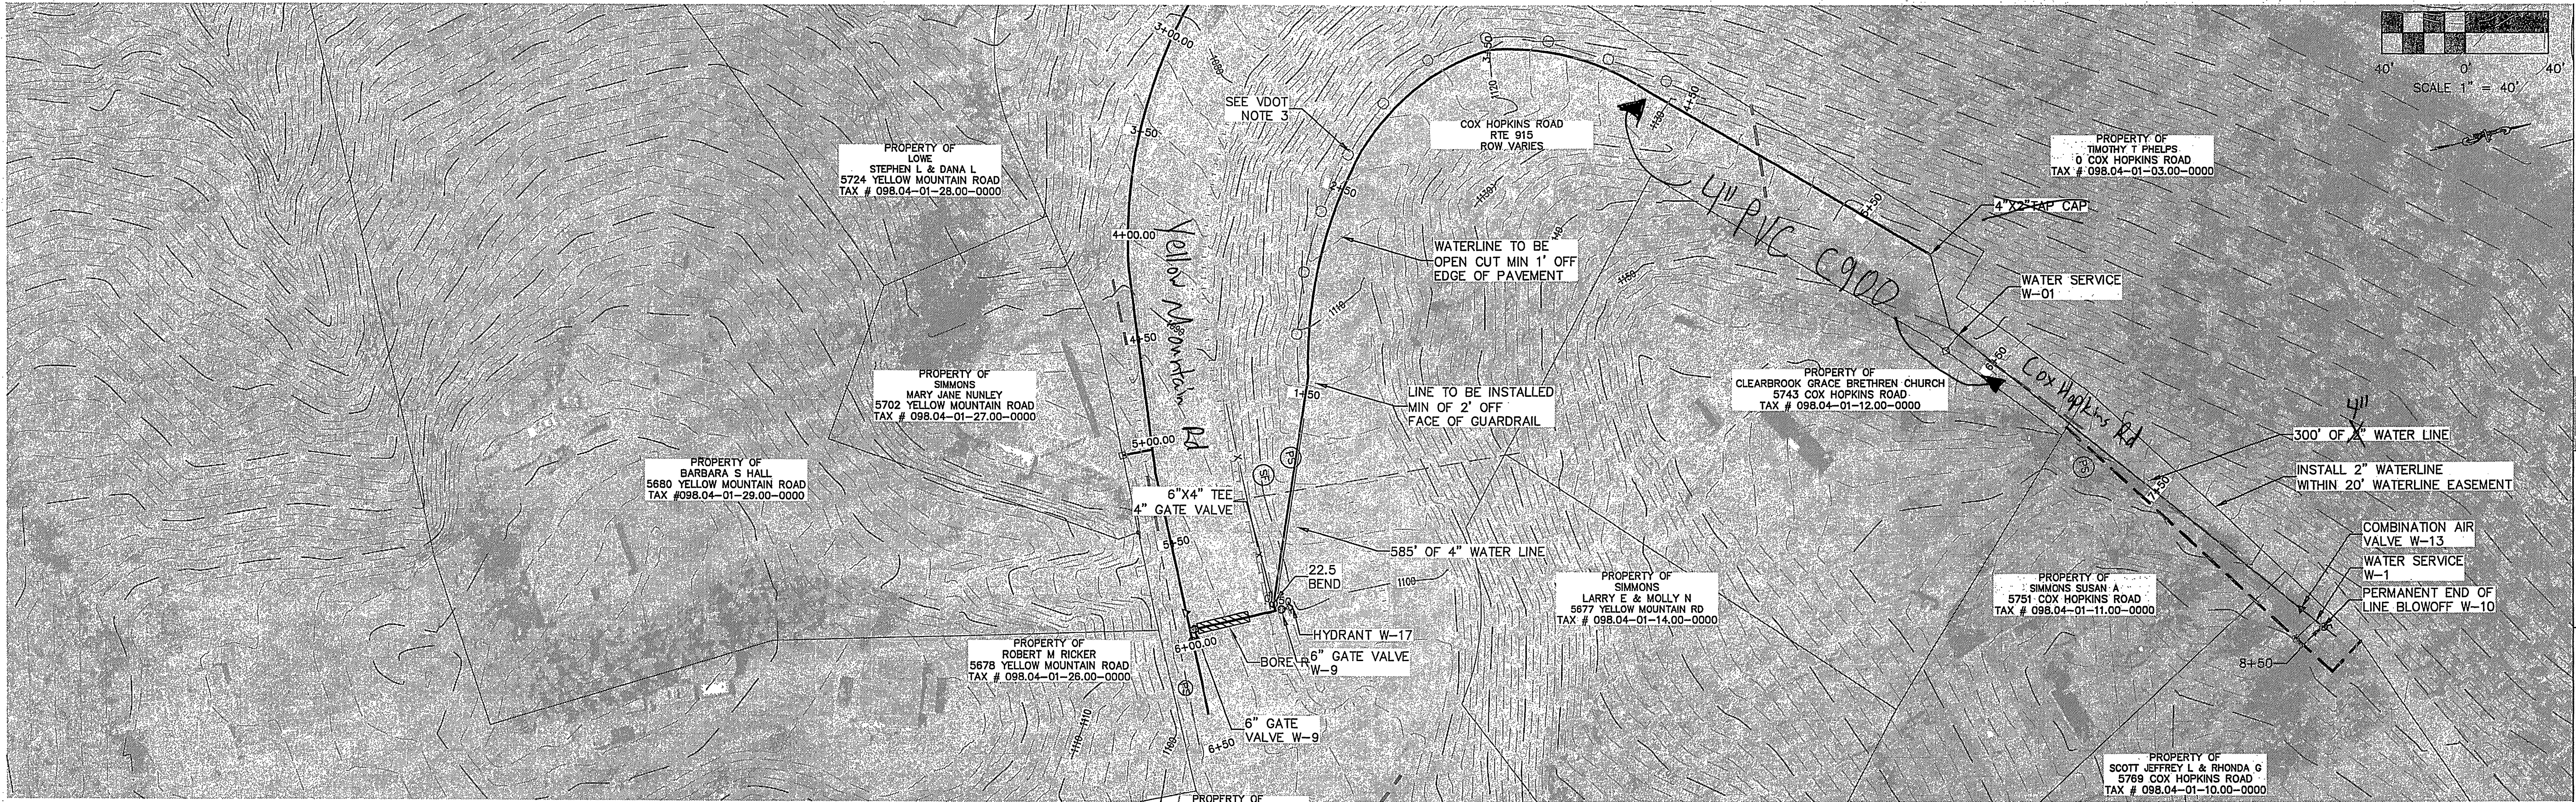


VDOT NOTE

1. ANY EXISTING ROADSIDE DITCHES THAT ARE DISTURBED DURING WATER LINE INSTALLATION SHALL BE RESTORED TO EXISTING CONDITIONS.
2. CONTRACTOR TO INSTALL WORK ZONE PROTECTION AS SHOWN IN DETAILS FROM VIRGINIA WORK AREA PROTECTION MANUAL DETAIL TTC-23 (SEE SHEET 4).
3. ANY DAMAGE TO THE EXISTING GUARDRAIL DUE TO INSTALLATION OF WATERLINE WILL NEED TO BE REPAIRED/REPLACED PER VDOT STANDARDS.

CONTRACTOR NOTES

1. CONTRACTOR TO COORDINATE LOCATION OF SERVICE LINES WITH PROPERTY OF OWNERS PRIOR TO INSTALLATION.
2. MAXIMUM WORKING PRESSURE 155 PSI.

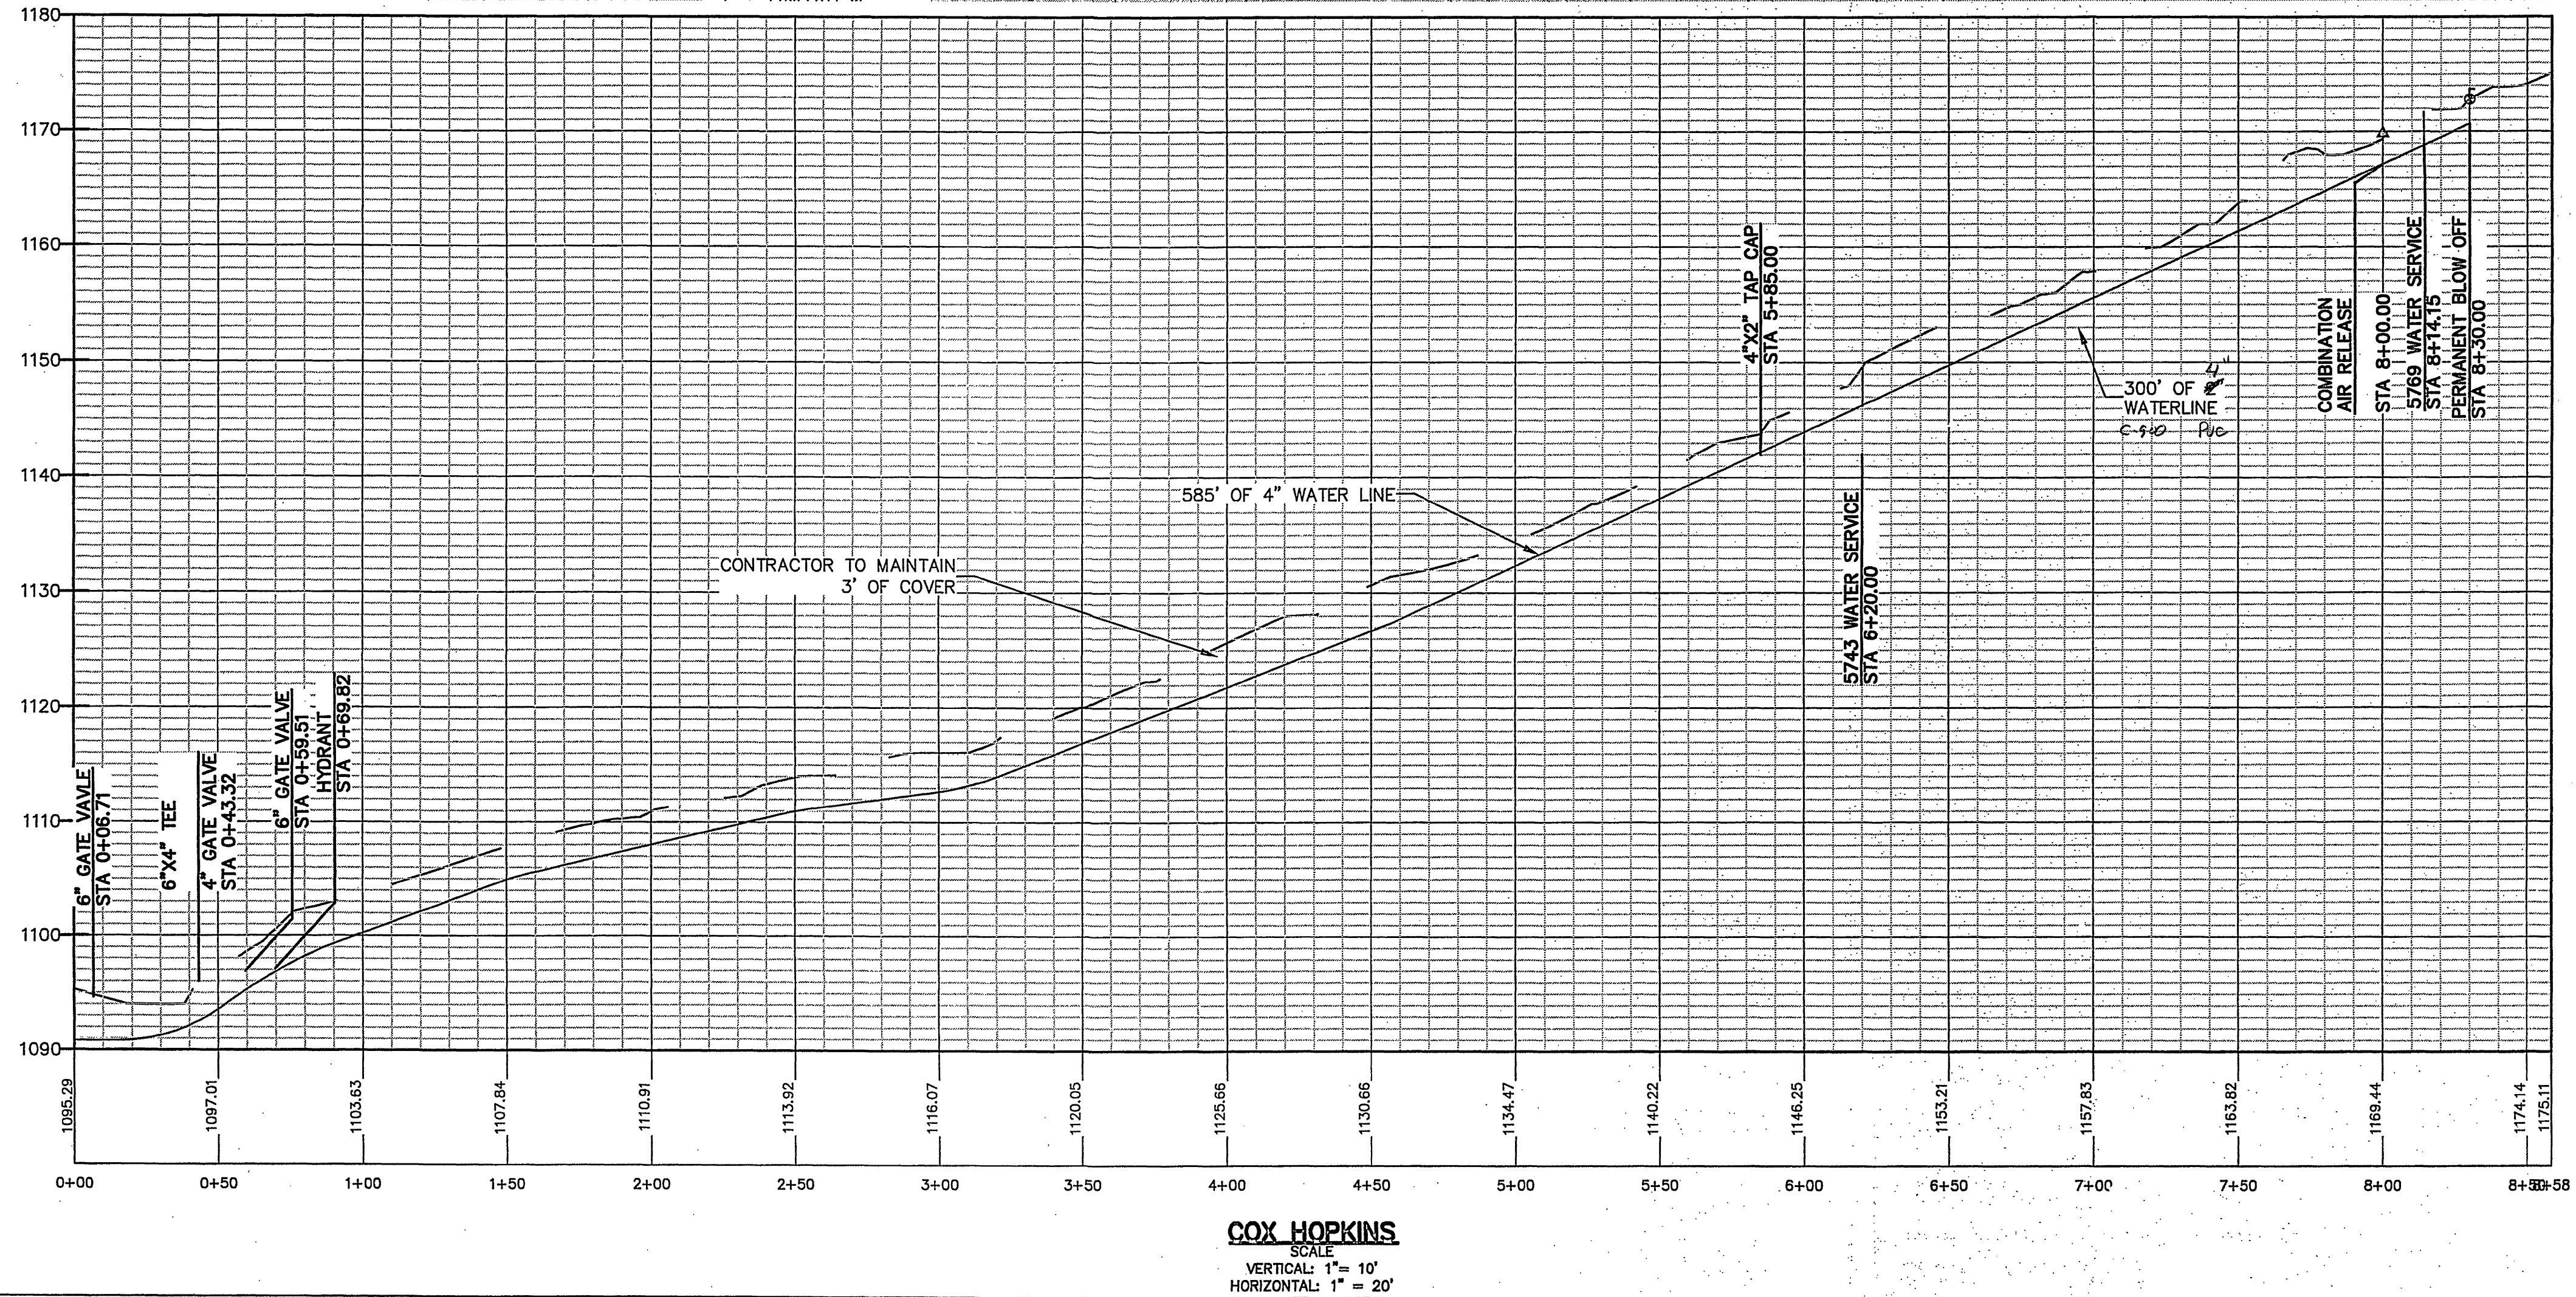

WESTERN VIRGINIA
WATER AUTHORITY
ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5641 or 540-853-5770



YELLOW MOUNTAIN WATER
COX HOPKINS
PLAN & PROFILE

Rev	Description	Date	By
1.	WATERLINE ALIGNMENT AND DESIGN CHANGES	6-21-13	
2.	VDOT TRAFFIC DETAILS	7-1-14	
Designed: AAS			
Drawn: AAS			
Checked: RRB			
Approved: RRB			
Date: 6-3-13			
Project:			
3			
Sheet 3 of 5			