



All interior metal and piping shall be painted 2 coats of enamel color - grey

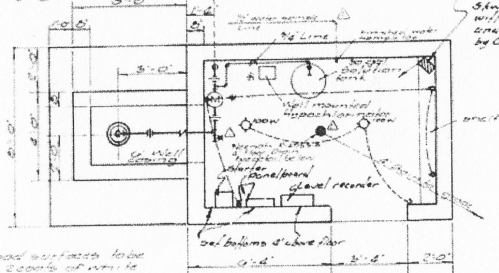

PLAN

All road surfaces to be
given coats of white
emulsion.

Contractor shall provide
conforming test kit for the
water supply station. The
test kit shall be listed
for the field kit kit #CN-
50 is 0-2 ppm range or
greater. CN-50

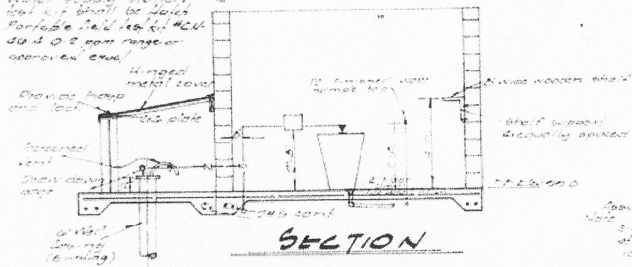


WELL HOUSE DETAIL


Pipe to be wrapped
with heat tape and
insulated with cellular
foam plastic from top
of well to building




4' FLOOR DRAIN

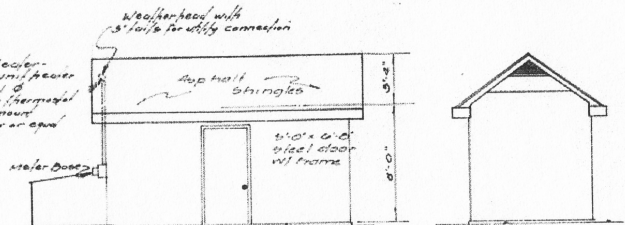


FRONT ELEVATION RIGHT SIDE

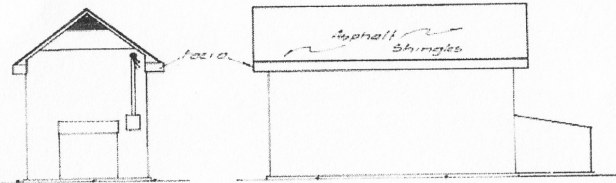



LEFT SIDE REAR ELEVATION

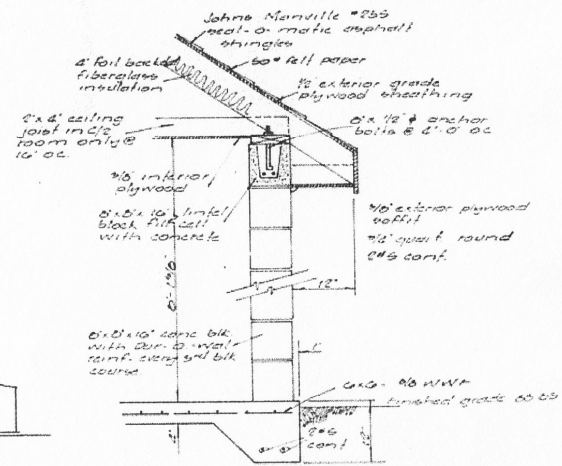


TYPICAL WALL SECTION

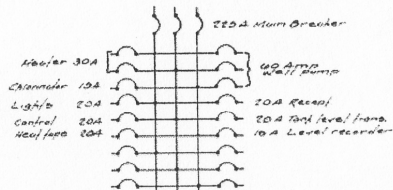

Main panel board 120/240V
3 phase, 4 wire, 250 amp
Main breaker 3/4"
Cutter Hammer model #CHP20-3C
or equiv. 20 pc/c spacers

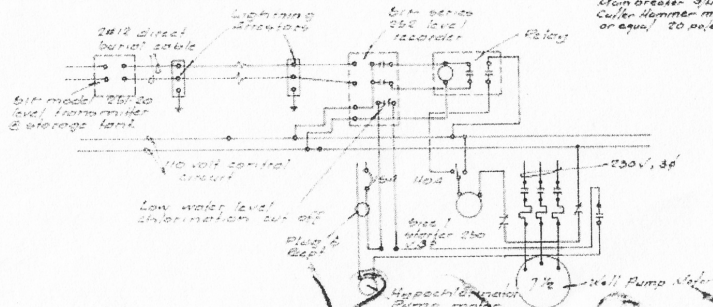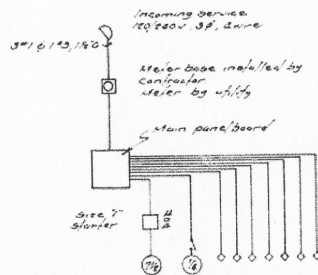

WIRING DIAGRAMS

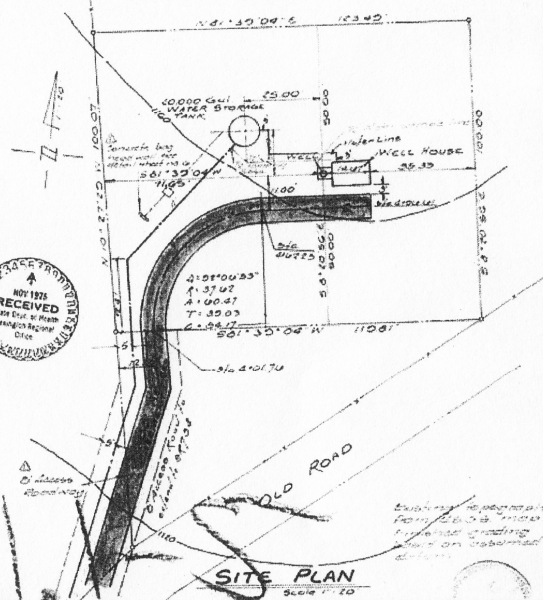

SITE PLAN

REVISIONS					job number: 1220-0
no.	date	description	by	chkd.	date: Aug 1976
1	8/1/76	add 1000' to 1000'	W.C.		designed by: W.C.
2	8/1/76	add 1000' to 1000'	W.C.		drawn by: W.C.
3	8/1/76	add 1000' to 1000'	W.C.		approved by: W.C.

TOWN OF EAGLE ROCK

RURAL WATER SYSTEM

DEMONSTRATION WATER PROJECT

WELL HOUSE

BOTETOURT COUNTY,

VIRGINIA

scale
As SHOWN

sheet

5

of

6