



Notes:

- 1. TANK SHALL BE IN ACCORDANCE WITH AWWA D100.
- 2. STEEL CONSTRUCTION SHALL CONFORM TO APPLICABLE PROVISIONS OF THE AISC CODE OF STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES; THE AISC SPECIFICATIONS FOR THE DESIGN, FABRICATION, AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS; AND THE AWS CODE FOR WELDING IN BUILDING CONSTRUCTION.
- 3. WELDING SHALL BE PERFORMED BY WELDERS QUALIFIED IN ACCORDANCE WITH THE REQUIREMENTS OF THE AWS CODE.
- 4. ELECTRODES SHALL BE E6010.
- 5. STRUCTURAL BOLTS SHALL BE A325.
- | 6. ALL TANK ACCESSORIES TO BE FIELD LOCATED BY OWNER'S
- REPRESENTATIVE.

  EXACT LOCATION OF INLET, OUTLET, DRAIN AND OVERFLOW TO BE DETERMINED DURING FIELD CONSTRUCTION.
- 10. WATER LINES TO BE TIED TO EXISTING WATER LINES.



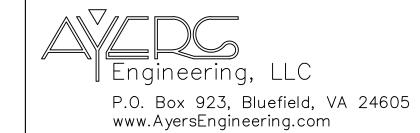

SUPPLIER:

TANK SUPPLIER: EASTERN TANK
145 KRIT ROAD
PRINCETON, WV 24739

CONTRACTOR:

EAGLE ROCK TANK EAGLE ROCK, VA

TANK DETAILS

 SCALE AT A1:
 DATE:
 DRAWN:
 CHECKED:

 NTS
 12/06/21
 BA
 BA

 PROJECT NO:
 DRAWING NO:
 REVISION:

 21041
 T2
 O