


POWER DEMOLITION PLAN
SCALE: 1/8" = 1'-0"

GENERAL SHEET NOTES

1. REFER TO DRAWINGS E0.01 FOR LEGEND AND ABBREVIATIONS AND E0.02 FOR DEFINITIONS AND GENERAL NOTES.
2. COORDINATE DEMOLITION WORK WITH OTHER TRADES AND UTILITIES IN THE BUILDING.
3. DEMOLISH ALL EQUIPMENT AND DEVICES IN THE AREA OF DEMOLITION. ALL DISCONNECTED CIRCUITS SHALL BE DEMOLISHED BACK TO THEIR SOURCE INCLUDING ALL ASSOCIATED WIRING AND BOXES, UON.
4. ELECTRICAL EQUIPMENT LABELED WITH "ETR" ARE EXISTING TO REMAIN.
5. ALL DISCONNECTED CIRCUITS SHALL BE REMOVED BACK TO THEIR SOURCE INCLUDING ALL ASSOCIATED WIRING AND BOXES, UON.
6. ALL EQUIPMENT, DEVICES AND WIRING SHALL BE DISPOSED BY APPROVED MEANS.
7. CIRCUIT TRACE EXISTING RECEPTACLES AND EQUIPMENT ADJACENT TO DEMOLITION AREA. PROVIDE ALL NECESSARY PROVISIONS TO PROVIDE CONTINUOUS OPERATION OF THE RECEPTACLES AND EQUIPMENT OUTSIDE OF THE CONSTRUCTION AREA. DO NOT DEMOLISH CIRCUITS PASSING THROUGH THE AREA OF DEMOLITION SERVING DEVICES OUTSIDE THE AREA TO REMAIN.
8. CIRCUIT TRACE EXISTING RECEPTACLES AND EQUIPMENT PRIOR TO DEMOLITION TO PREVENT INTERRUPTION TO EXISTING RECEPTACLES AND EQUIPMENT /CIRCUITS TO REMAIN.

DEMOLITION KEYNOTES

- ① DEMOLITION AREA, DEMOLISH EXISTING RECEPTACLES, DISCONNECT SWITCHES, MOTORS AND ASSOCIATED BRANCH WIRING BACK TO SOURCE. PANEL 'ORP'.
- ② DEMOLISH EXISTING VOICE/DATA OUTLETS, ASSOCIATED WIRING BACK TO SOURCE RACK.
- ③ EXISTING FILTER BAY PLC PANEL TO REMAIN. DEMOLISH EXISTING 120V 20-AMP BRANCH CIRCUIT BACK TO SOURCE PANEL EFP. LABEL PANELBOARD DIRECTORY AS SPARE.

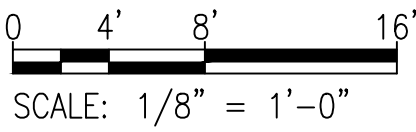

WESTERN VIRGINIA WATER AUTHORITY
601 South Jefferson Street, Suite 300
Roanoke, Virginia 24011

DES:	EJB	SCALE:	1/8" = 1'-0"
DRAWN:	EJB	HORIZ:	N/A
CHECK:	IHK	VERT:	N/A
DATE:	1/24/20		

CRYSTAL SPRING
PUMP STATION RELOCATION

ELECTRICAL POWER DEMOLITION PLAN

DRAWING
ED3.01

SHEET
54

REV	DATE	DESCRIPTION