



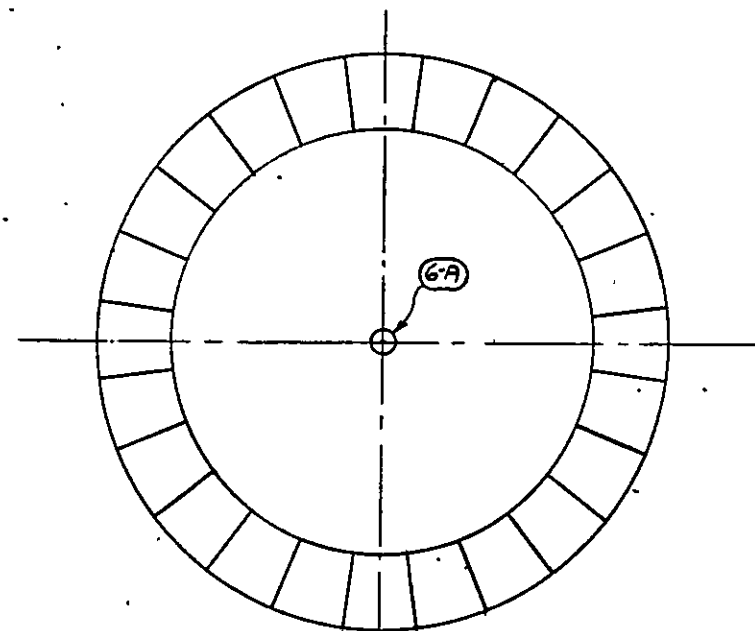

PLAN

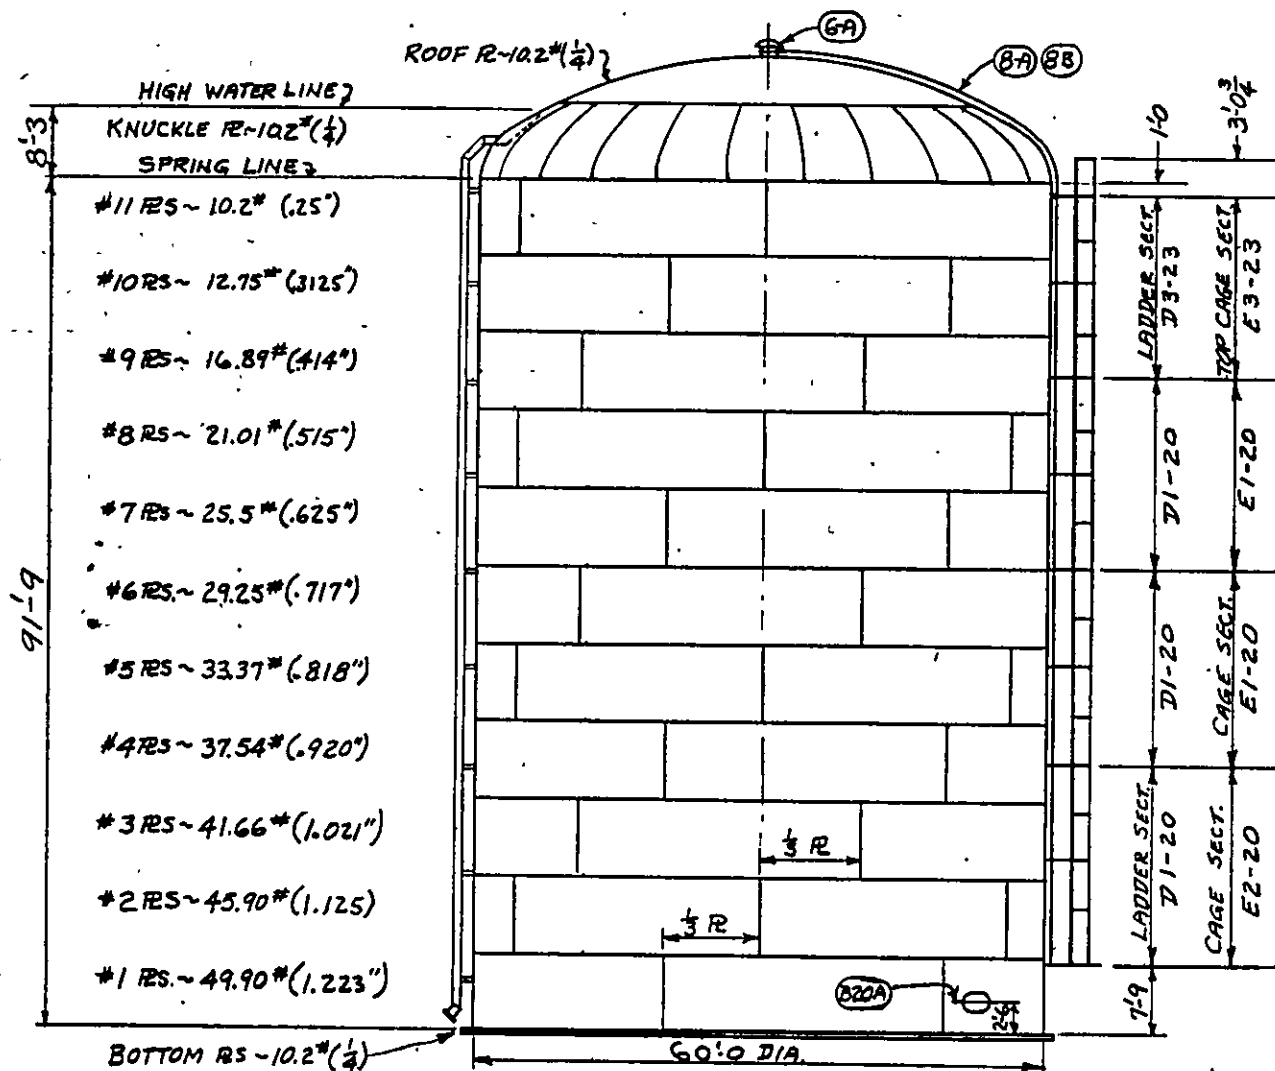


APPROVED

ALVORD, BURDICK & HOWSON

BY *[Signature]*

DATE JAN 7 1963

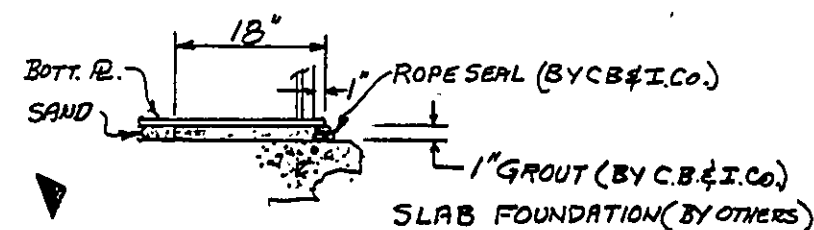

DRAWINGS & FITTINGS FURNISHED & INSTALLED BY C.B. & I. CO.

MARK	DRAWING	REQ.	DESCRIPTION
	1		GENERAL PLAN
	5A60		BOTTOM
	2		SHELL
	3		ROOF SECTION & KNUCKLE
	4		ROOF DOME
5-A	5	1	8" OVER FLOW
6-A	6	1	24" VENT
7-1	7	1	16" INLET CONN. & SILT STOP
8A & 8B	8	1	REVOLVING ROOF LADDER
	B20A	1	18x24" SHELL MANHOLE
	B5	1	24" RAINPROOF DOOR
D1-20	D1	3	LADDER SECTION
D3-23	D3	1	TOP LADDER SECTION
E2-20	E2	1	BOTTOM CAGE SECTION
E1-20	E1	2	CAGE SECTION
E3-23	E3	1	TOP CAGE SECTION
	P1, P2, P3		CLEANING & PAINTING INSTRUCTIONS
		1	ELECTRO RUST PROOFING CATHODIC PROTECTION SYSTEM

GENERAL NOTES

- FOUNDATION - BY OTHERS (GROUT AND SEAL BY C.B. & I. Co.)
- ERECTION - BY CHICAGO BRIDGE & IRON COMPANY
- SERVICE - WATER
- CAPACITY - 2,000,000 GAL.
- SPECIFICATIONS - AWWA # ALVORD, BURDICK & HOWSON (CONTRACT #)
- STEEL - PLATES AND GR.C. STRUCTURAL A7
- INSPECTION - MILL - CTR.
- SHOP - NO
- FIELD - YES, BY CUSTOMER'S REPRESENTATIVE
- PICKLING - SEE P1, P2, P3
- PAINTING - SEE P1, P2, P3
- FITTINGS - TO BE LOCATED AS SHOWN OR TO SUIT CUSTOMER IN FIELD.
- EDGES OF ADJACENT REINFORCING PLATES MUST BE AT LEAST 12" APART.
- NOZZLE BOLT HOLES TO STRADDLE VERTICAL & RADIAL CENTERLINES.
- STERILIZATION IN ACCORDANCE WITH SPECIFICATIONS

DETAILS & MATERIAL FOR ONE TANK - 1 REQ'D.

