
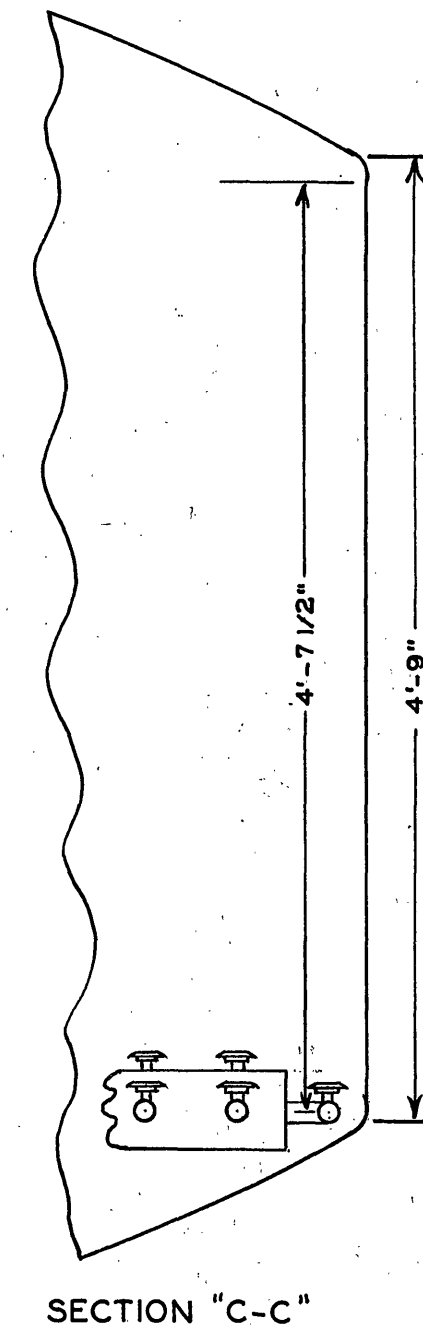


ALL LATERALS - 1 1/4" PIPE

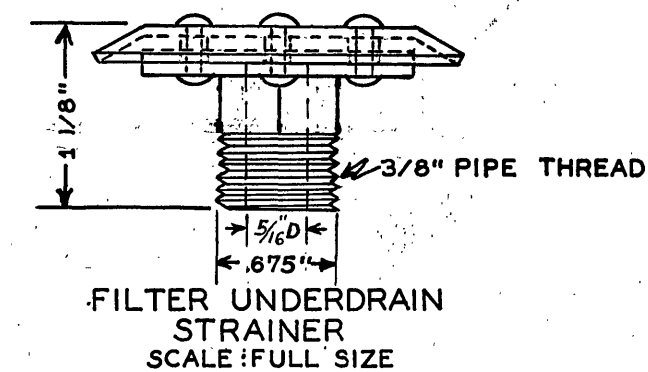

WATER DEPARTMENT
CITY OF ROANOKE, VA.
UNDERDRAIN SYSTEM
FALLING CREEK FILTER PLANT
SCALE: 1" = 1'-0"
(EXCEPT AS SHOWN)
DRAWN BY E.L.A. FEBRUARY 11 1952