





1. FLAT WASHERS TO BE PLACED ON PAINTED SURFACES WITH SHEAR EDGE OF WASHER AWAY FROM PAINT.
2. DO NOT OVERTIGHTEN FASTENERS.
3. SURFACE WASH ARMS (ITEM 15) TO BE LEVEL AND ROTATE FREELY.
4. INSTALL AND LEVEL EFFLUENT HEADS (ITEM 11) BEFORE INSTALLING UNDERDRAIN. LATERALS (ITEM 12). GRIFFETS OF LATERALS TO POINT DOWN.
5. REFER TO INDIVIDUAL ASSEMBLY DRAWINGS FOR ASSEMBLY OF FLOCCULATOR, TUBE MODULES, AND MEDIA INSTALLATION.
6. PLACE CARDBOARD OR OTHER PROTECTIVE COVERING INTO TANK WHEN PATCH DRILLING.
7. ALL EQUIPMENT AND PIPING TO BE LOCATED ACCORDING TO CONTRACT DRAWINGS.
8. EFFLUENT AND OVERFLOW NOZZLES HAVE VICTALIC® GROOVES FOR FLANGES (STYLE 741) OR COUPLINGS (STYLE 77). FLANGES AND COUPLINGS NOT SUPPLIED BY MICROFLOC PRODUCTS®.
9. 
10. DO NOT EXPOSE SETTLING TUBE MODULES TO FLAME, WELD SPLATTER, OR HIGH HEAT.
11. SEE ITEMS 38 THRU 43 OF B.O.M. FOR MIXING & CHEMICAL FEED EQUIPMENT FURNISHED BY CPC-MICROFLOC INC.

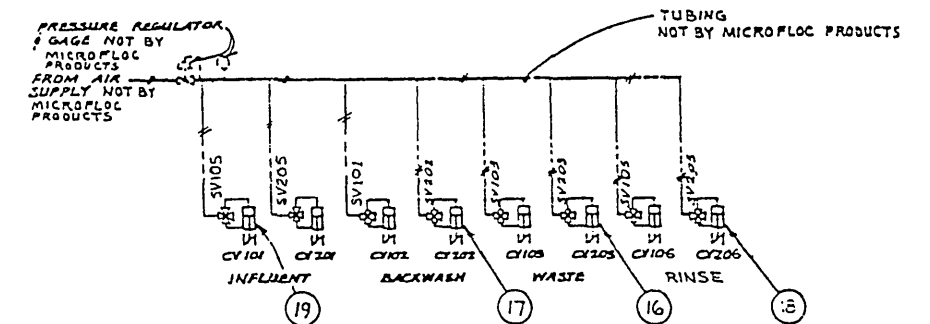

CONTROL VALVE AIR PIPING SCHEMATIC
ISOLATION VALVE RECOMMENDED AT EL BRANCH CONNECTION

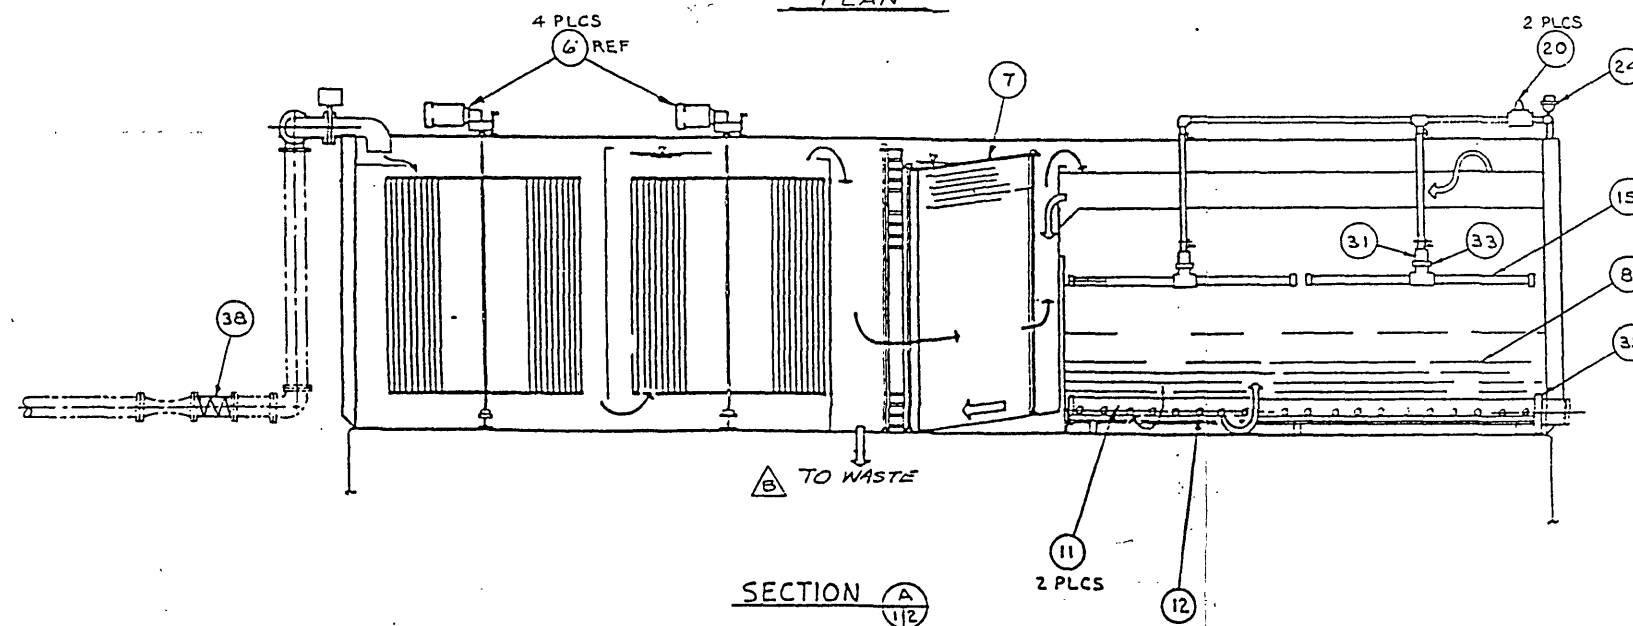

ELEVATION
BACKWASH END

SEE SEPARATE BILL OF MATERIAL

THIS SHIPPER AND INCORPORATED
CONTAINS THEREIN OF THE
PROPERTY OF WICHOLOC
PACKETS AND MUST NOT BE
USED IN ANY WAY DETRIMENTAL
TO THE INTEREST OF THE COR-
PORATION. THIS SHIPPER MUST
BE RETURNED AT THE REQUEST
OF WICHOLOC PRODUCTS.

microfloc.
PRODUCTS

SCALE _____

NOTE: DO NOT SCALE FROM THE DRAWING TO OBTAIN DIMENSIONS.

DRAWING	DATE:
BH	8-28-8
COORDINATOR	DATE:
EG	AUG 87
CHECKER	DATE:
EG	AUG 87
APPROVED	DATE:

FALLING CREEK WTP
ROANOKE, VIRGINIA
MODULAR AQUARIUS® AQ-300B
ASSEMBLY EQUIPMENT

DRAWING NUMBER -		REV.
P6376-1	B	
A6A-20	1	
SHEET	OF	