



FILTERED WATER WET WELL PANEL

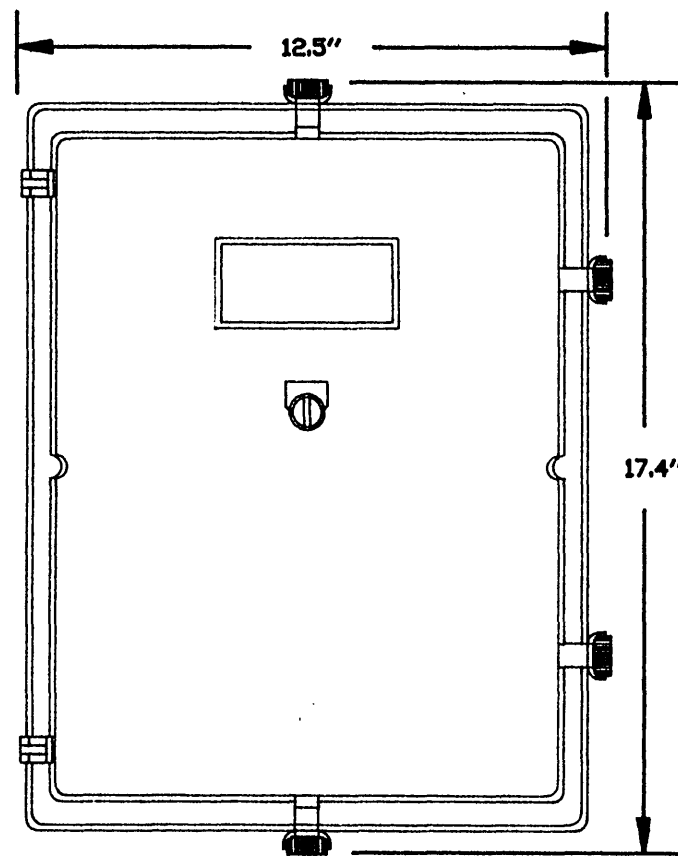


FRONT VIEW
SCALE: 1/4" = 1"
TAG: ENC-1

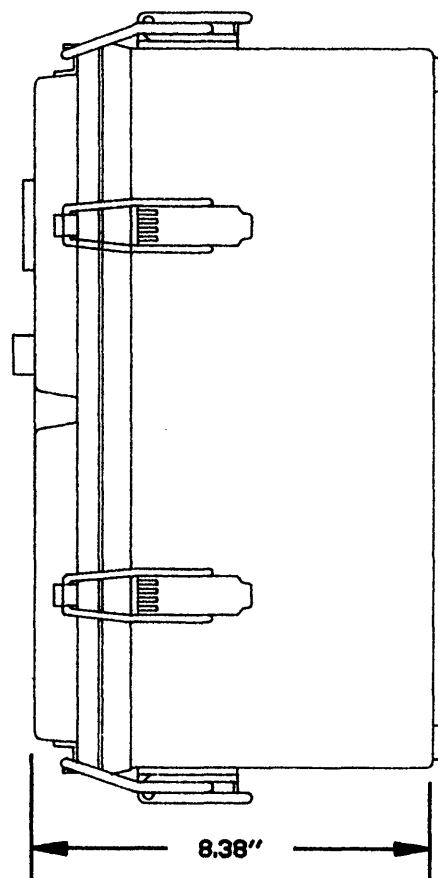


SIDE VIEW
SCALE: 1/4" = 1"

BILL OF MATERIAL


TAG	QTY	PART NO.	DESCRIPTION	MANUFACTURER
ENC-1	1	A-16128JFGOR	NEMA TYPE 4X FIBERGLASS ENCLOSURE	HOFFMAN
BACKPAN	1	A-14P12	BACK PANEL	HOFFMAN
LI-1	1	PD610-3-6	INDICATOR W/LEVEL CONTROL	PRECISION DIGITAL
LSH-1	1	PTA 4034-17	ALARM TRIP	AGM
CR-1 TO CR-8	8	RH2B-U AC120	DPDT RELAY	IDEC
SS-13	1	E22XGR1RR	3 PDS. SWITCH	CUTLER-HAMMER
FD-1	1	WS16	FUSED DISCONNECT	WEIDMULLER
TERMS	18	VDU 2.5	TERMINALS	WEIDMULLER
	1	FNM 5	FUSE 5 AMP	BUSS

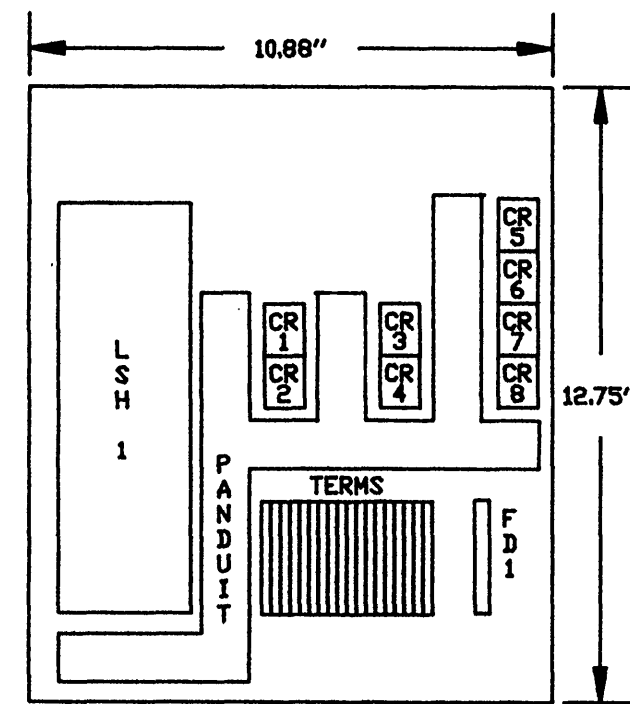



BACK PANEL
SCALE: 1/4" = 1"
TAG: BACKPAN

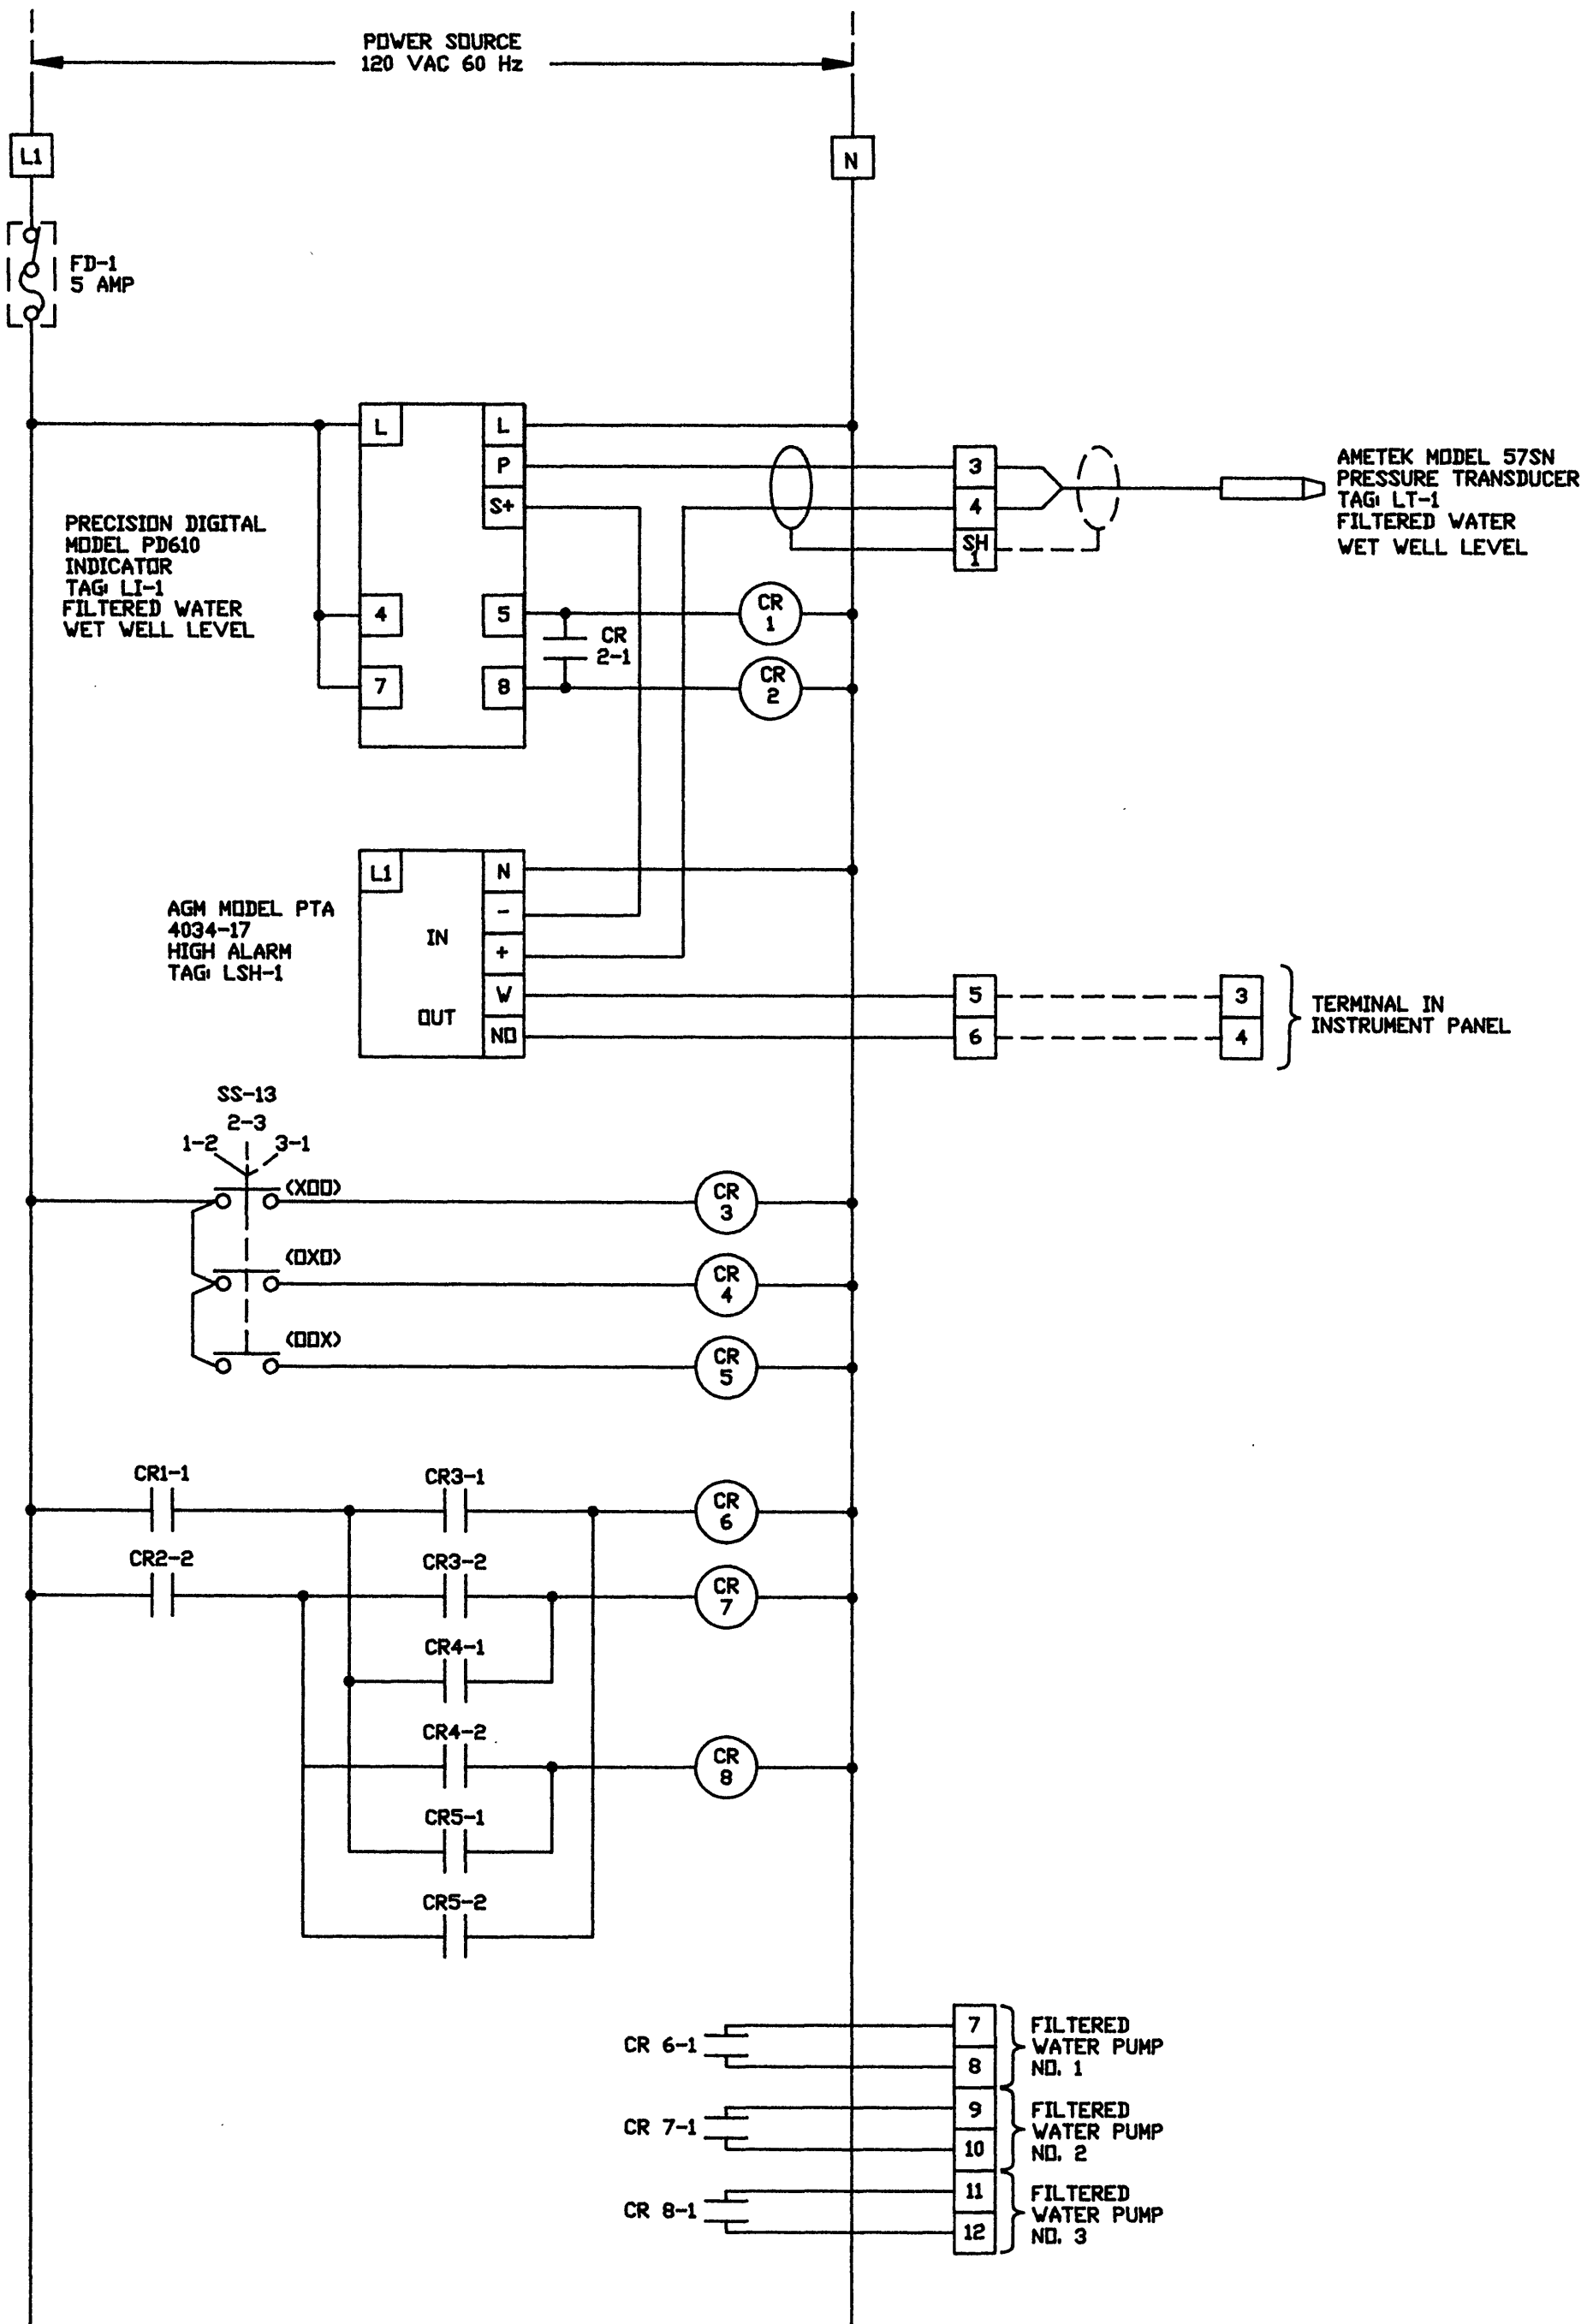


CLEARWELL LEVEL PANEL

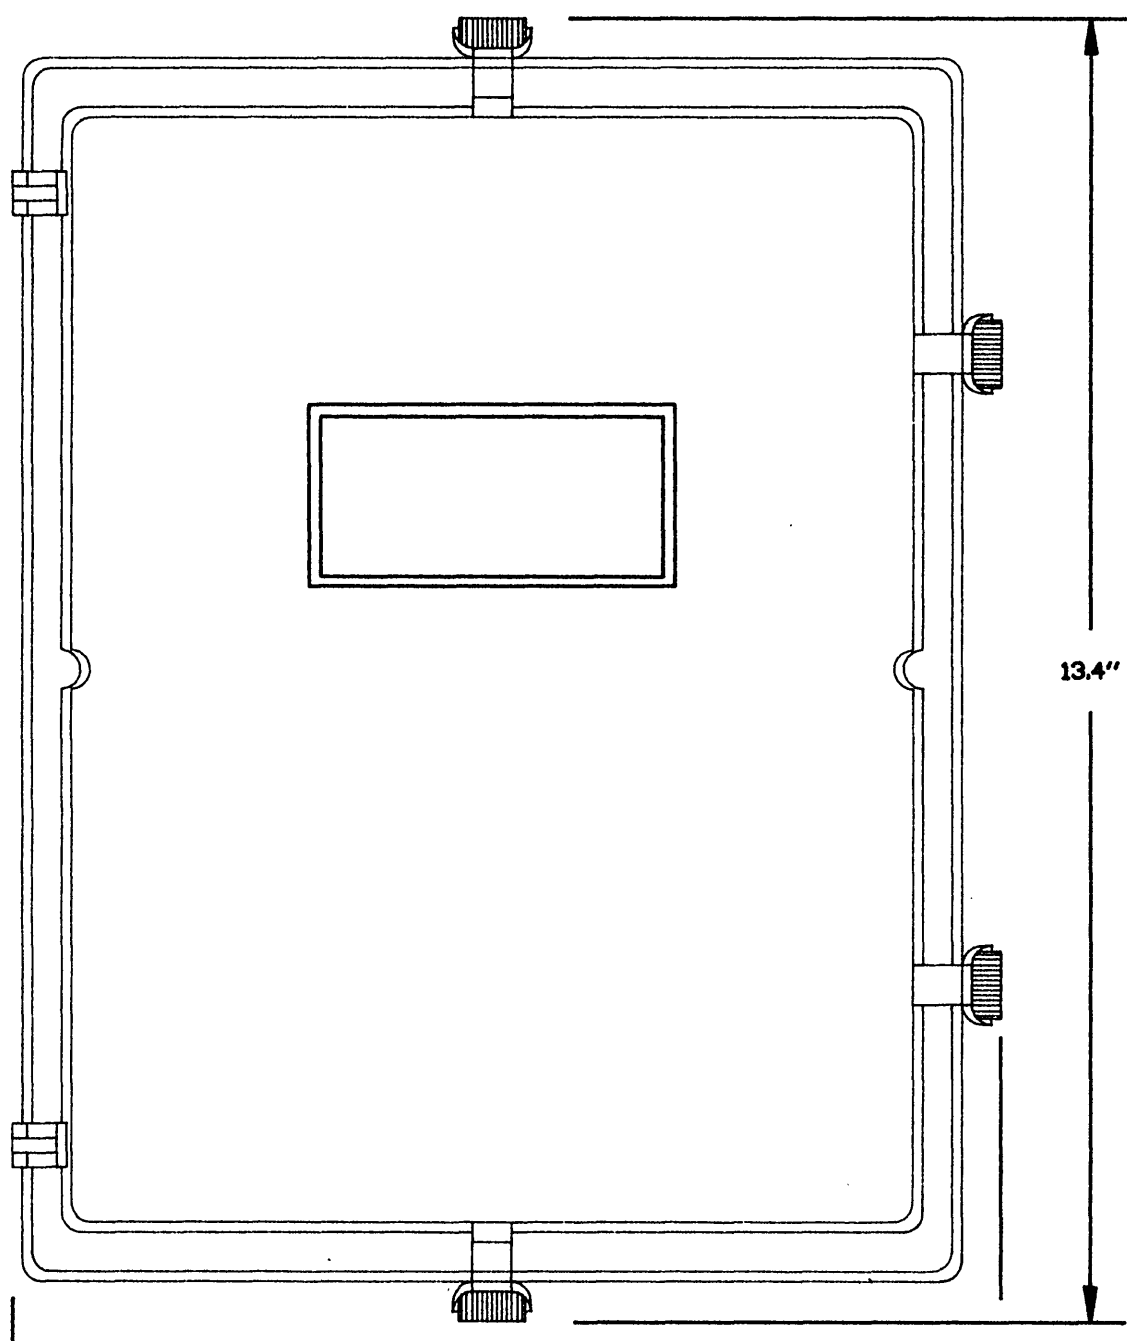

FRONT VIEW
SCALE: 1/2" = 1"
TAG: ENC-1

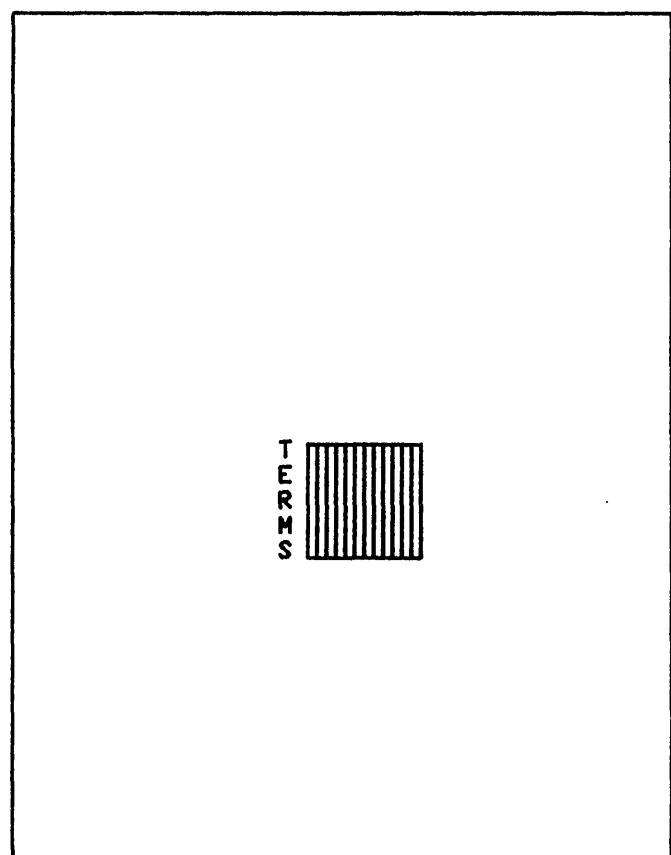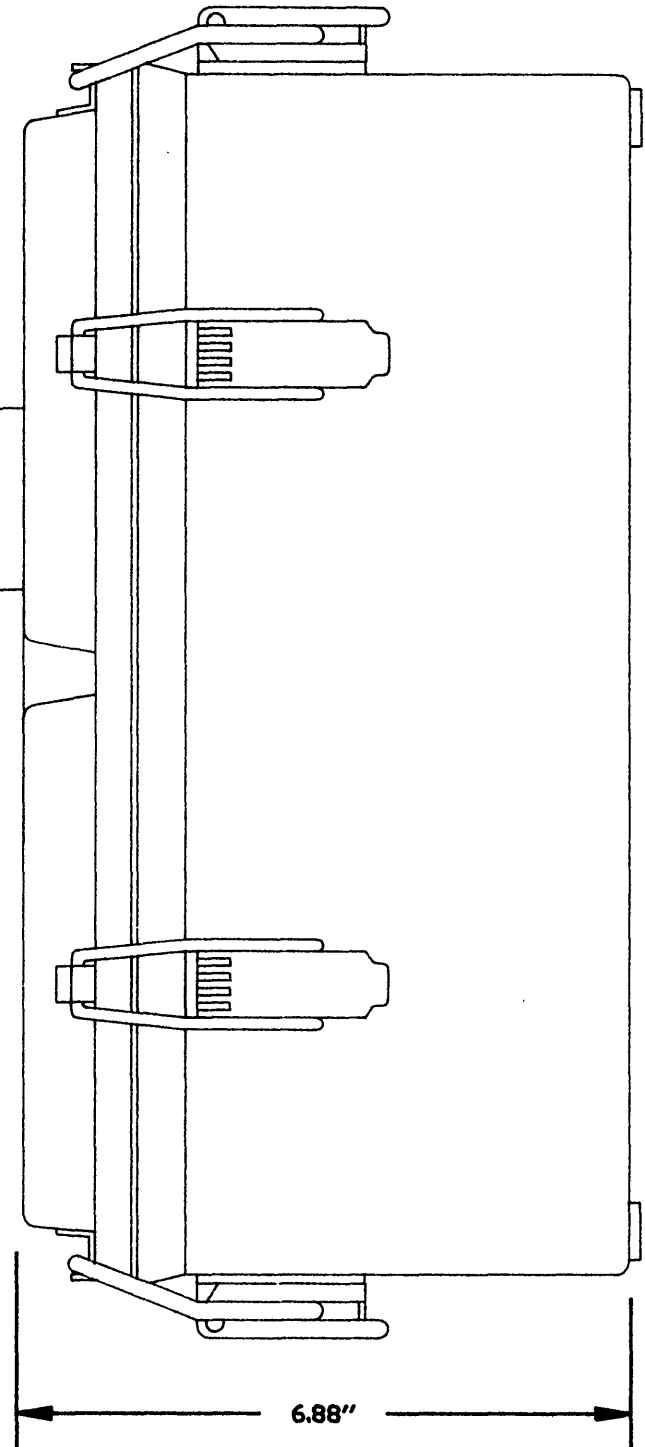

BACK PANEL LAYOUT
TAG: BACKPAN
SCALE: 1/2" = 1"

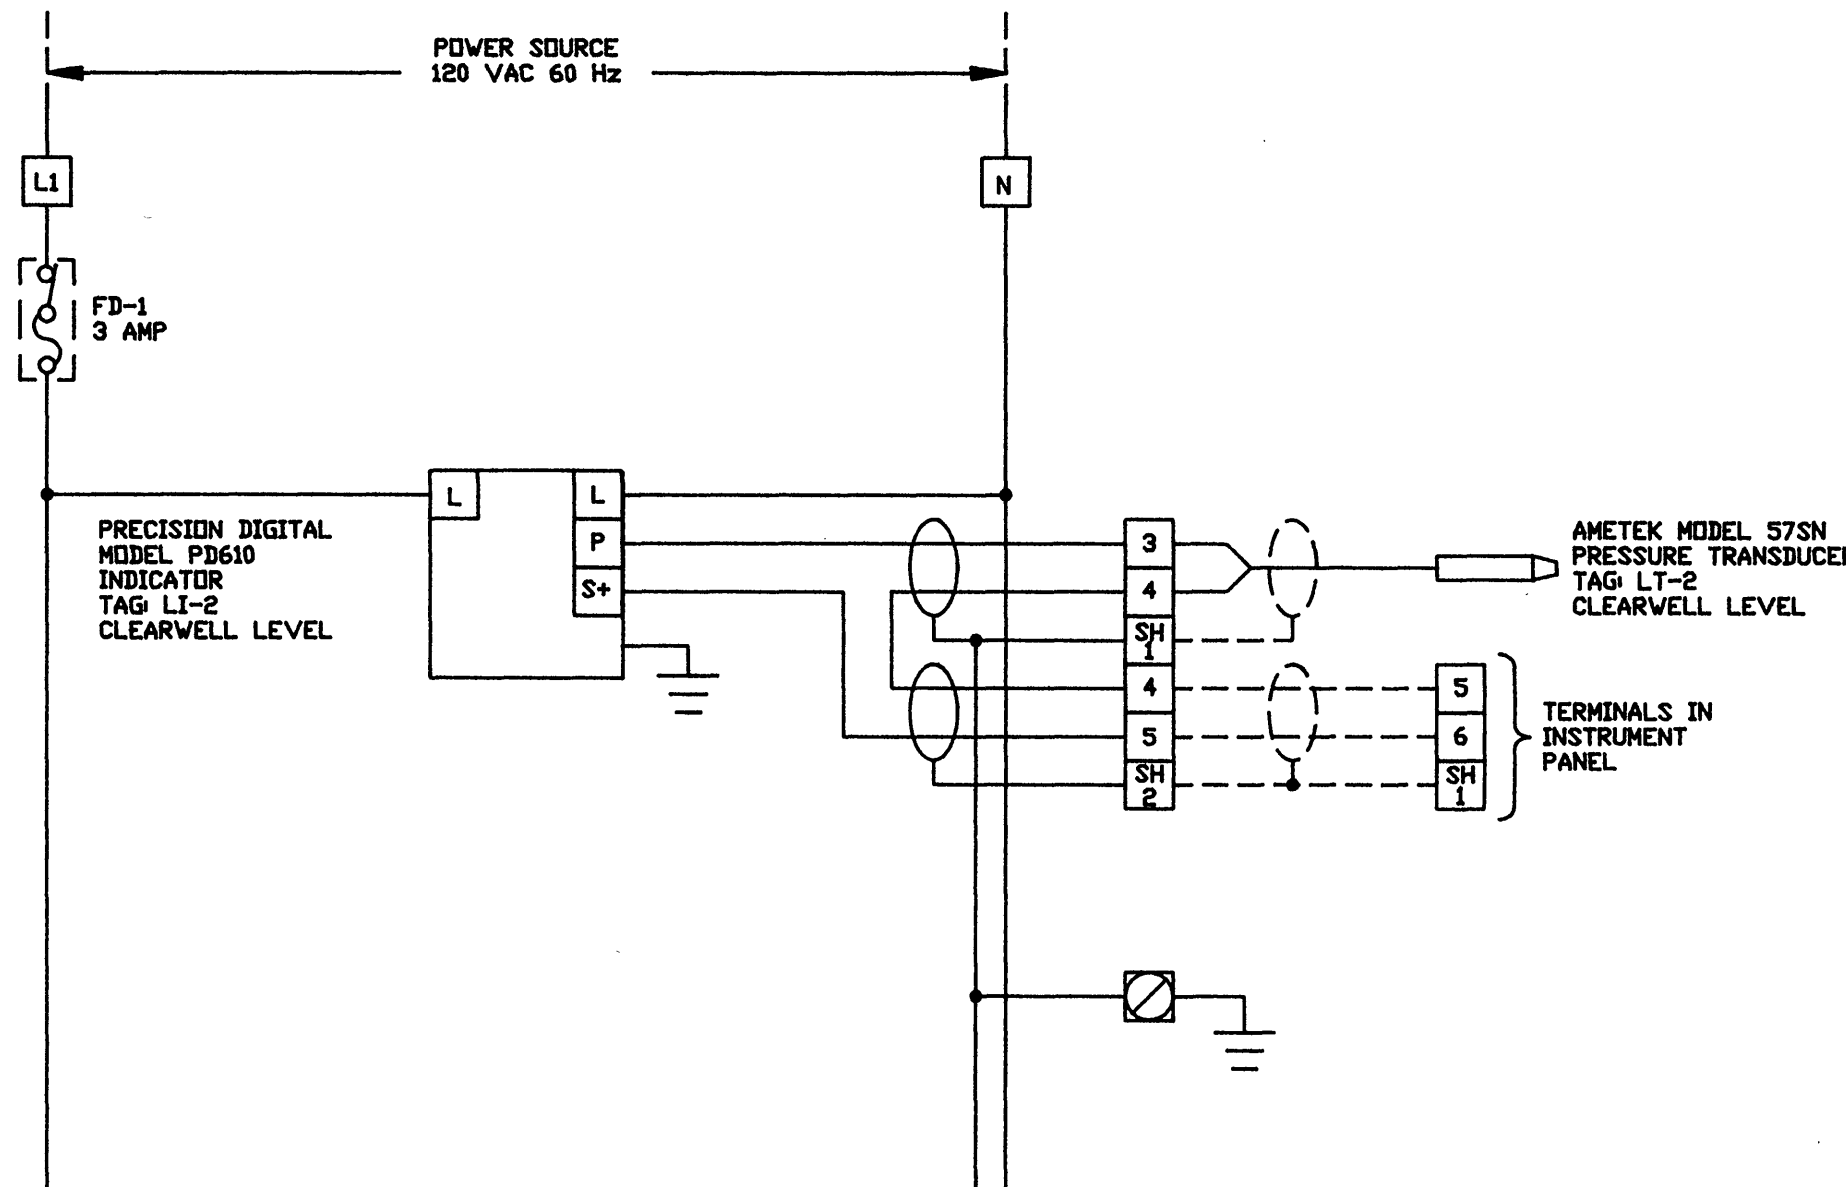

BILL OF MATERIAL

TAG	QTY	PART NO.	DESCRIPTION	MANUFACTURER
ENC-1	1	A-1287JFGOR	NEMA TYPE 4X FIBERGLASS ENCLOSURE	HOFFMAN
BACKPAN	1	A-10P8	BACK PANEL	HOFFMAN
LI-2	1	PD610-3	INDICATOR	PRECISION DIGITAL
FD-1	1	WS16	FUSED DISCONNECT	WEIDMULLER
TERMS	12	VDU 2.5	TERMINALS	WEIDMULLER
	1	FNM 3 AMP	FUSE	BUSS

TOLERANCES	REVISIONS			FALLING CREEK WATER PLANT		
	NO.	DATE	BY	FILTERED WATER WET WELL PANEL / CLEARWELL LEVEL PANEL		
DECIMAL	1					
FRACTIONAL	2					
ANGULAR	3			DRAWN BY SSS	SCALE AS SHOWN	MATERIAL
	4			CHK'D RWS	DATE 11/30/90	DRAWING NUMBER
	5			TRACED	APP'D	SLC376-06
	6					