


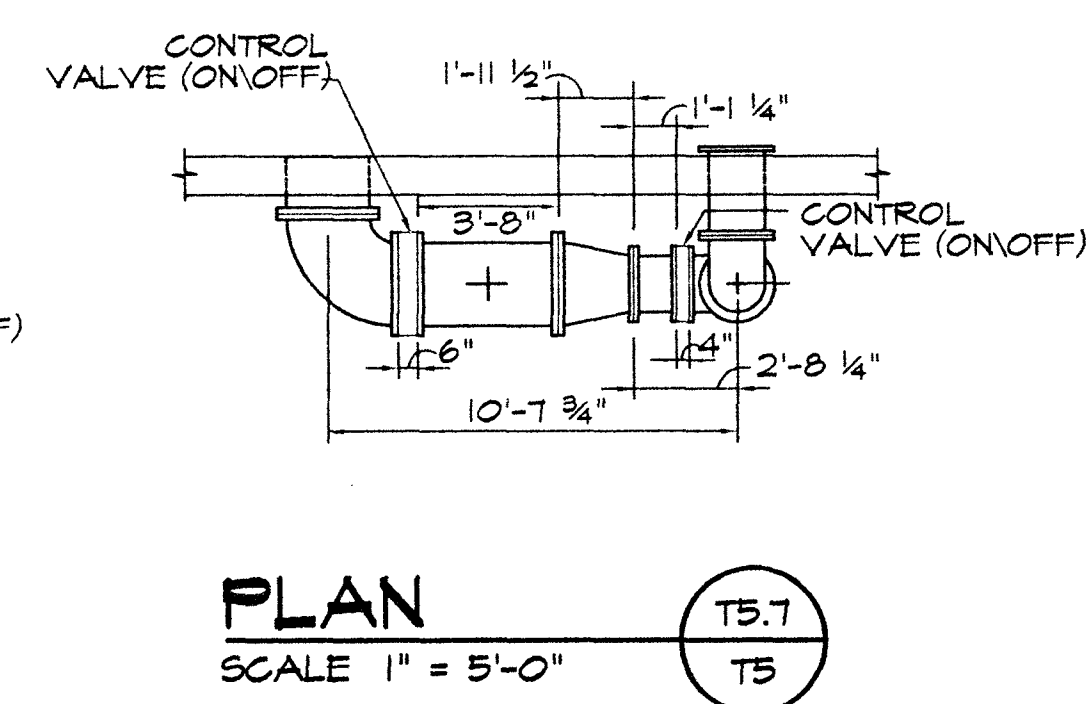
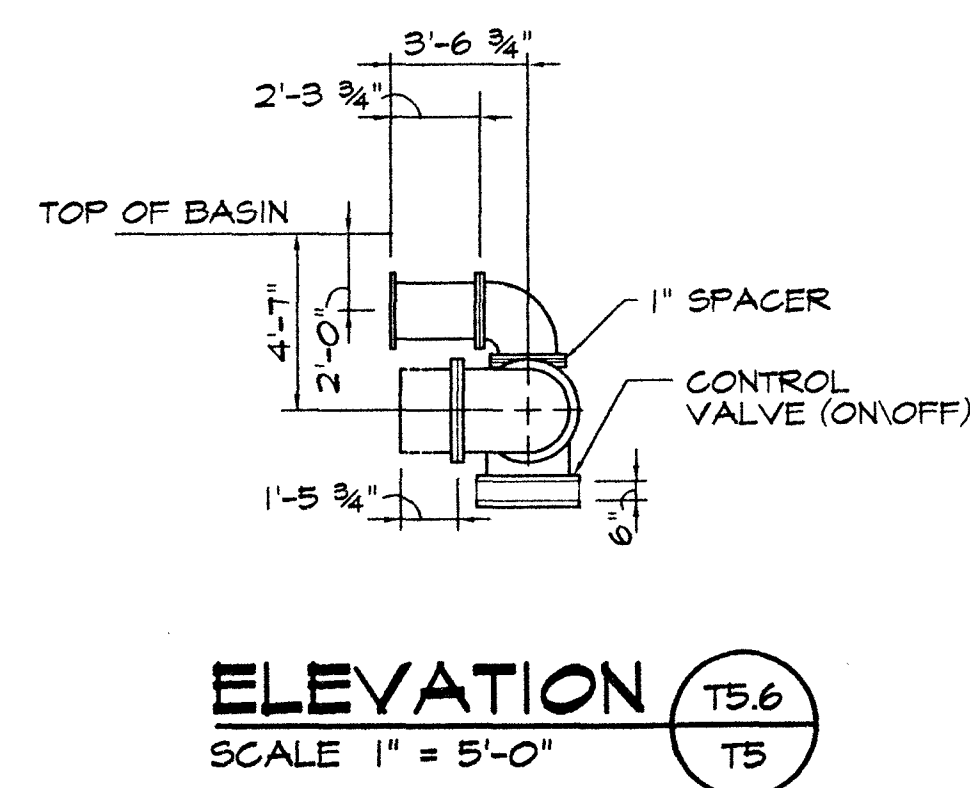
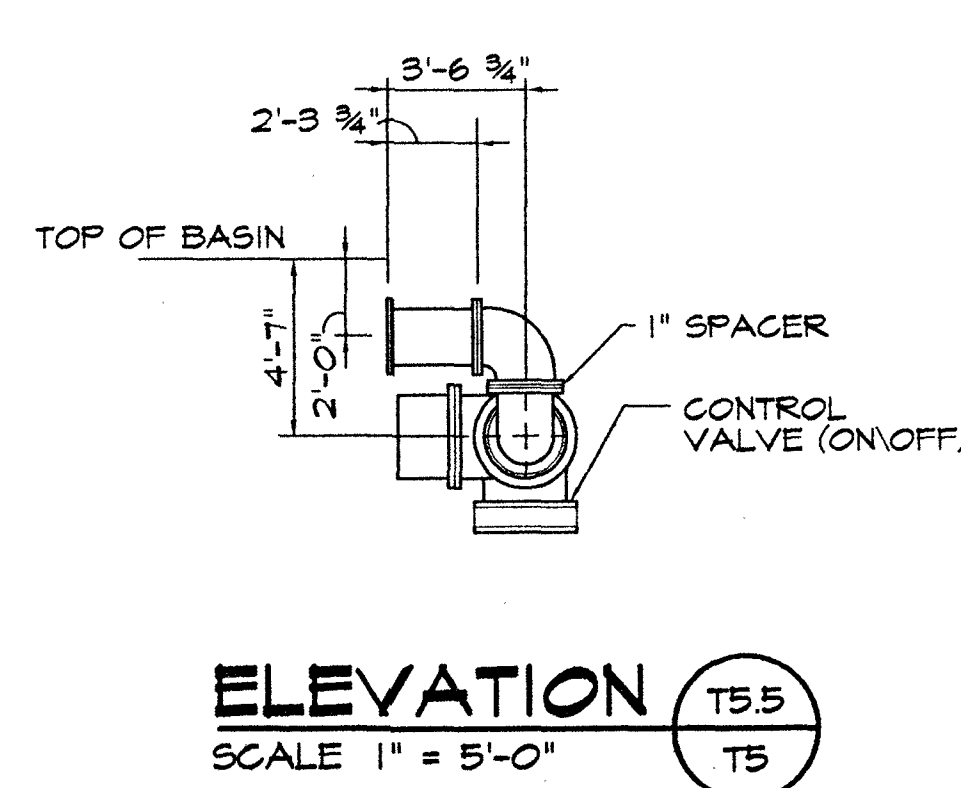
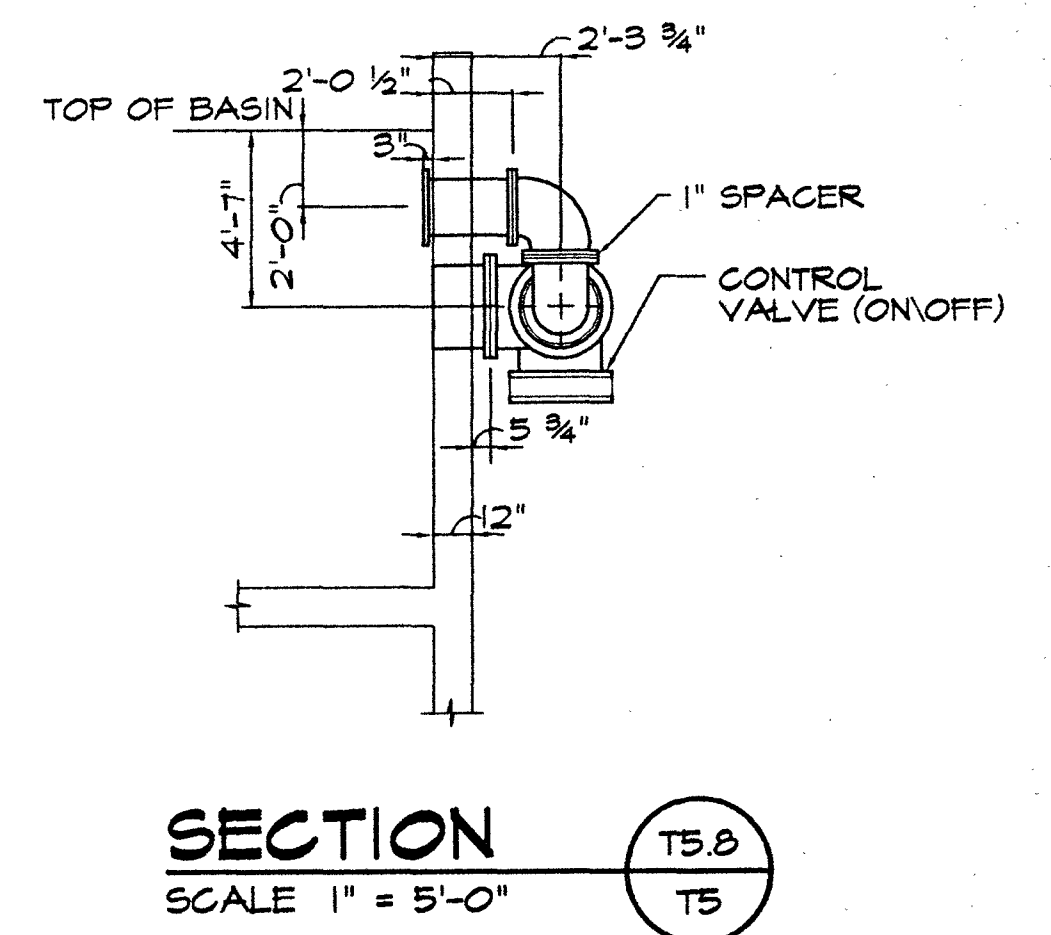
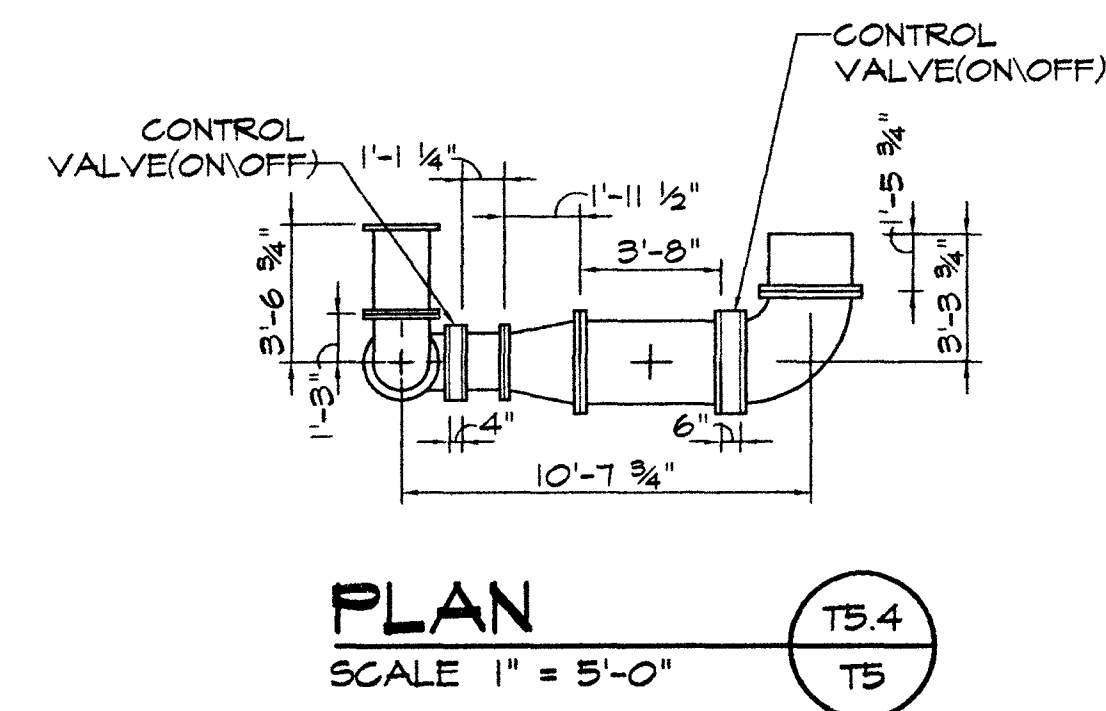
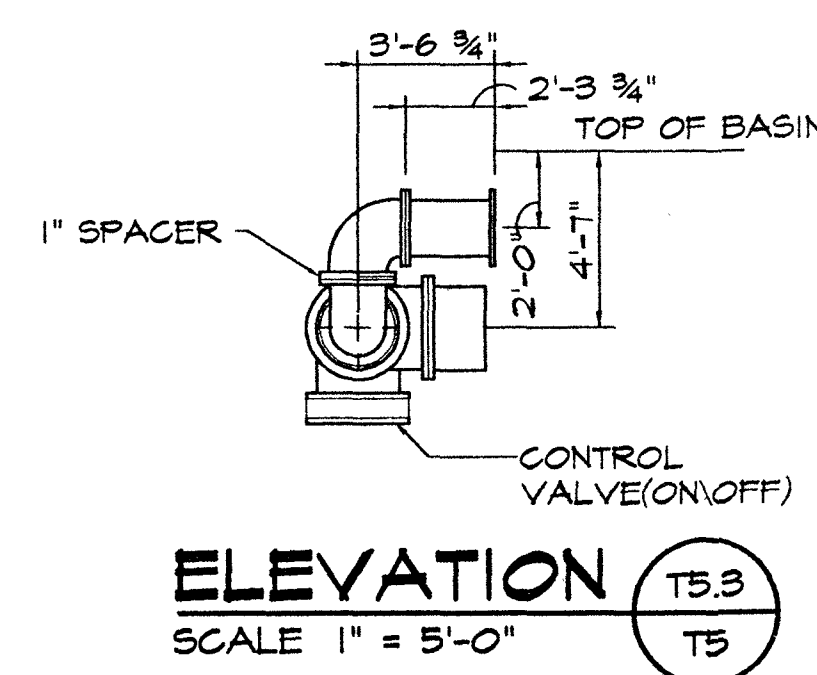
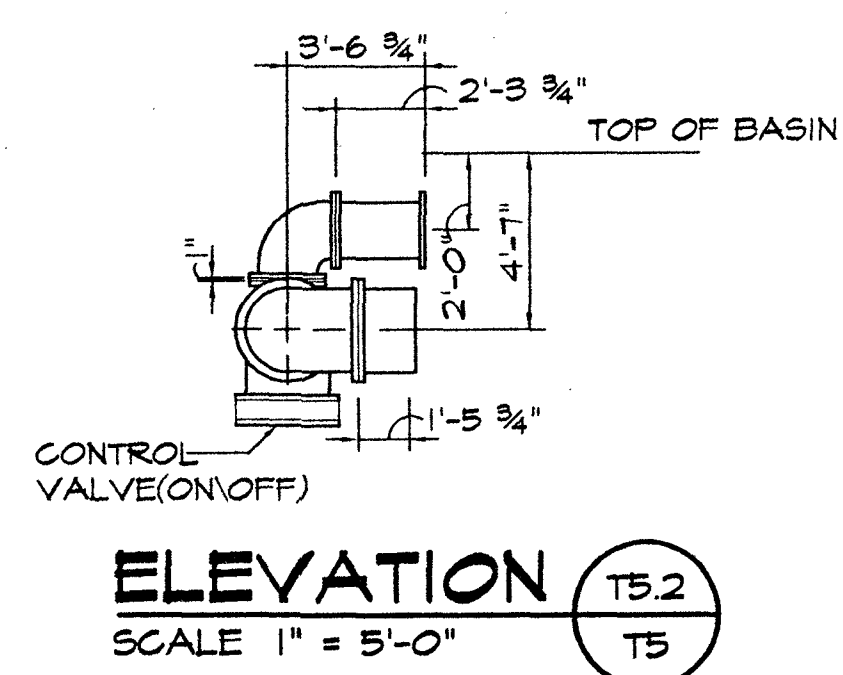
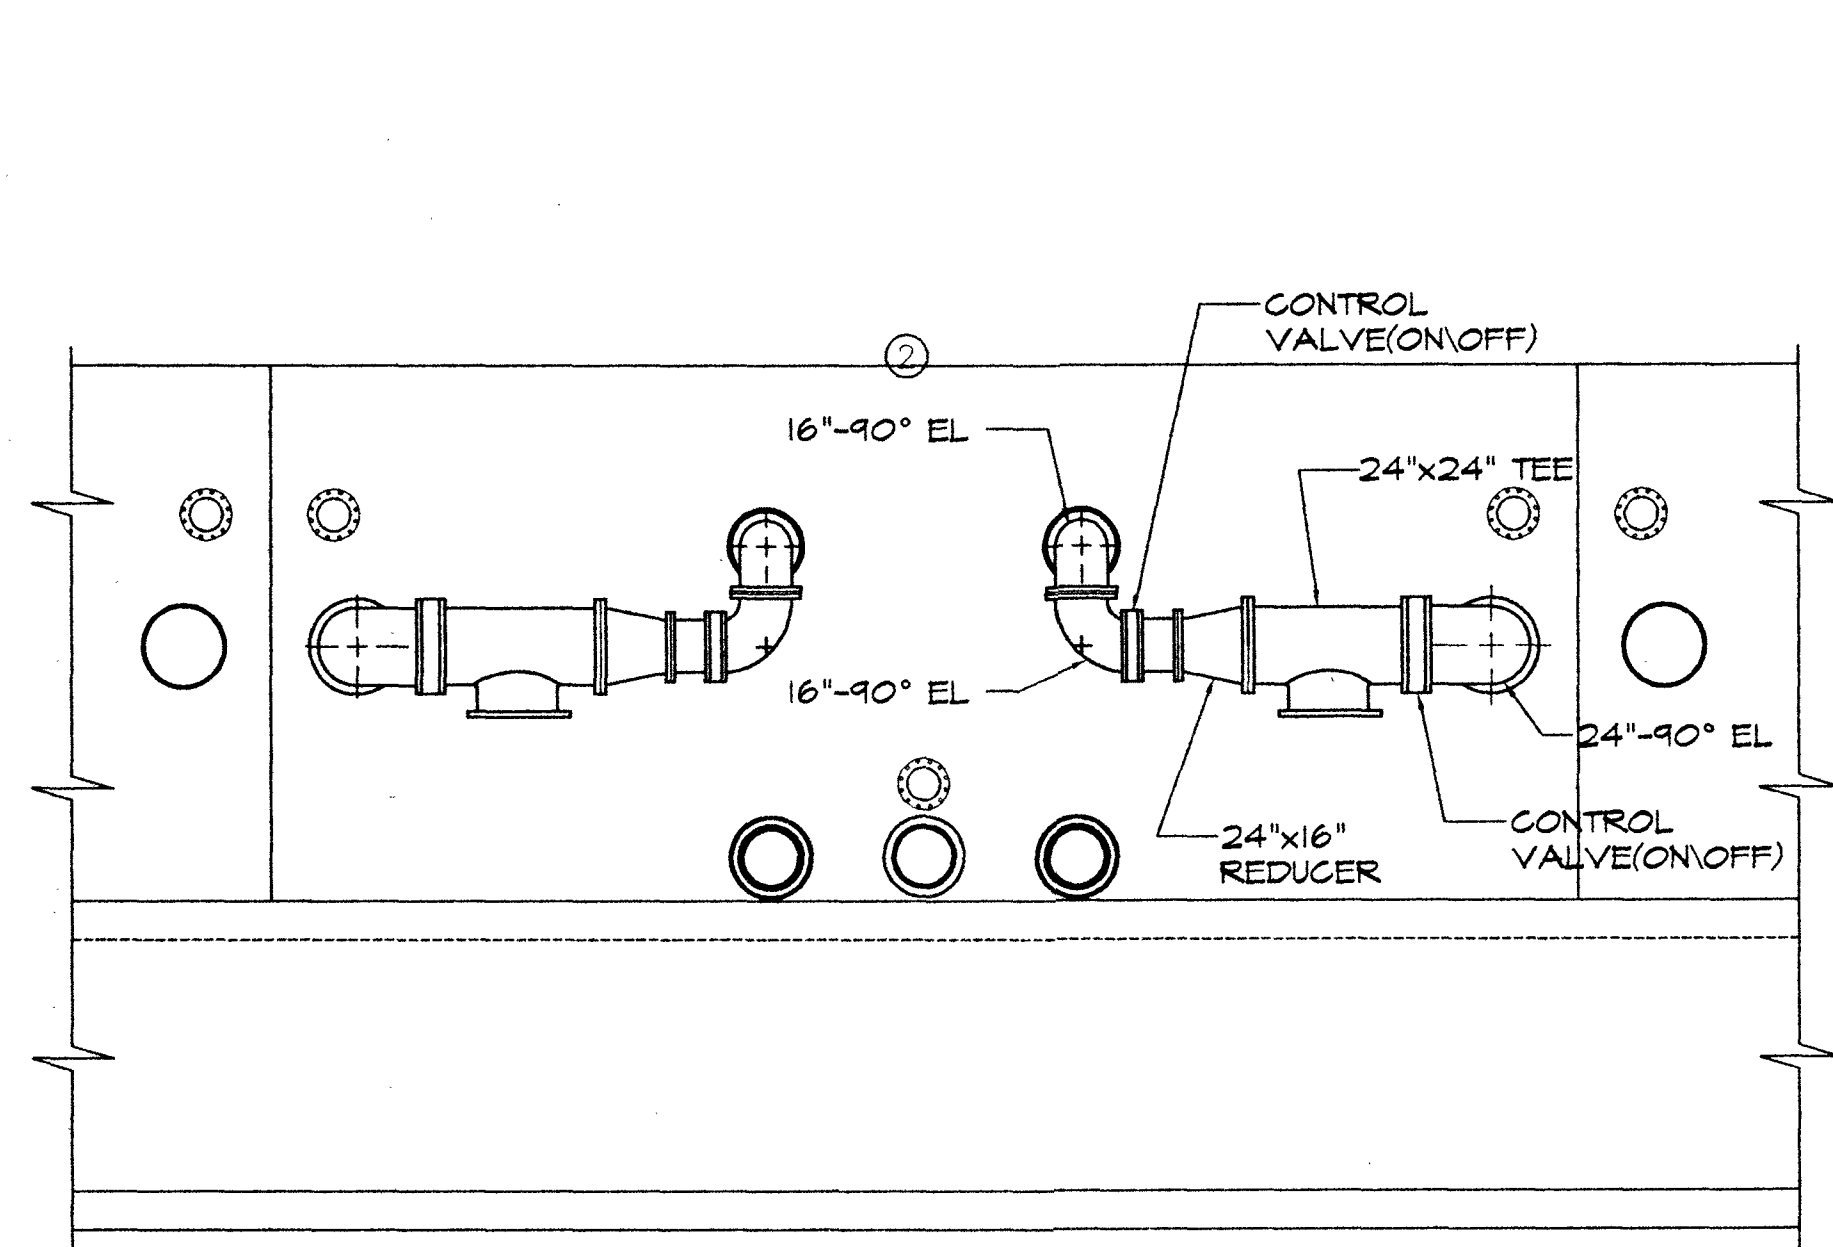


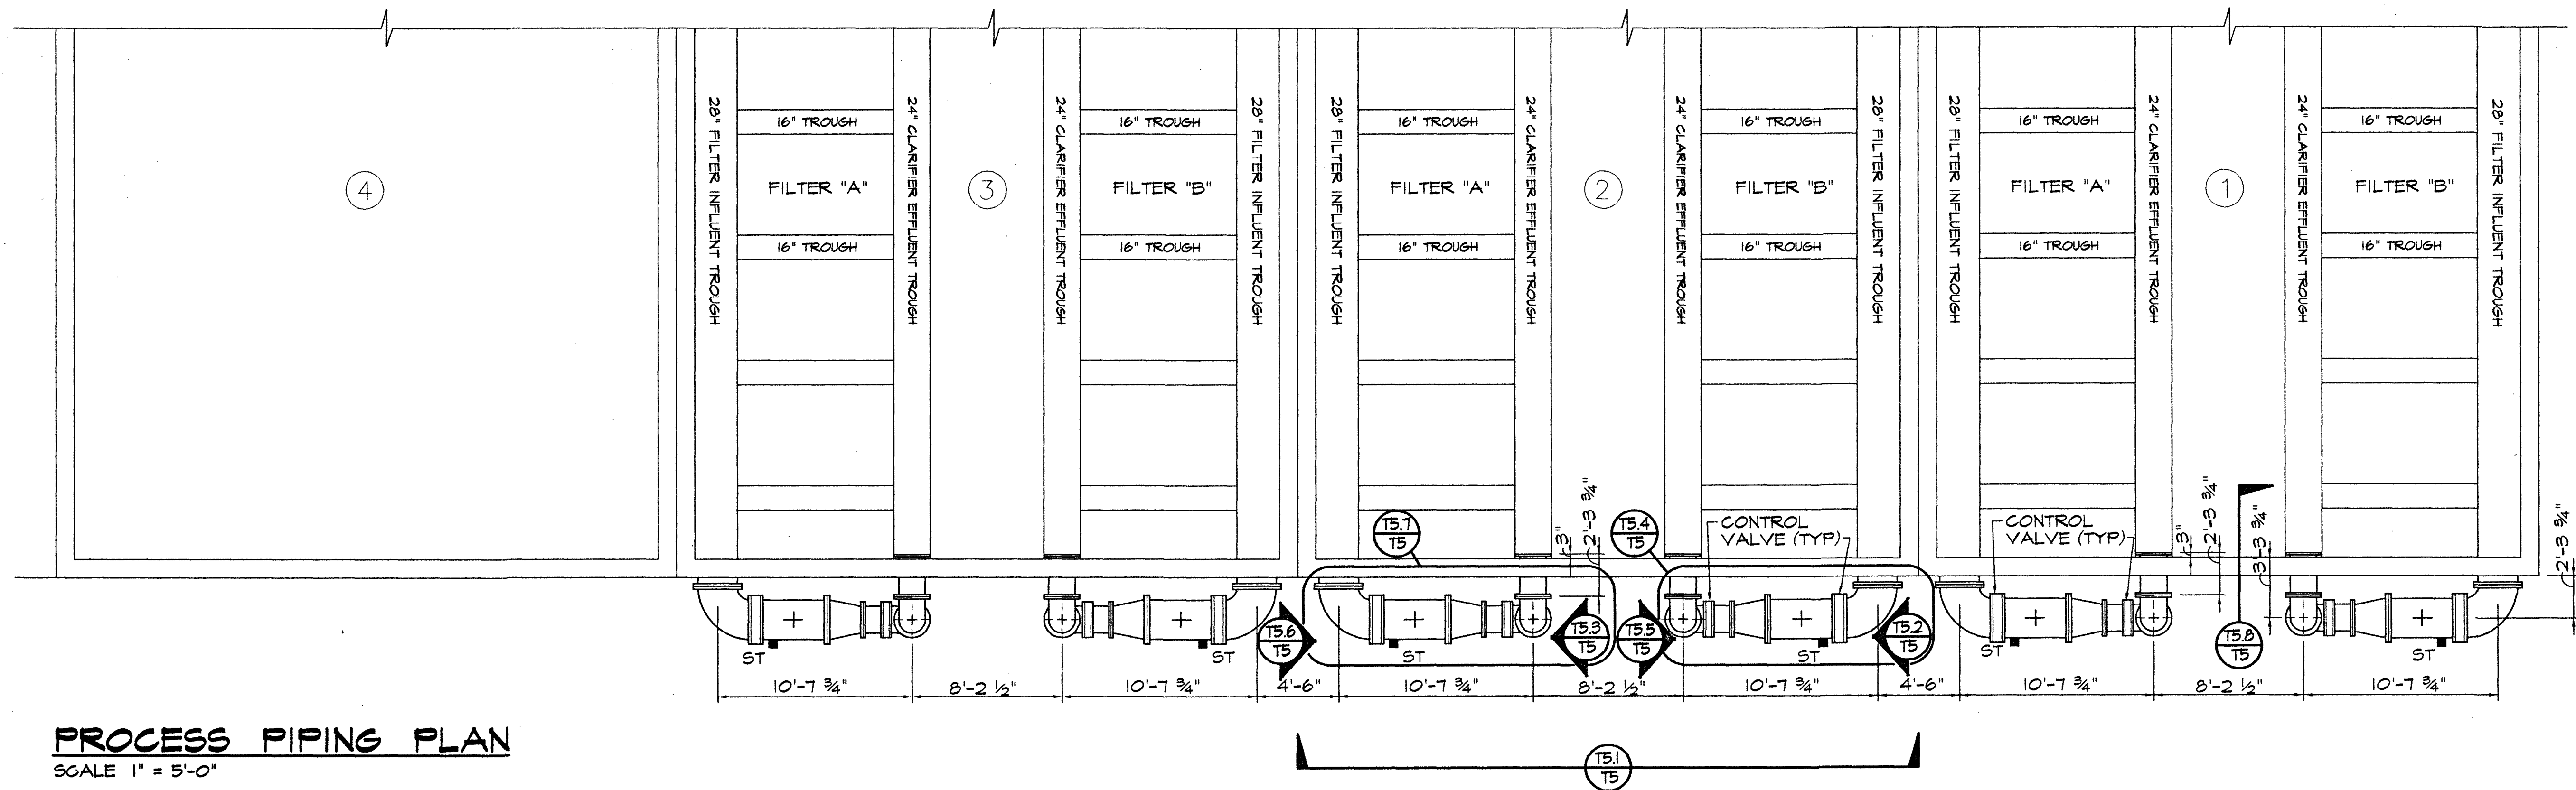

- NOTES**
- ALL PROCESS PIPING AND FITTINGS TO BE 304 STAINLESS STEEL RATED AT 125 PSI
 - ALL CONTROL VALVES TO BE SUPPLIED BY OTHERS
 - CONTROL VALVE (ON/OFF): MOTORIZED ON/OFF BUTTERFLY VALVE WITH HAND OPERATOR

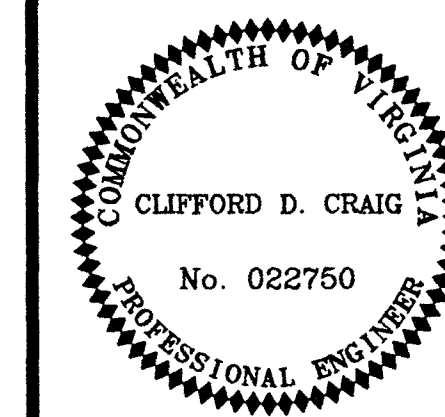

ROANOKE COUNTY WATER TREATMENT FACILITY

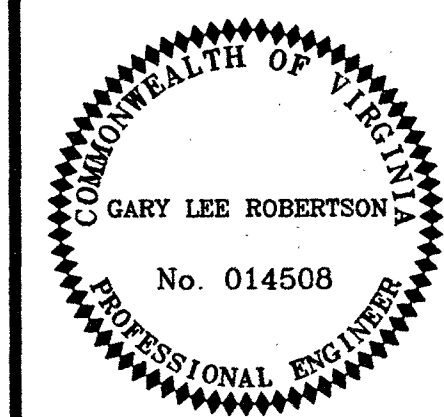

PROCESS PIPING DIAGRAMS	
DESIGN ENGINEER CLIFFORD D. CRAIG	COMMISSION NUMBER 1913
RCUD NUMBER WTF-1	DATE 9 SEPT. 1994

T5