


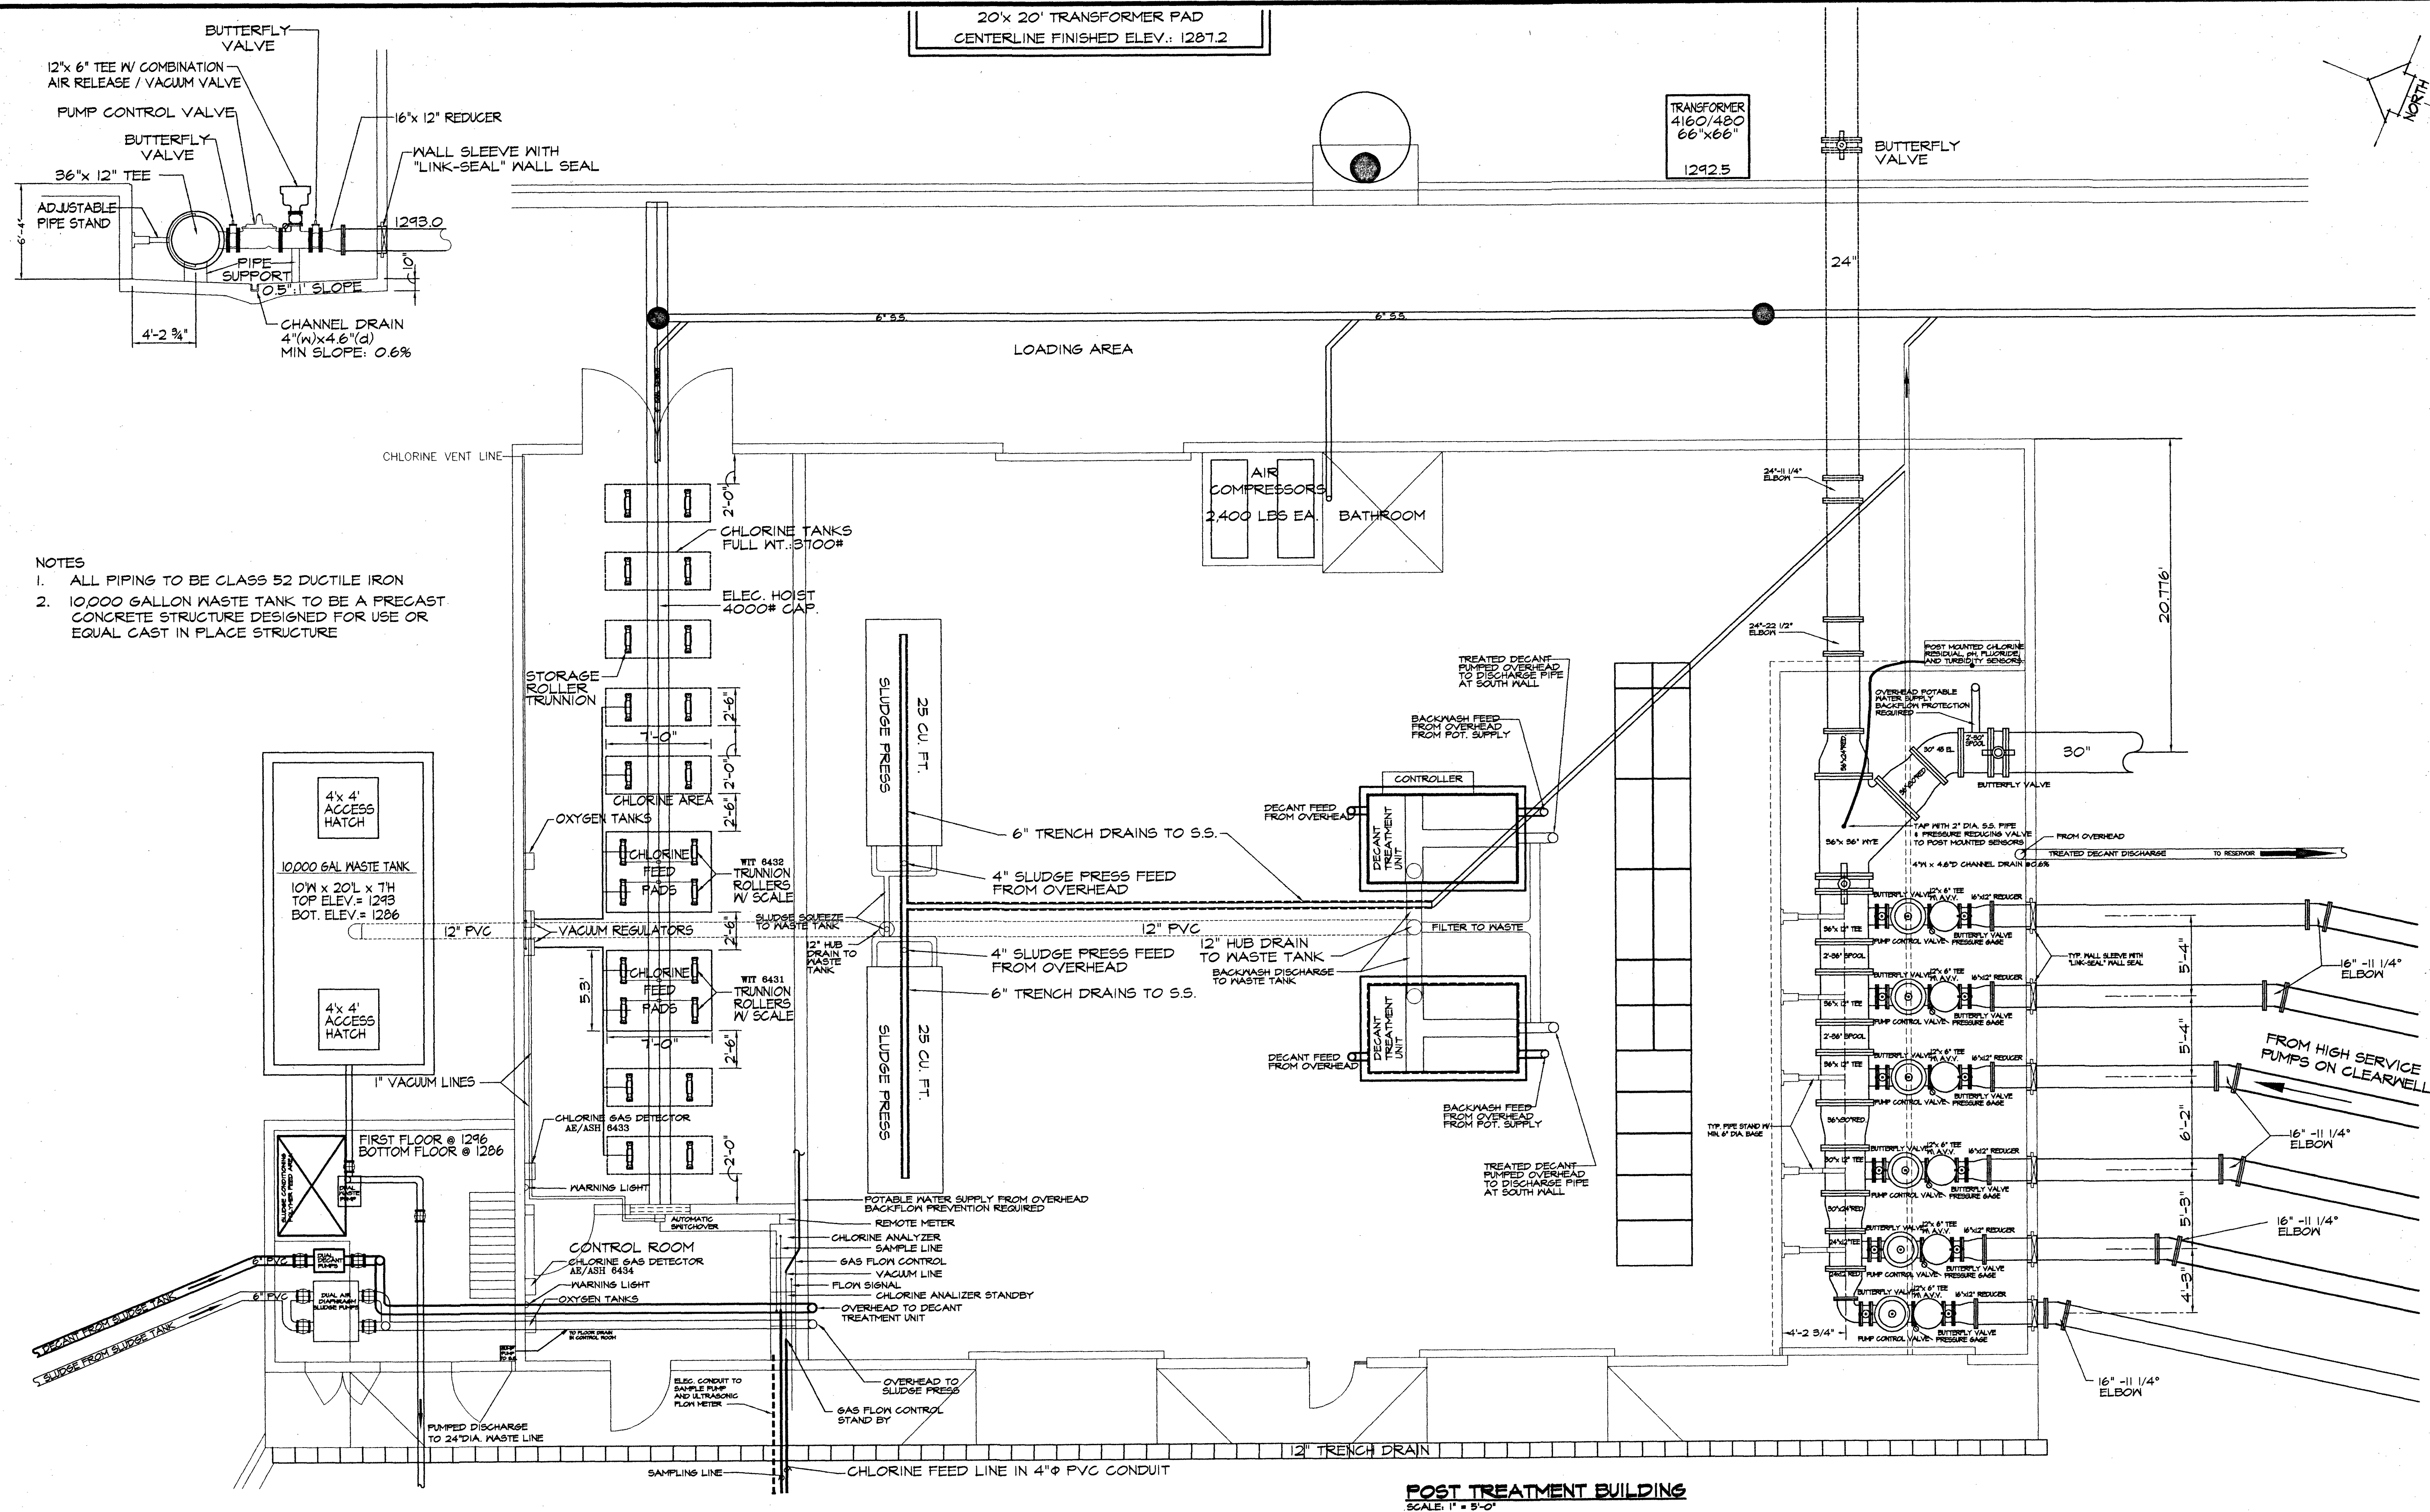


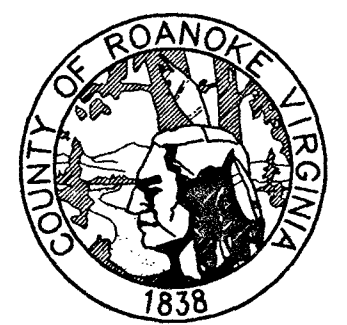

- NOTES
1. ALL PIPING TO BE CLASS 52 DUCTILE IRON
 2. 10,000 GALLON WASTE TANK TO BE A PRECAST CONCRETE STRUCTURE DESIGNED FOR USE OR EQUAL CAST IN PLACE STRUCTURE

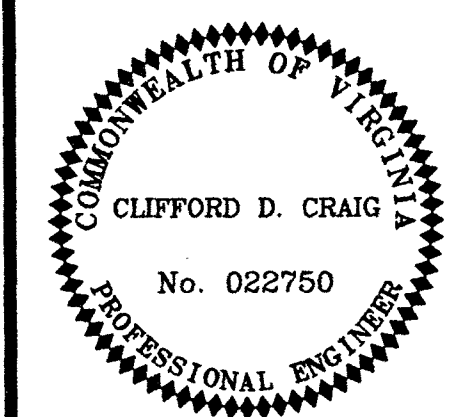

ROANOKE COUNTY WATER TREATMENT FACILITY

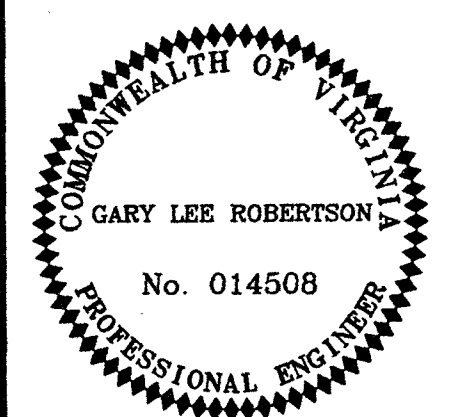

POST TREATMENT BUILDING TREATMENT SYSTEM PLAN

DESIGN ENGINEER CLIFFORD D. CRAIG	COMMISSION NUMBER 1913
RCUD NUMBER WTF-1	DATE 12 SEPT. 1994

T11