




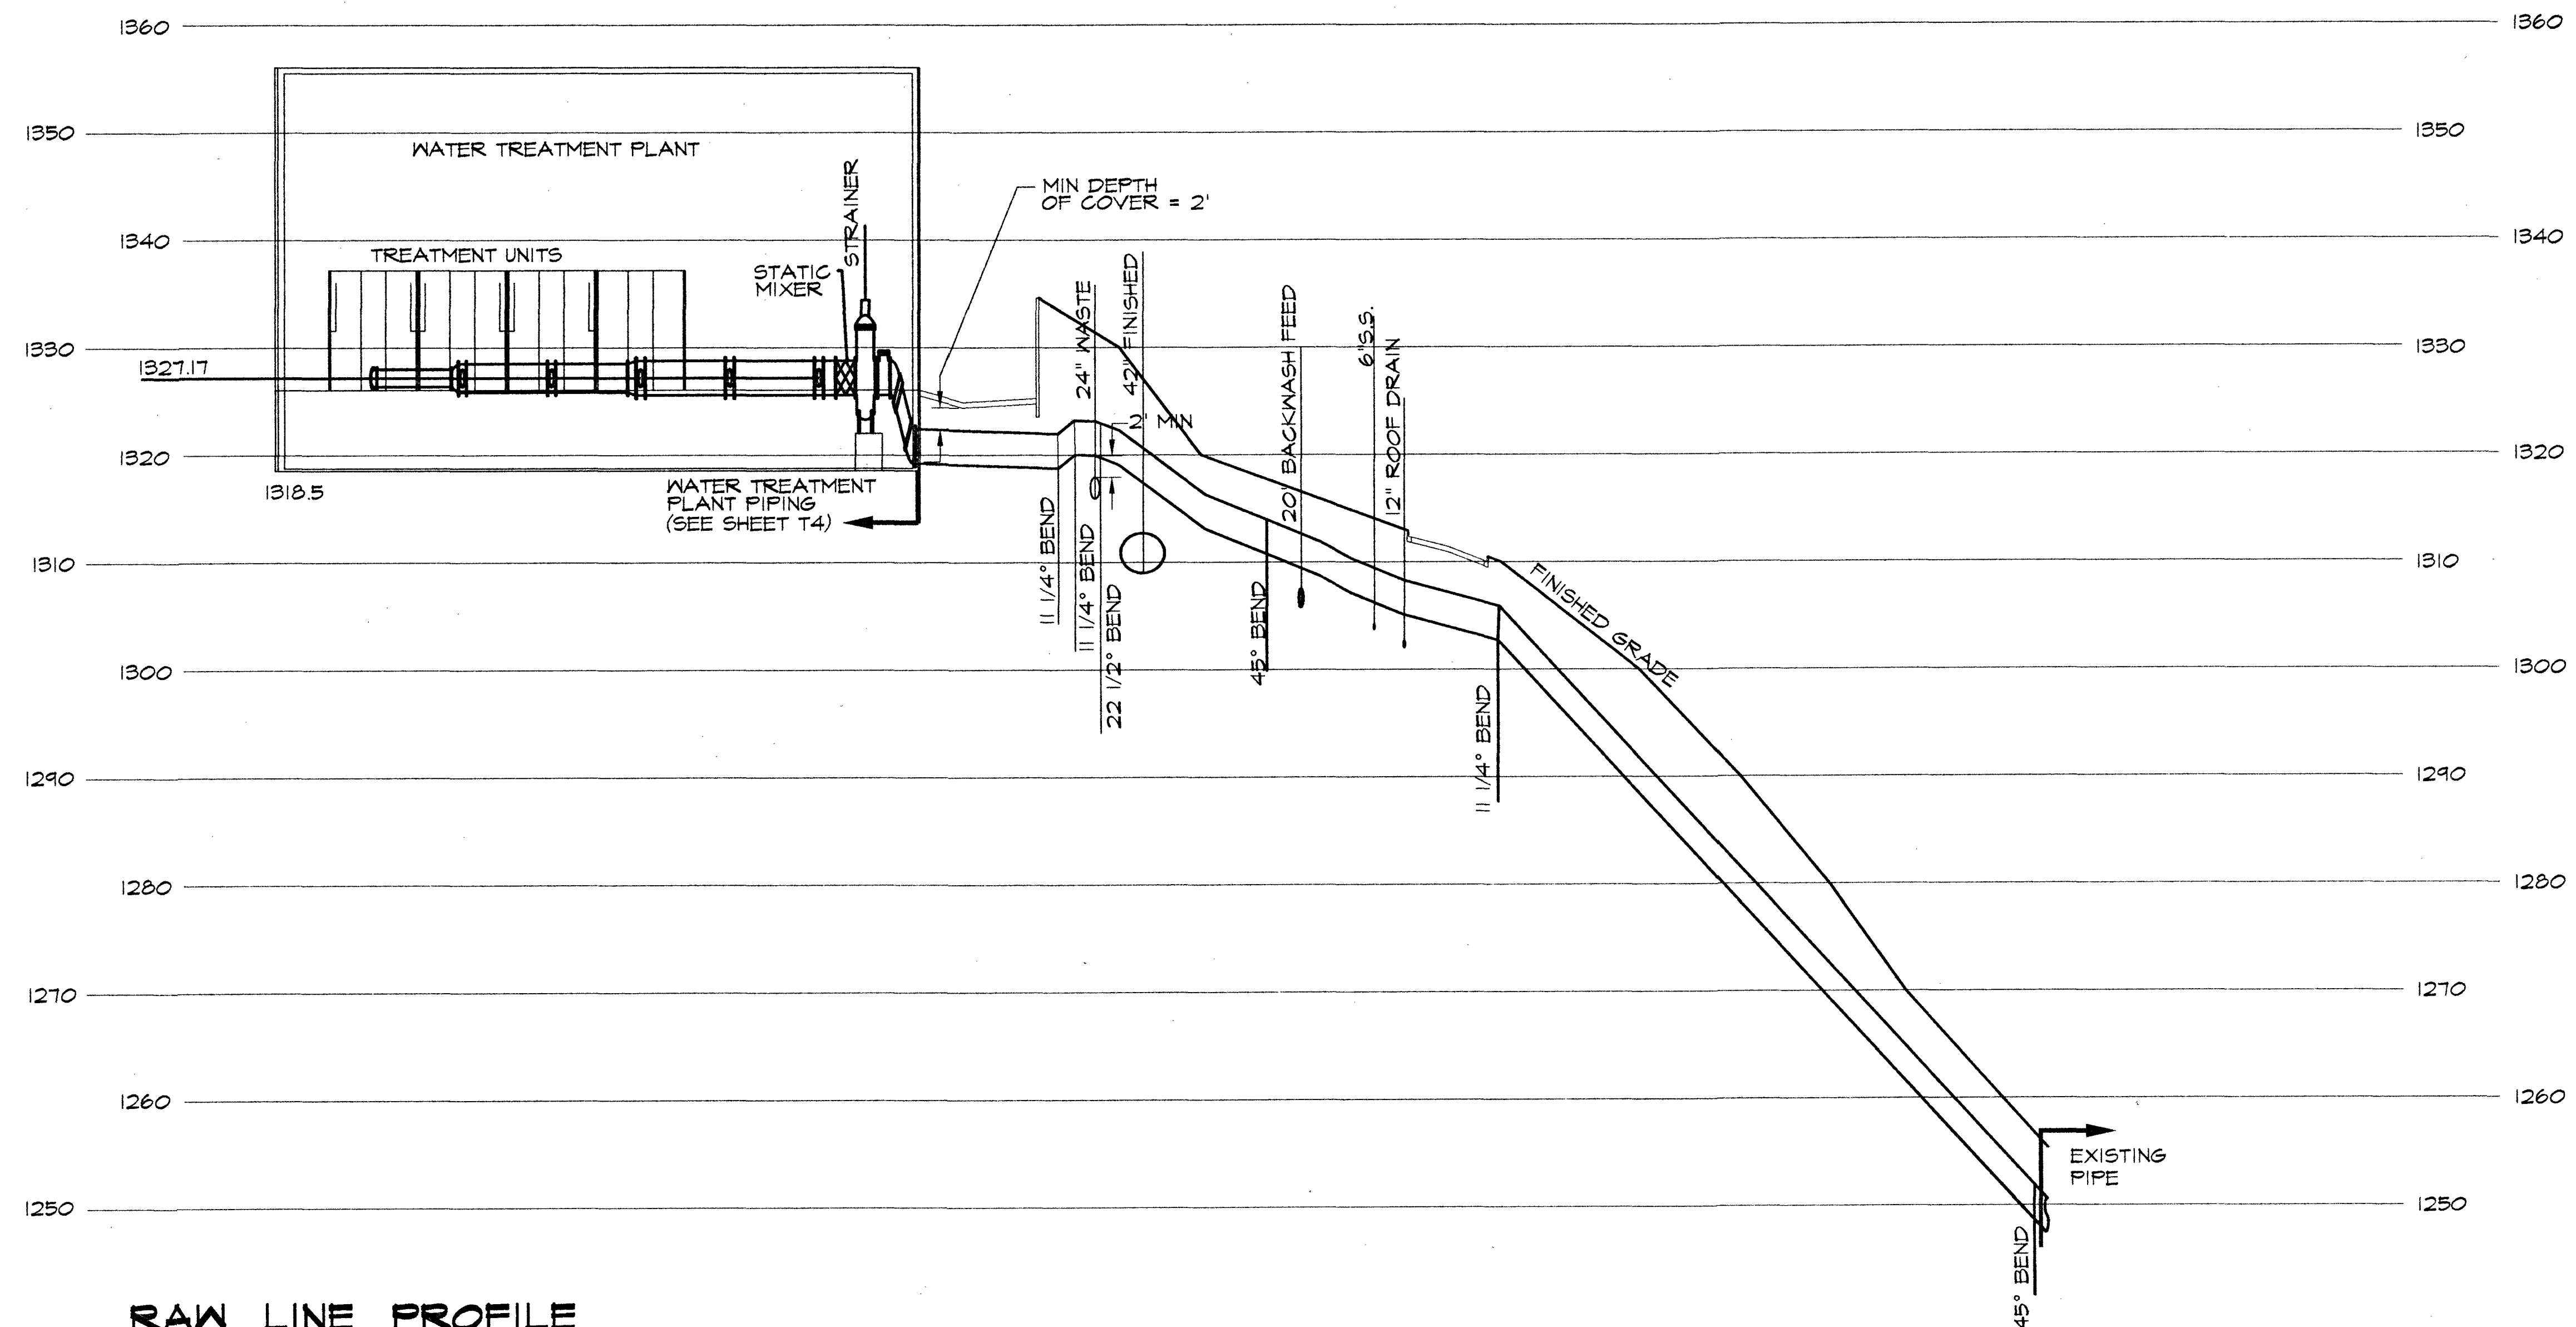


RAW LINE PROFILE
SCALE VERT 1" = 10'-0"
HORIZ 1" = 40'-0"

NOTE
1. ALL RAW PIPING AND FITTINGS TO BE CLASS 52 DUCTILE IRON EXCEPT FOR WATER TREATMENT PLANT PIPING

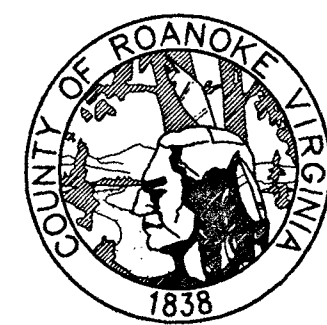

ROANOKE COUNTY WATER TREATMENT FACILITY

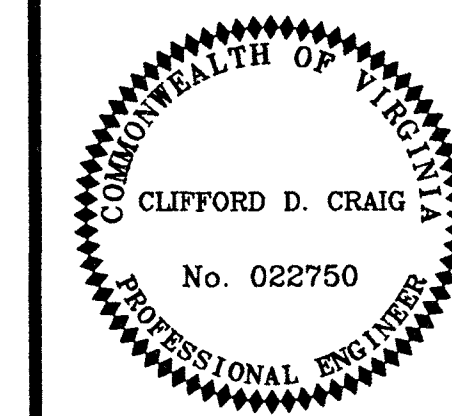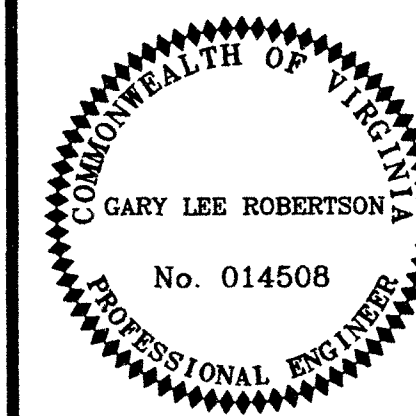

RAW WATER LINE PROFILE			
DESIGN ENGINEER CLIFFORD D. CRAIG	COMMISSION NUMBER 1913		
RCUD NUMBER WTF-1	DATE 12 SEPT. 1994		

T12