




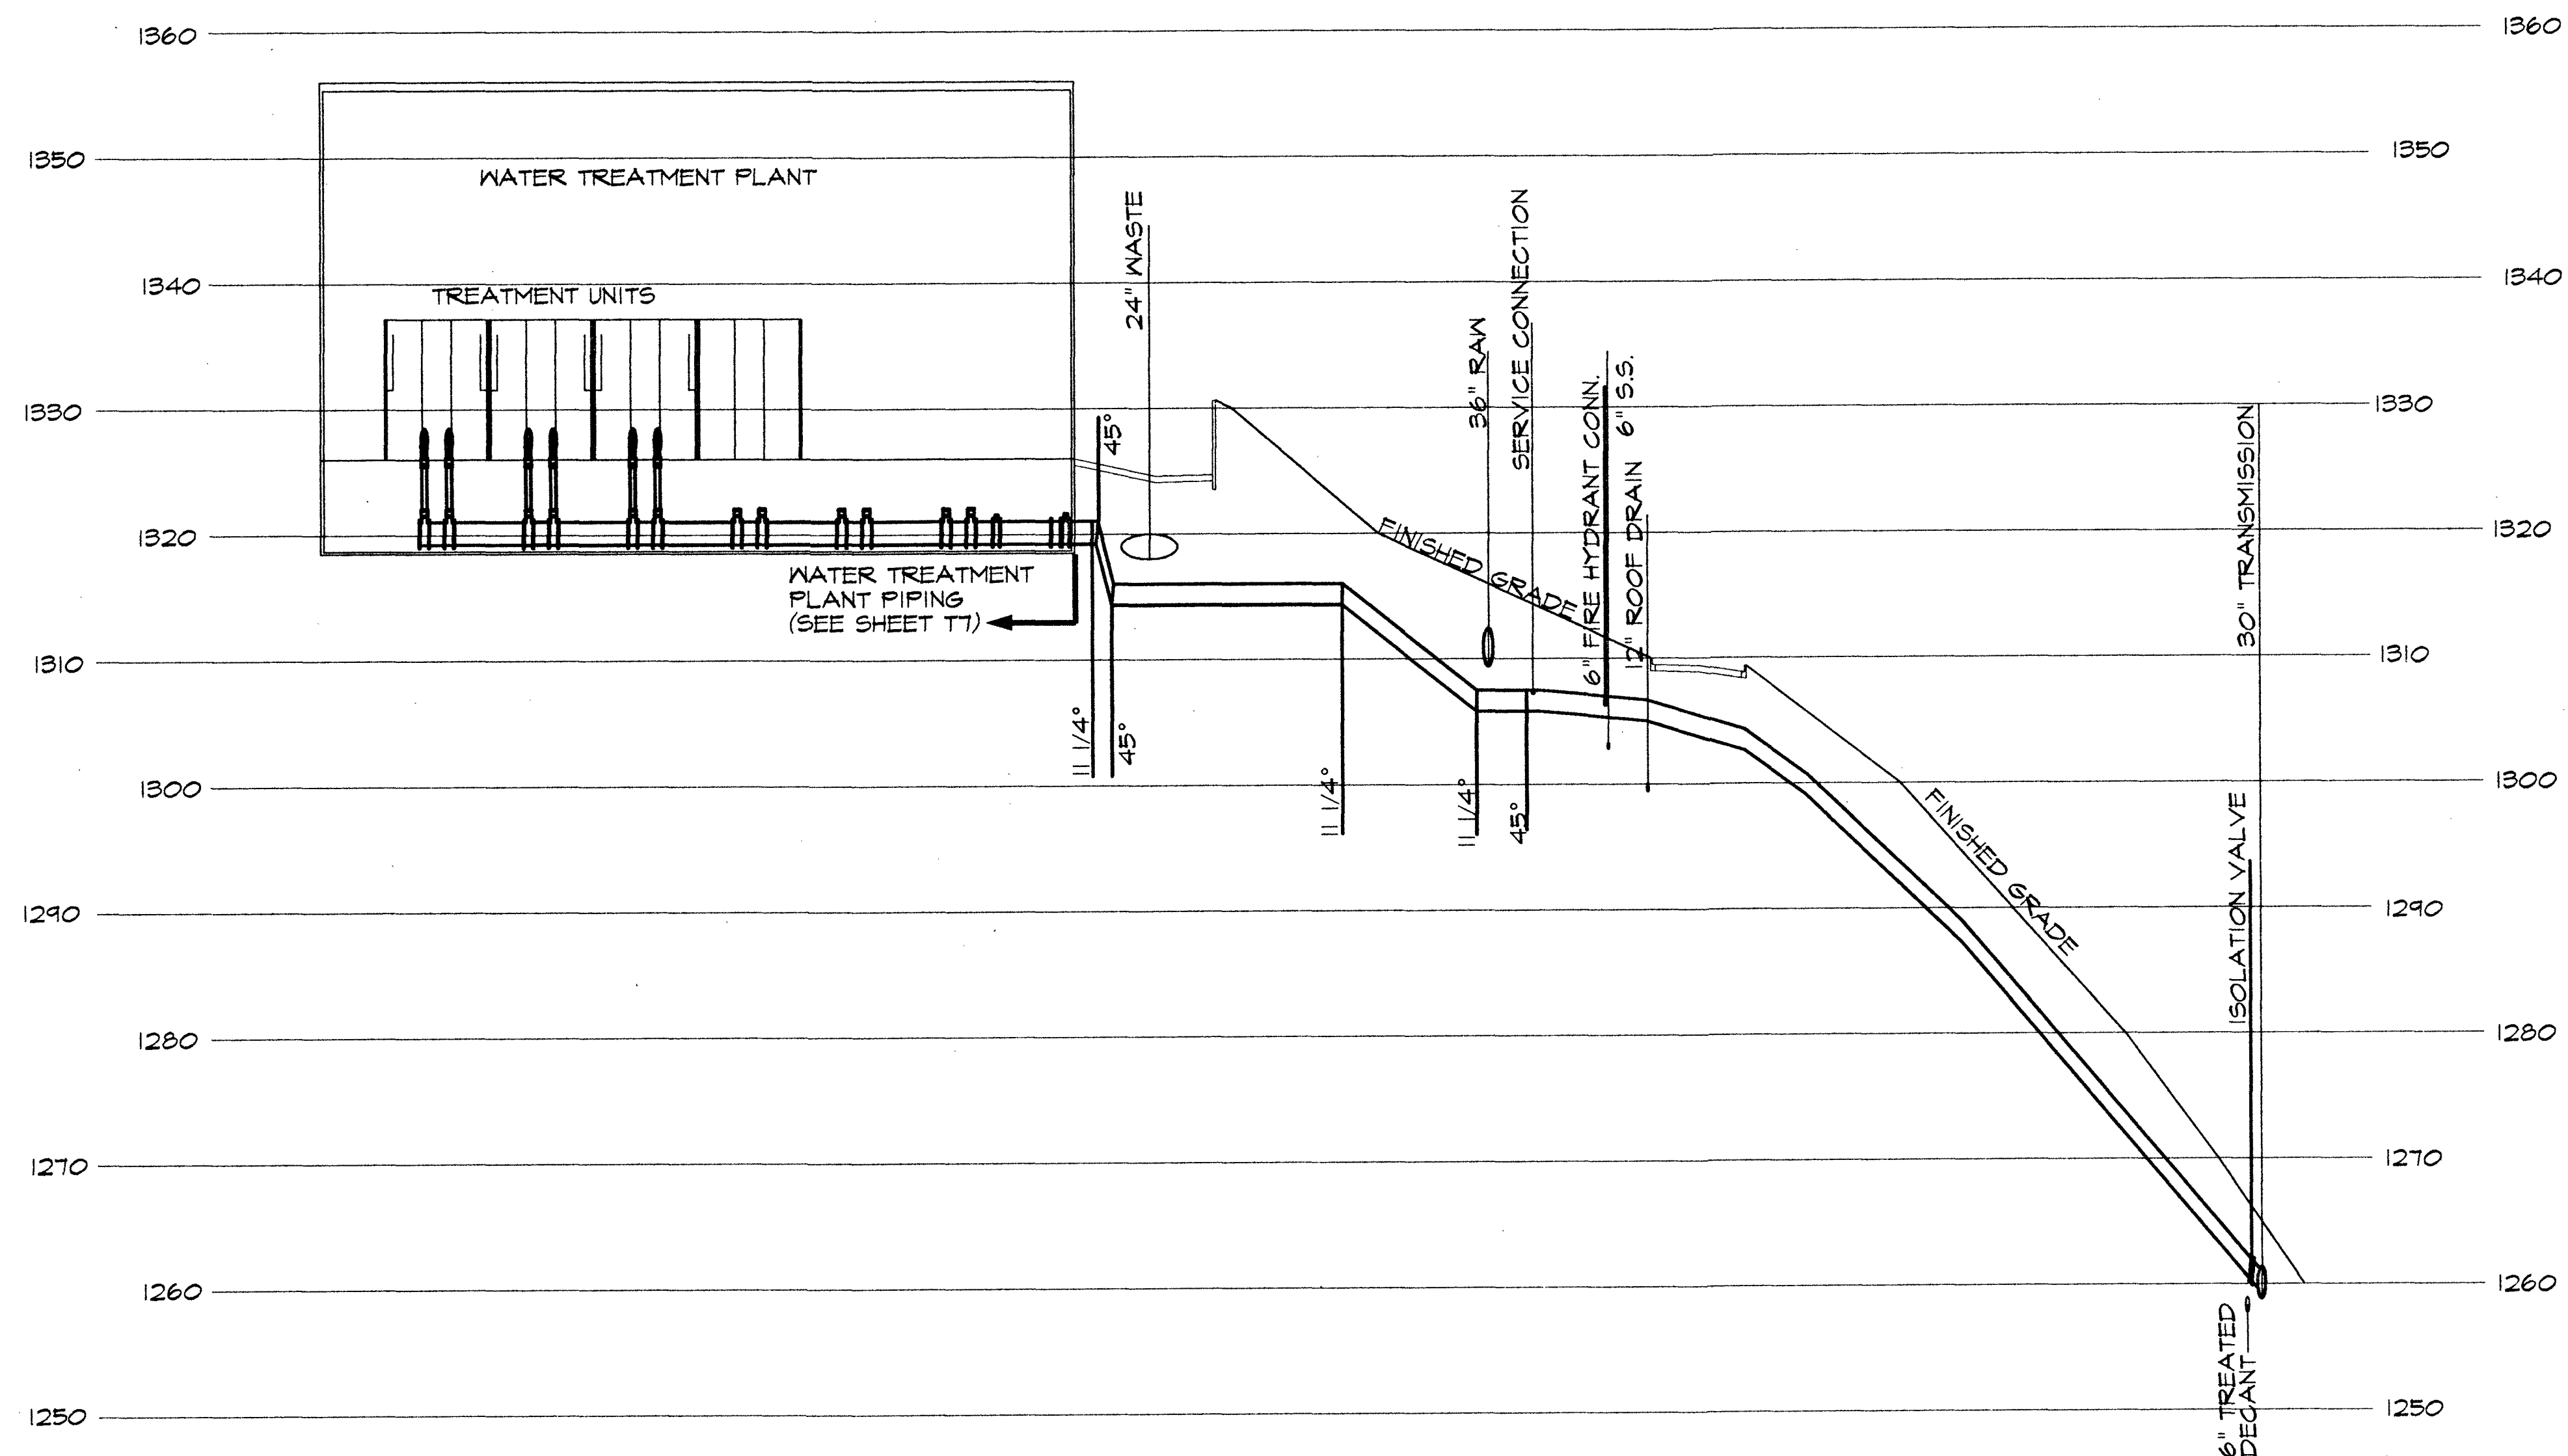


BACKWASH FEED LINE PROFILE
 SCALE VERT 1" = 10'-0"
 HORIZ 1" = 40'-0"

NOTE
 1. ALL BACKWASH FEED PIPING AND FITTINGS TO BE CLASS 52 DUCTILE IRON EXCEPT FOR WATER TREATMENT PLANT PIPING

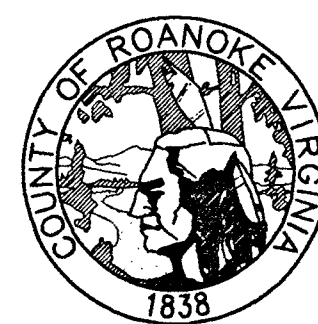

ROANOKE COUNTY WATER TREATMENT FACILITY

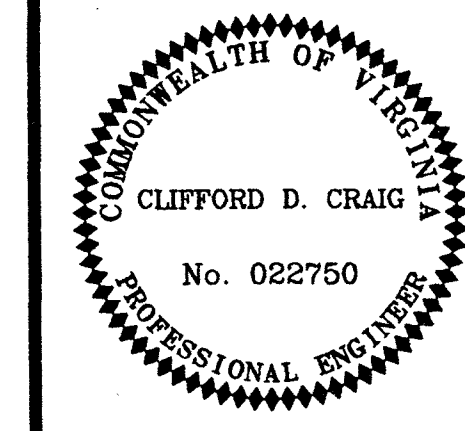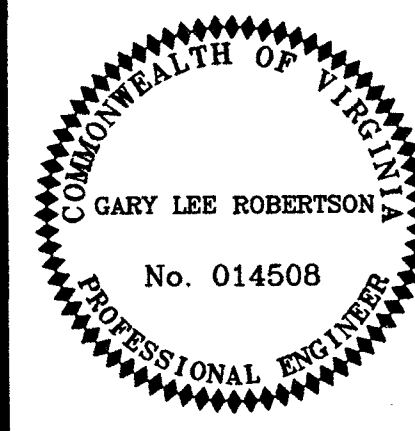

BACKWASH FEED LINE PROFILE	
DESIGN ENGINEER CLIFFORD D. CRAIG	COMMISSION NUMBER 1913
RCUD NUMBER WTF-1	DATE 12 SEPT. 1994

T14