




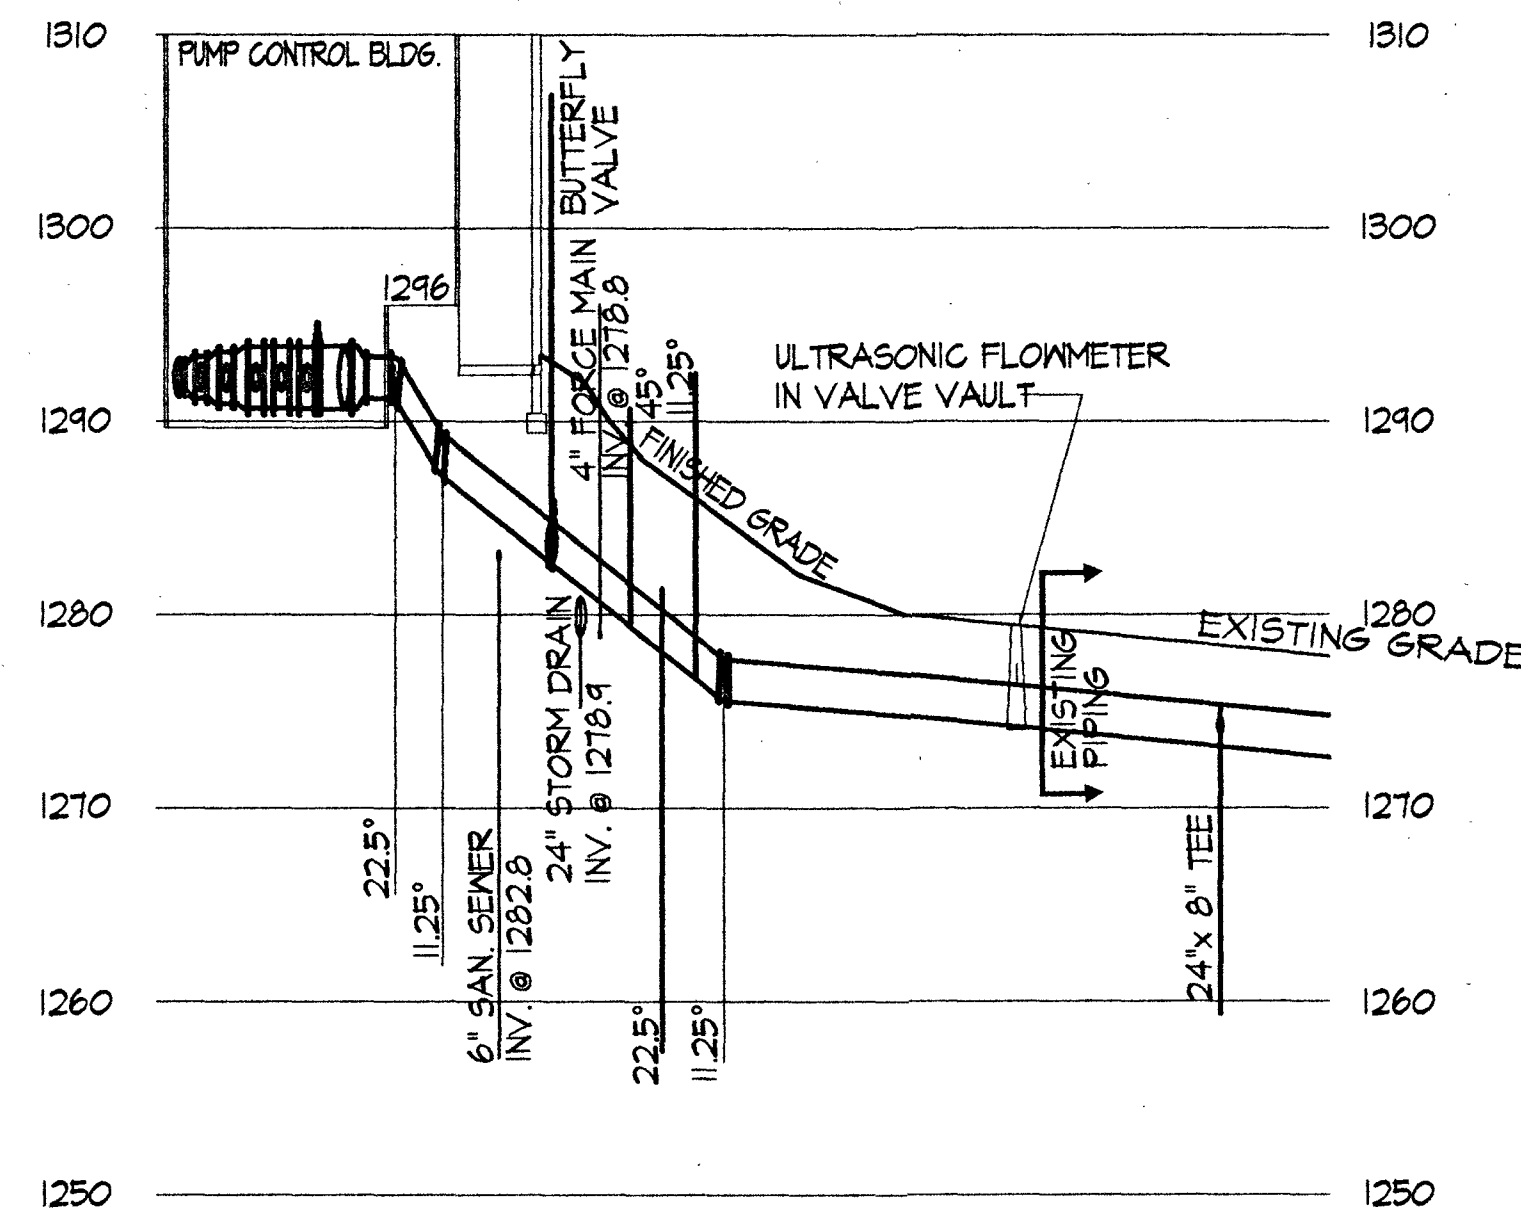


24" TRANSMISSION LINE PROFILE
 SCALE VERT 1" = 10'-0"
 HORIZ 1" = 40'-0"

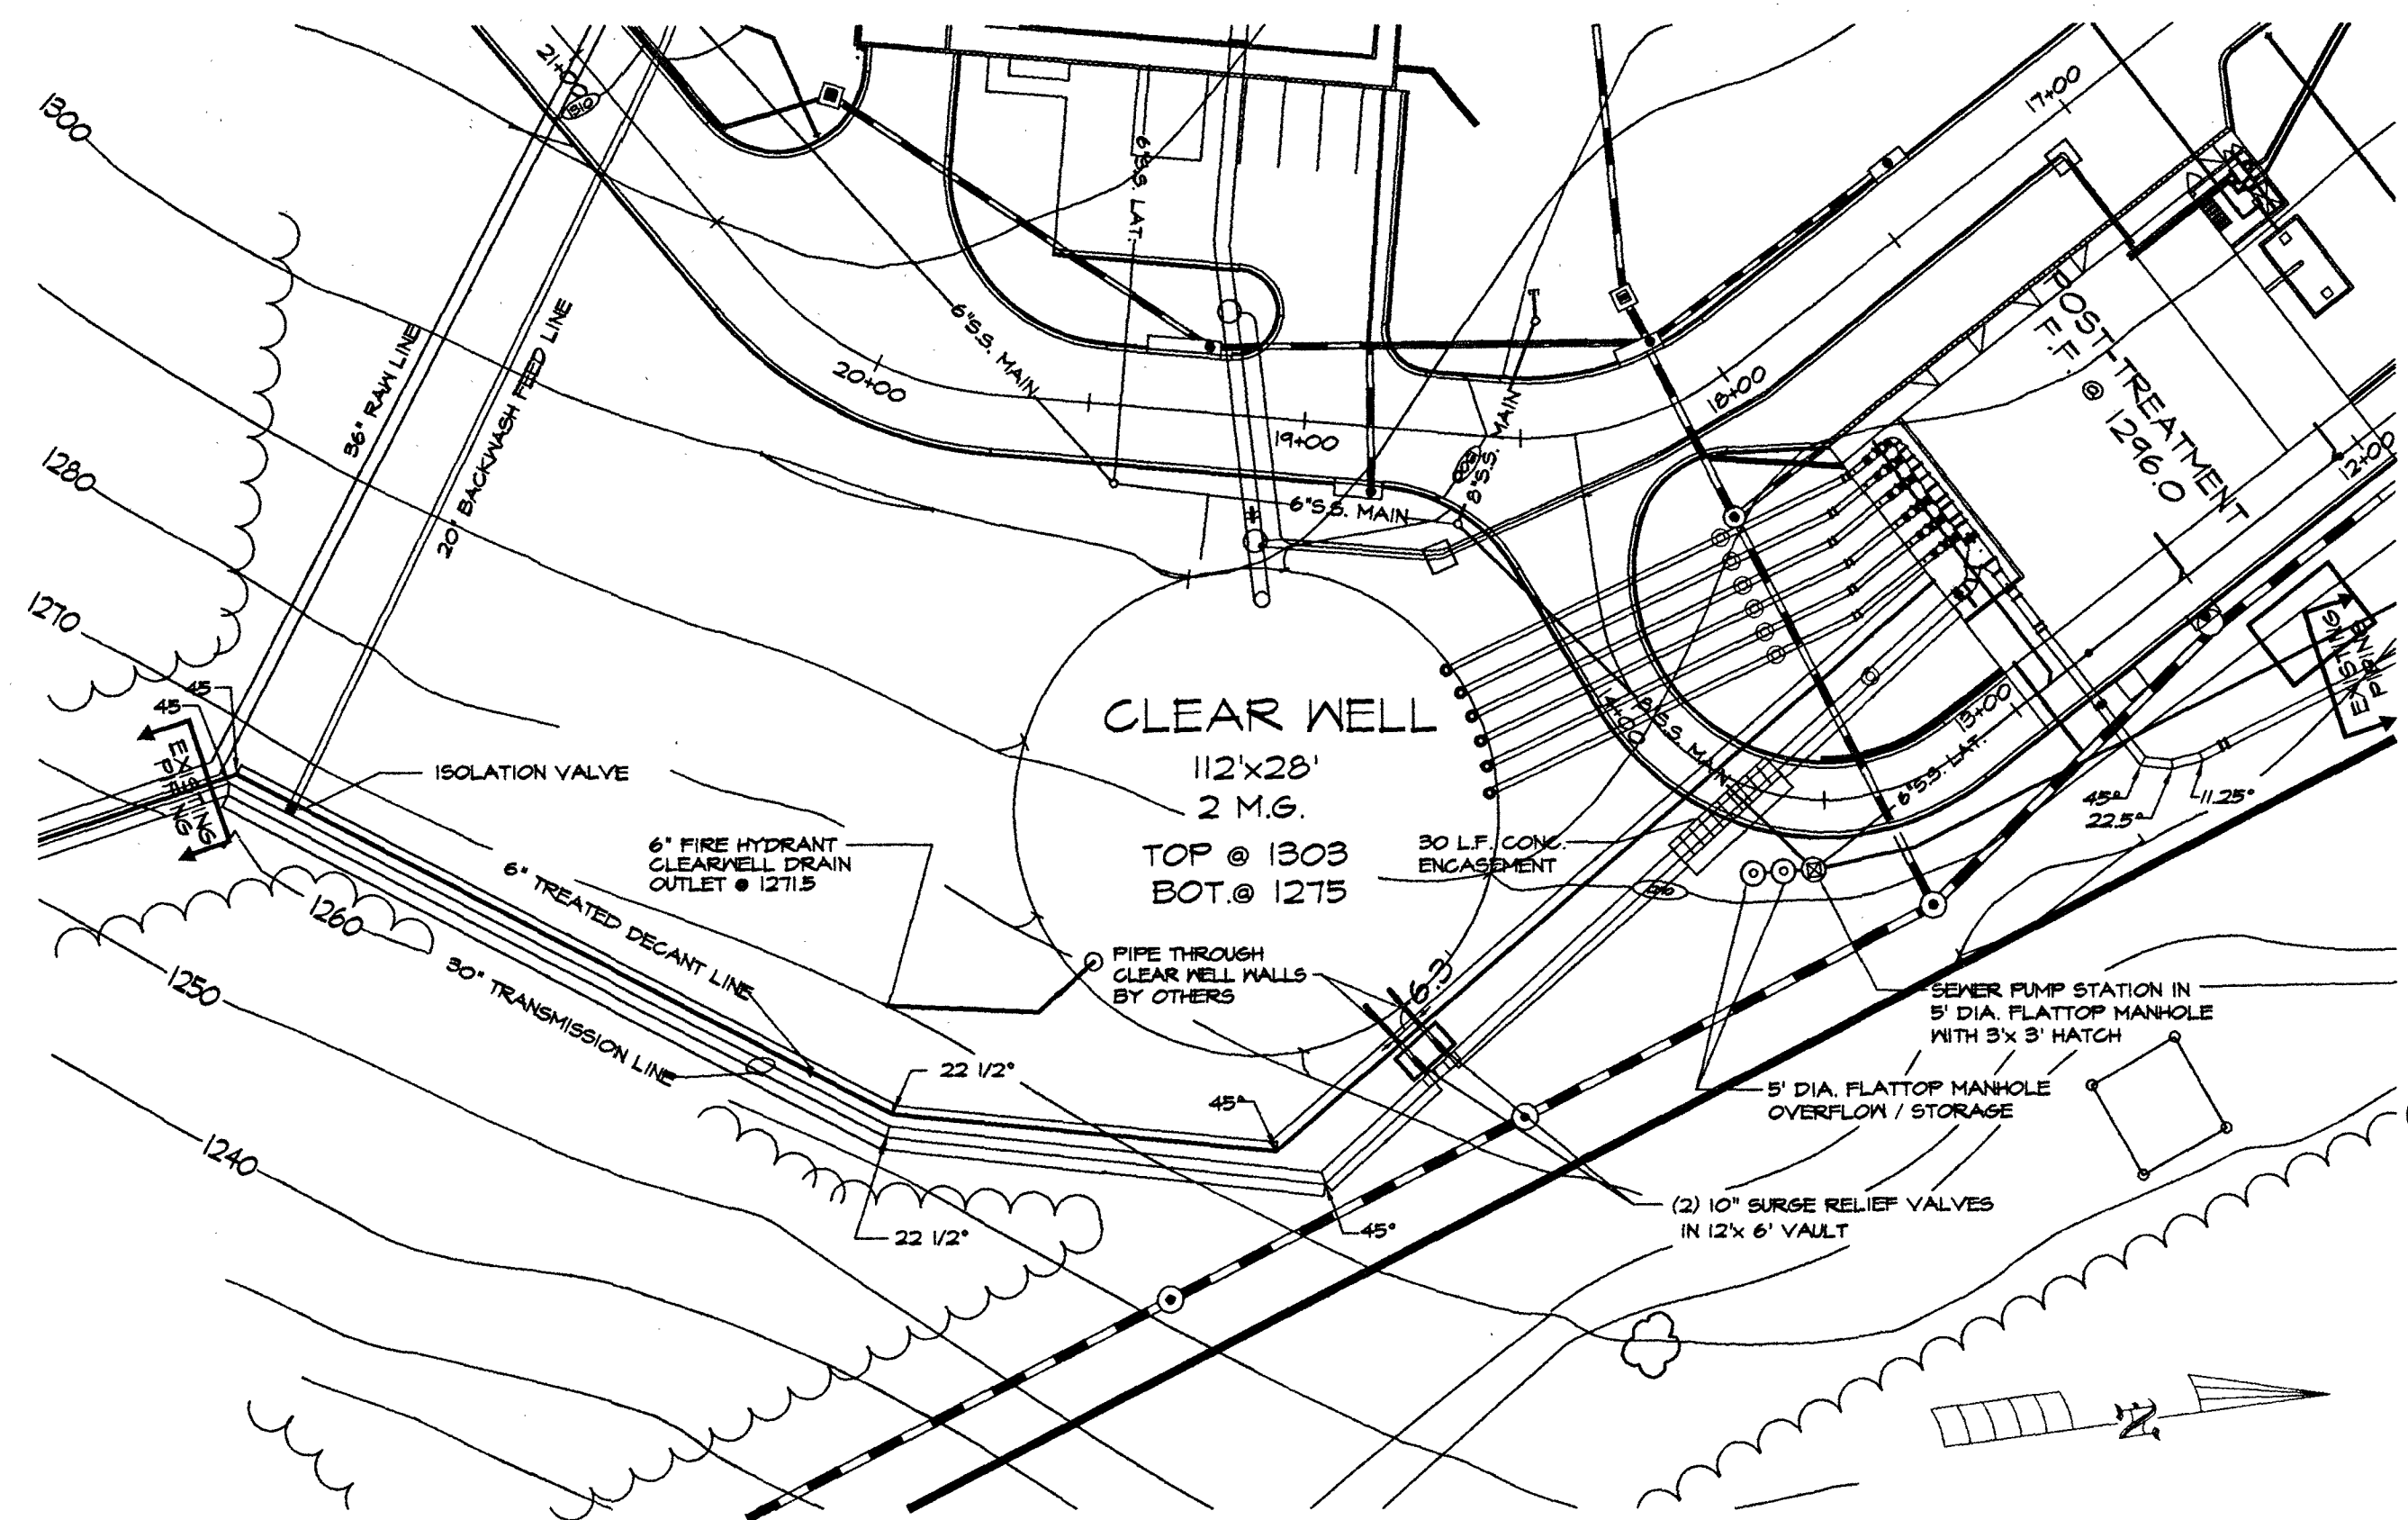

30" TRANSMISSION & 6" TREATED DECANT PLAN
 SCALE 1" = 40'-0"

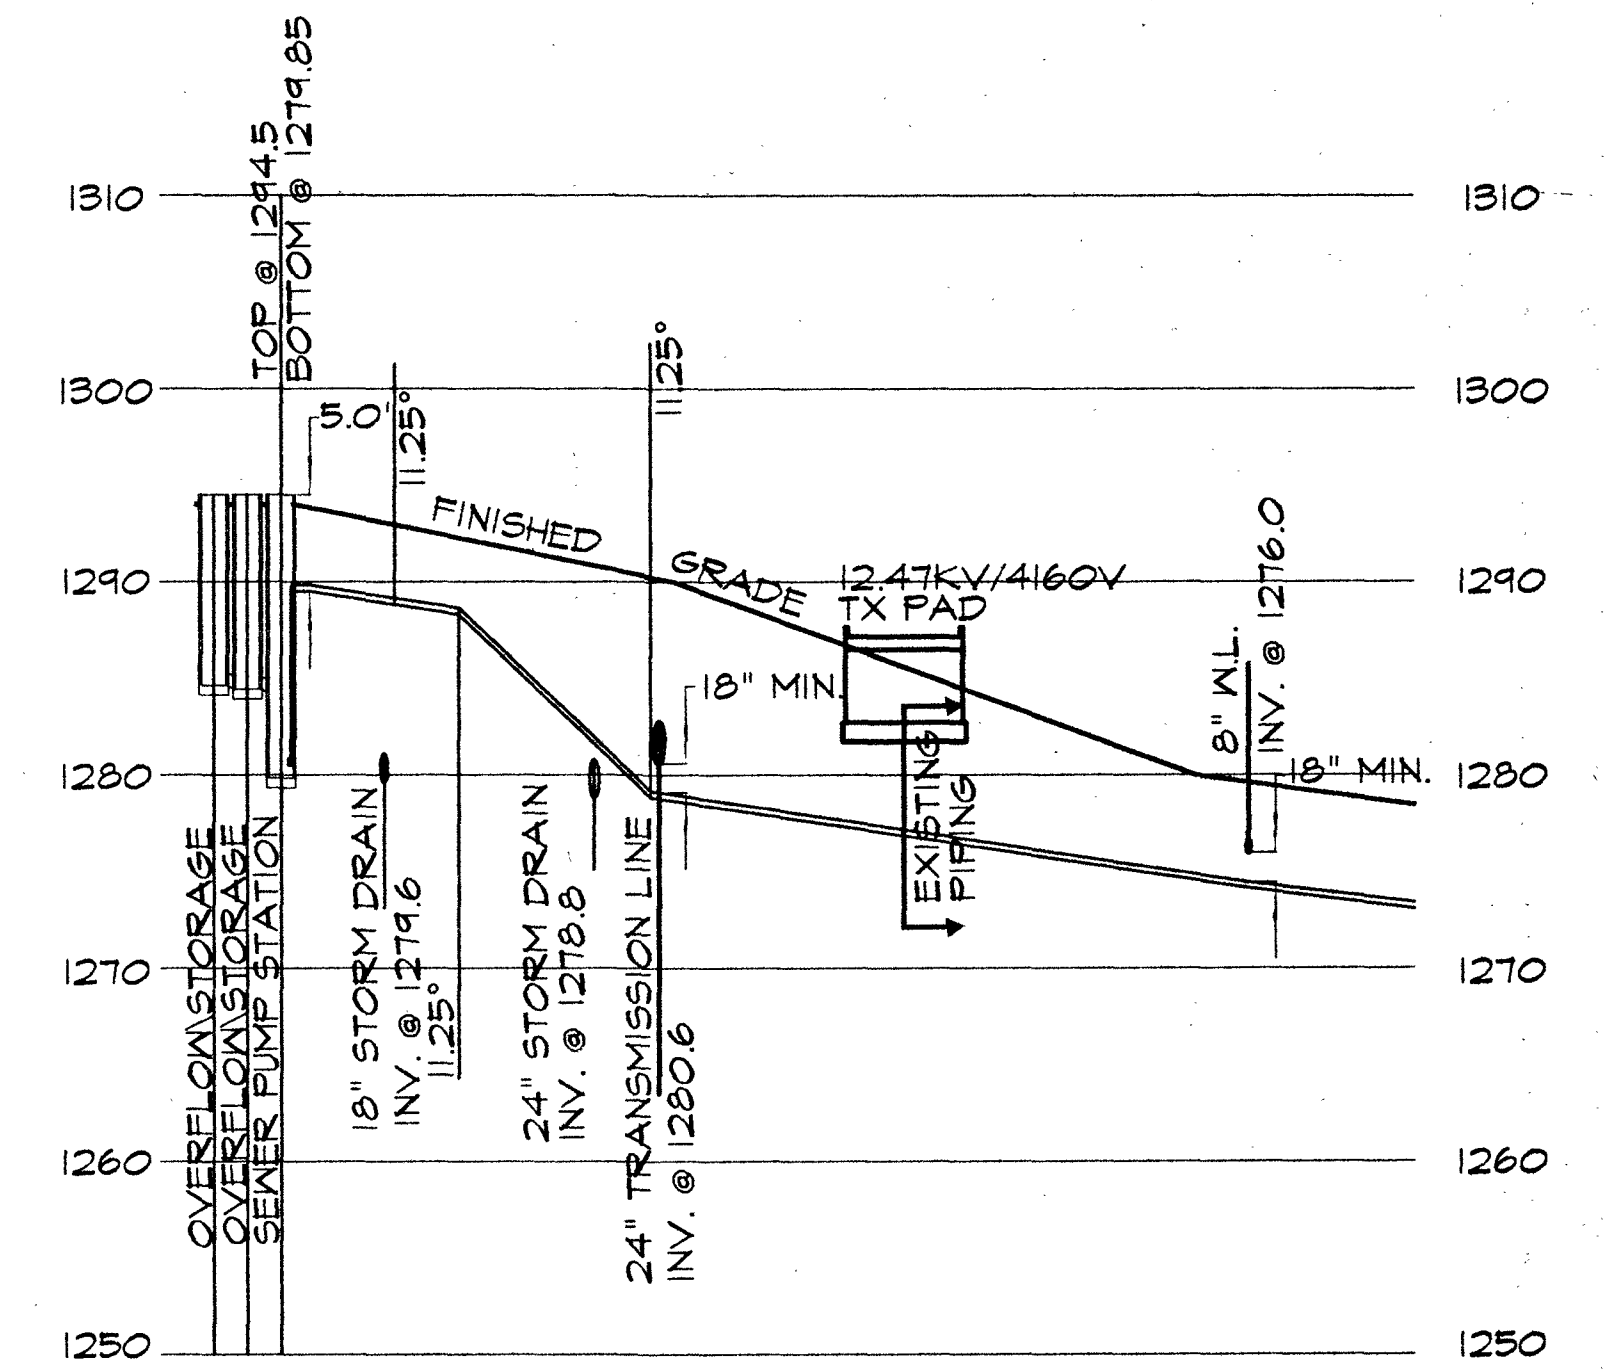


4" S.S. FORCE MAIN PROFILE
 SCALE VERT 1" = 10'-0"
 HORIZ 1" = 40'-0"

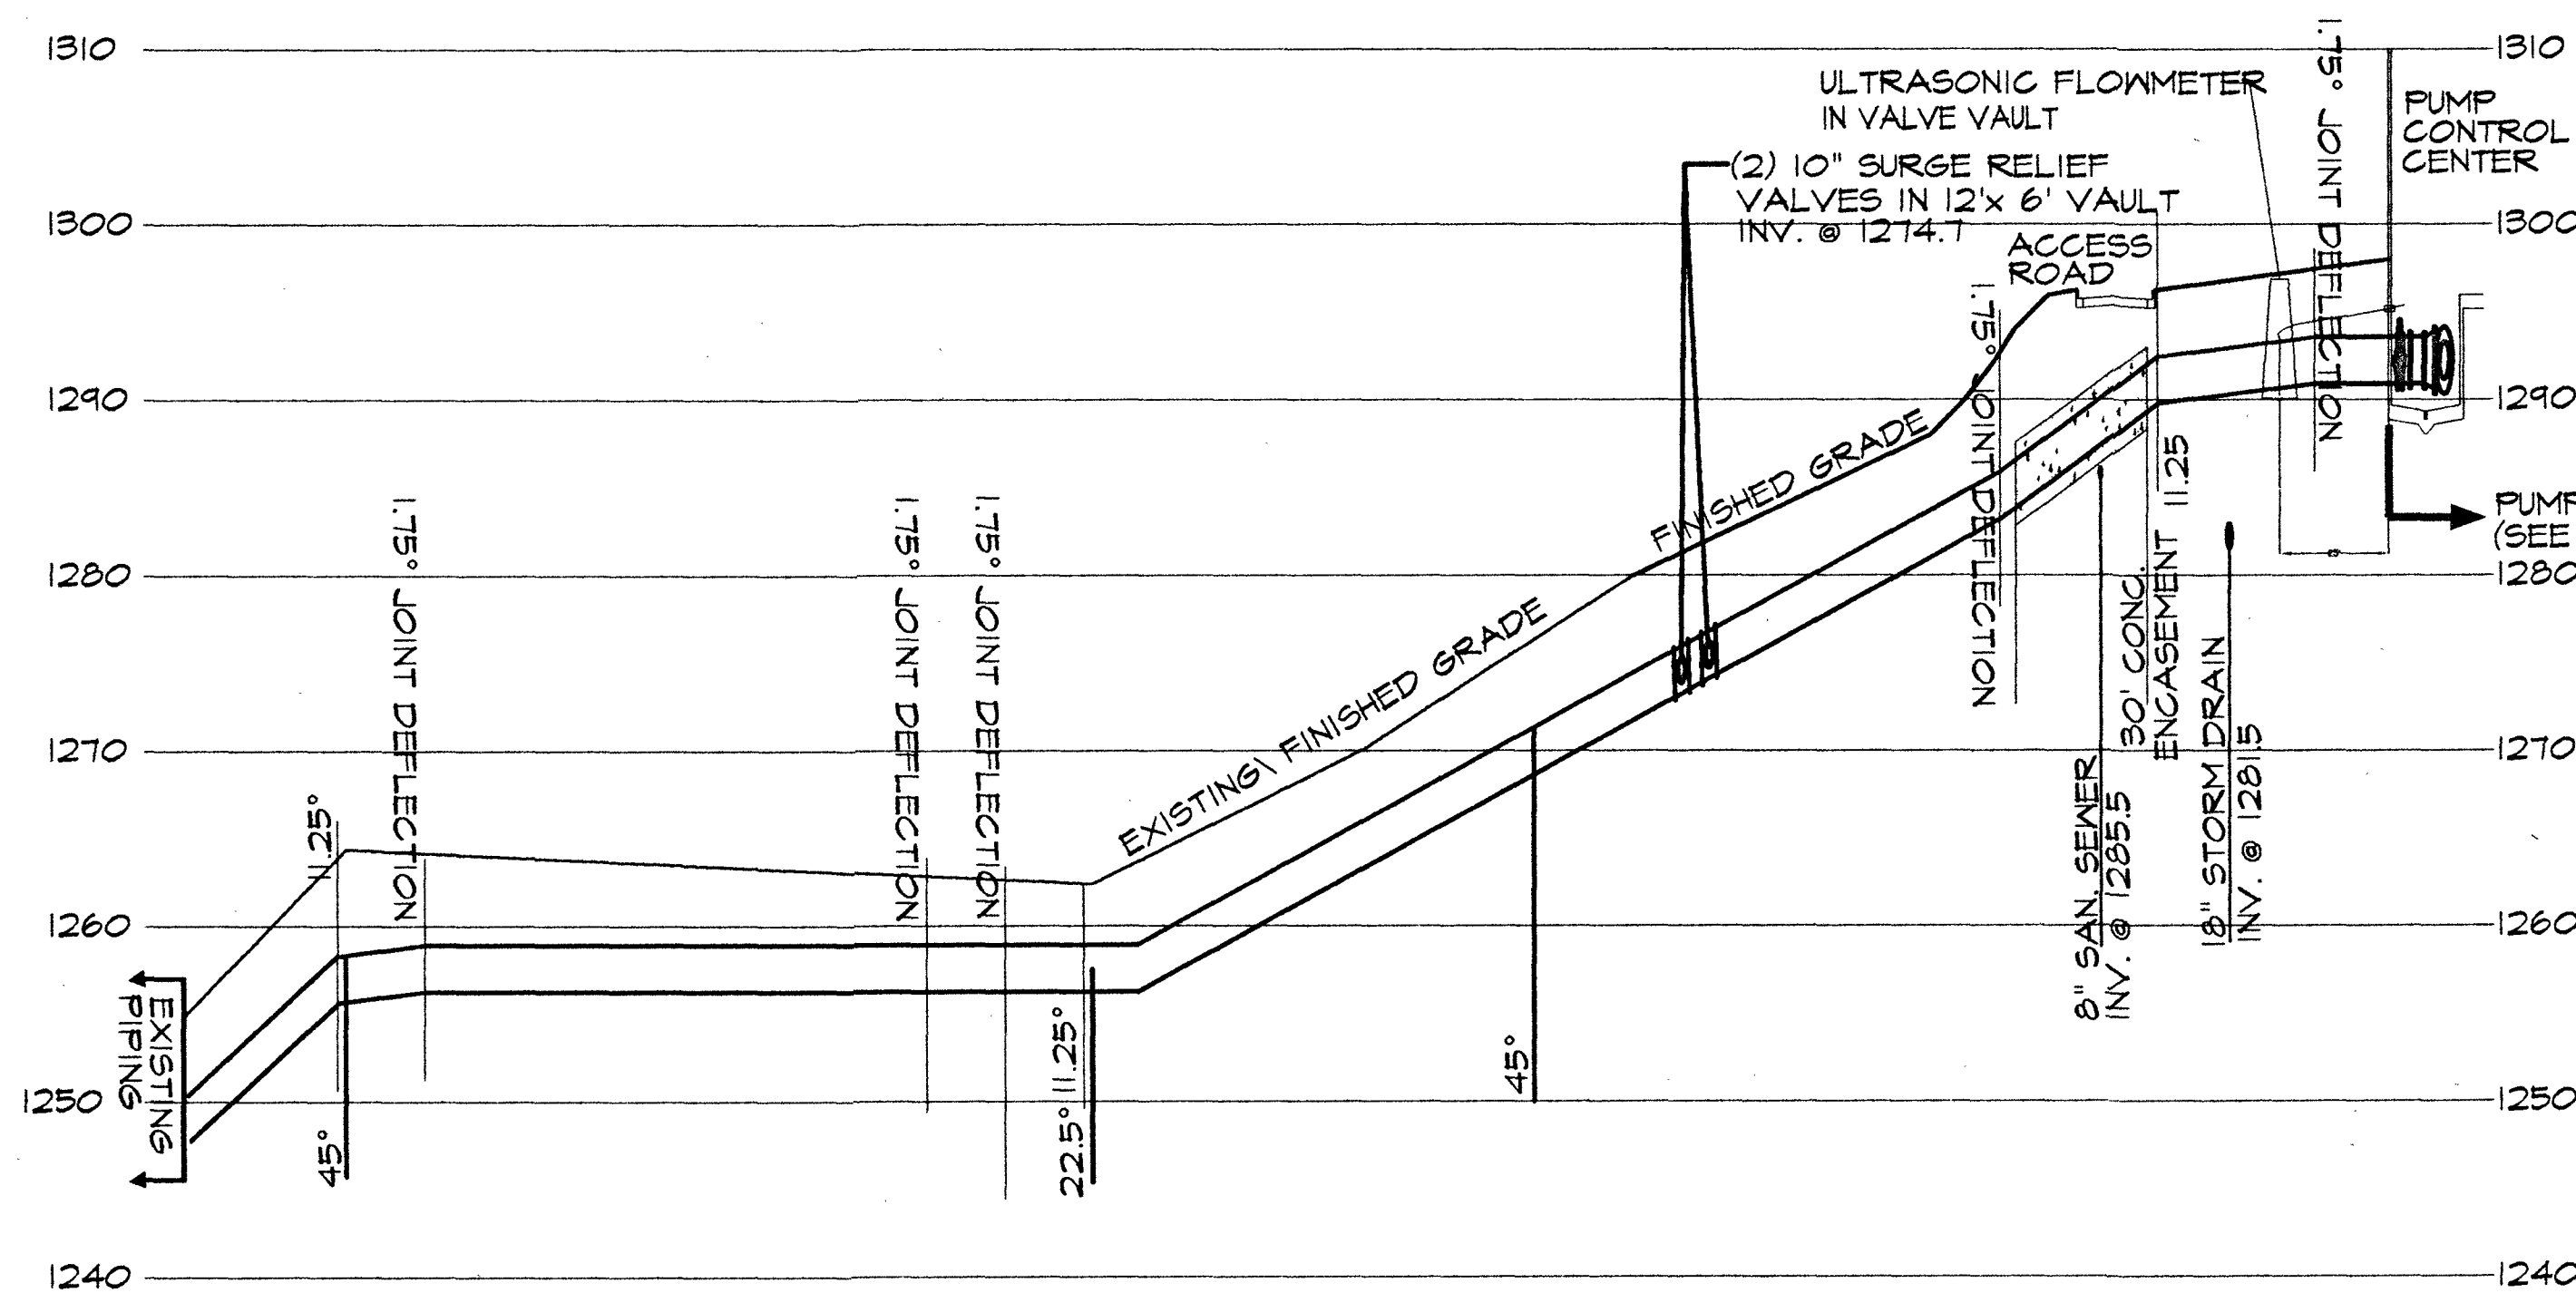


30" TRANSMISSION LINE PROFILE
 SCALE VERT 1" = 10'-0"
 HORIZ 1" = 40'-0"



- NOTES
1. TRANSMISSION LINES AND FITTINGS TO BE CLASS 52 MECHANICAL JOINT DUCTILE IRON
 2. 6 INCH TREATED DECANT LINE AND FITTING TO BE SDR-21 PVC
 3. 4 INCH SANITARY SEWER FORCE MAIN TO BE SDR-21 PVC

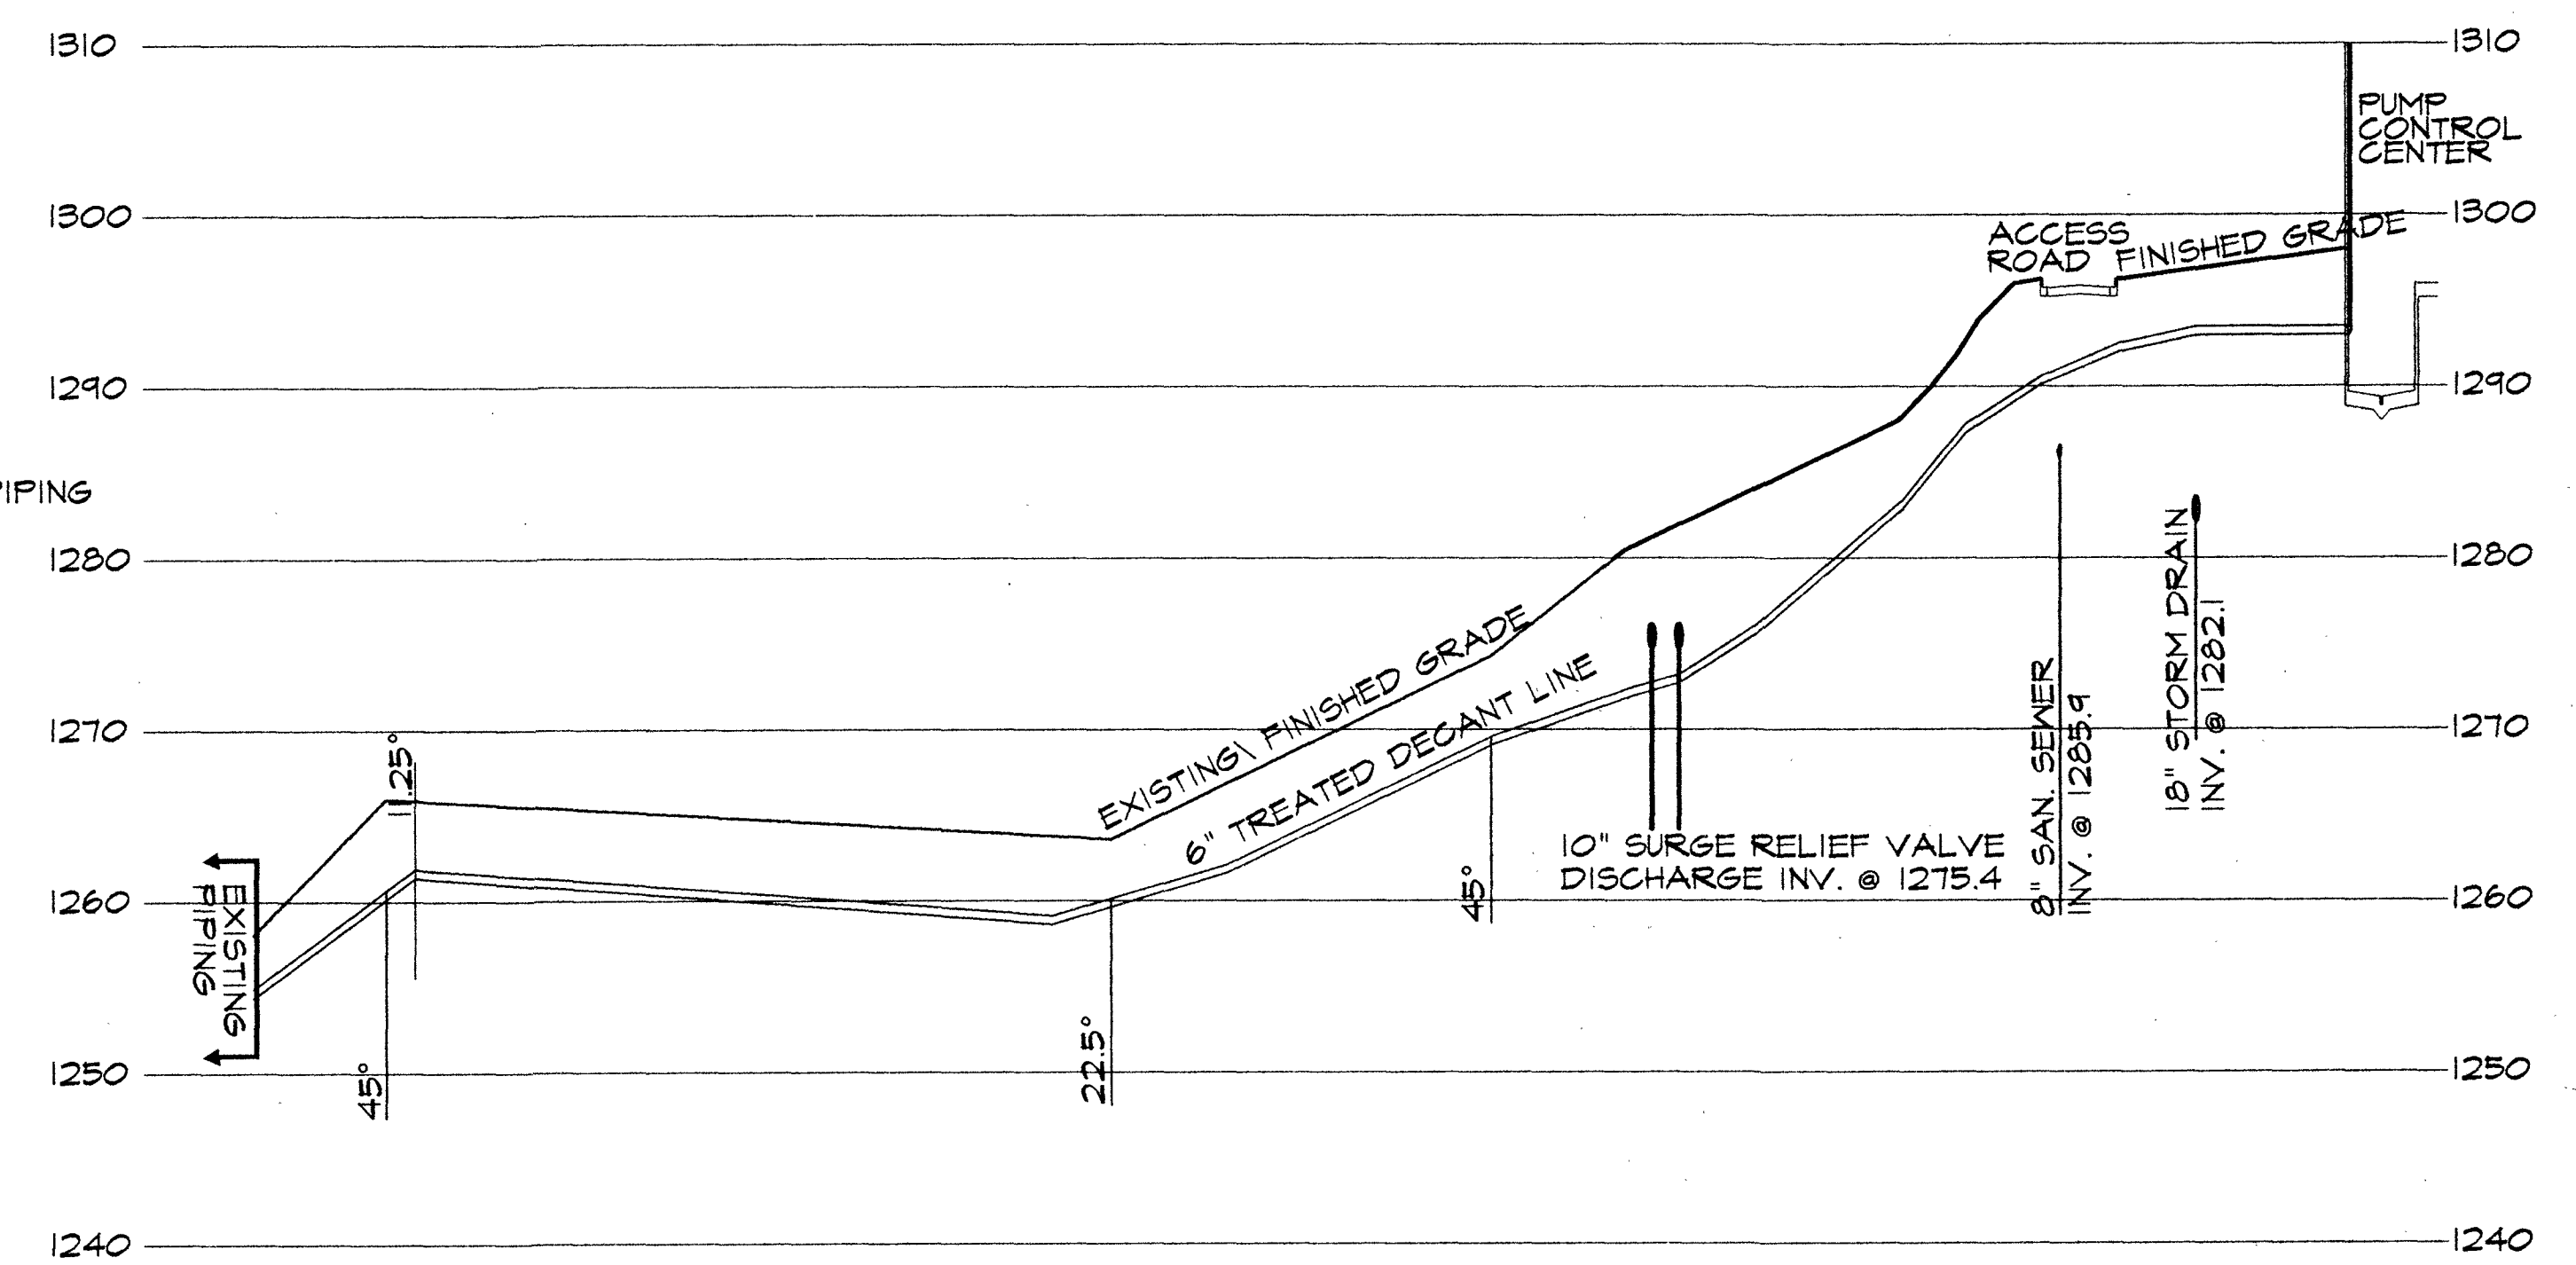

6" TREATED DECANT LINE PROFILE
 SCALE VERT 1" = 10'-0"
 HORIZ 1" = 40'-0"

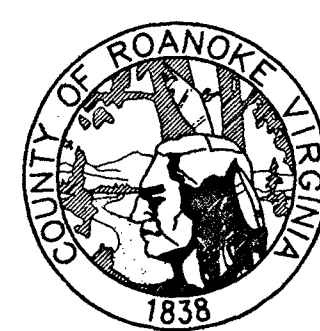

ROANOKE COUNTY WATER TREATMENT FACILITY

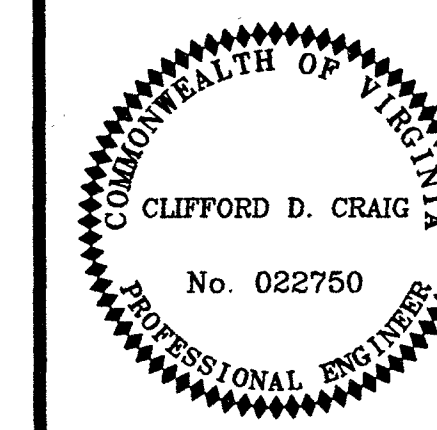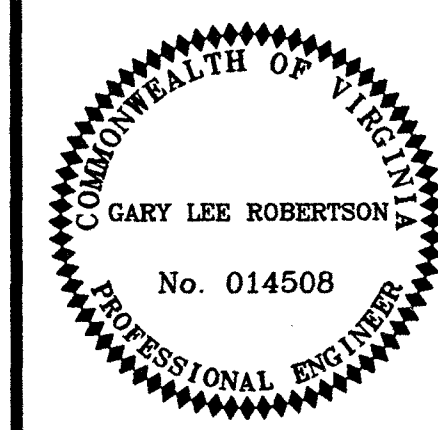

TRANSMISSION LINE PROFILES AND DECANT LINE PROFILE

DESIGN ENGINEER
 CLIFFORD D. CRAIG

COMMISSION NUMBER
 1913

RCUD NUMBER
 WTF-1

DATE
 15 SEPT. 1994

T17