



DATE: 03-21-95

DRAWN: PJK

CHECKED: JSW

APPROVED: JSW

DESIGNED: JSW

TANK DESCRIPTION:

2.0-MG CLEAR WELL

TANK DIMENSIONS:

112'0" ID x 28'0" SWD

TANK BUILDER:

THE CROM CORPORATION  
GAINESVILLE, FLORIDA

OWNER:

COUNTY OF  
ROANOKE  
VIRGINIA

CONSULTING ENGINEER:

ROANOKE COUNTY  
UTILITY DEPARTMENT

REV.	DESCRIPTION	DATE CHK. BY
------	-------------	-----------------


WHERE STANDARD SPECIFICATIONS ARE  
IN CONFLICT WITH CROM CORPORATION  
SPECIFICATIONS OR WITH GOOD PRE-  
STRESSING OR SHOTCRETE PRACTICES  
THE STANDARD SPECIFICATIONS SHALL  
BE SUBORDINATED.  
THIS DESIGN AND DRAWING ORIGINATED  
BY AND THE EXCLUSIVE PROPERTY OF  
THE CROM CORPORATION.

BAR IS ONE INCH ON ORIGINAL  
DRAWINGS 0 1"

SCALE: 1/4" = 1'0"

FILE NO. 9449.2


SHEET 10 OF 19

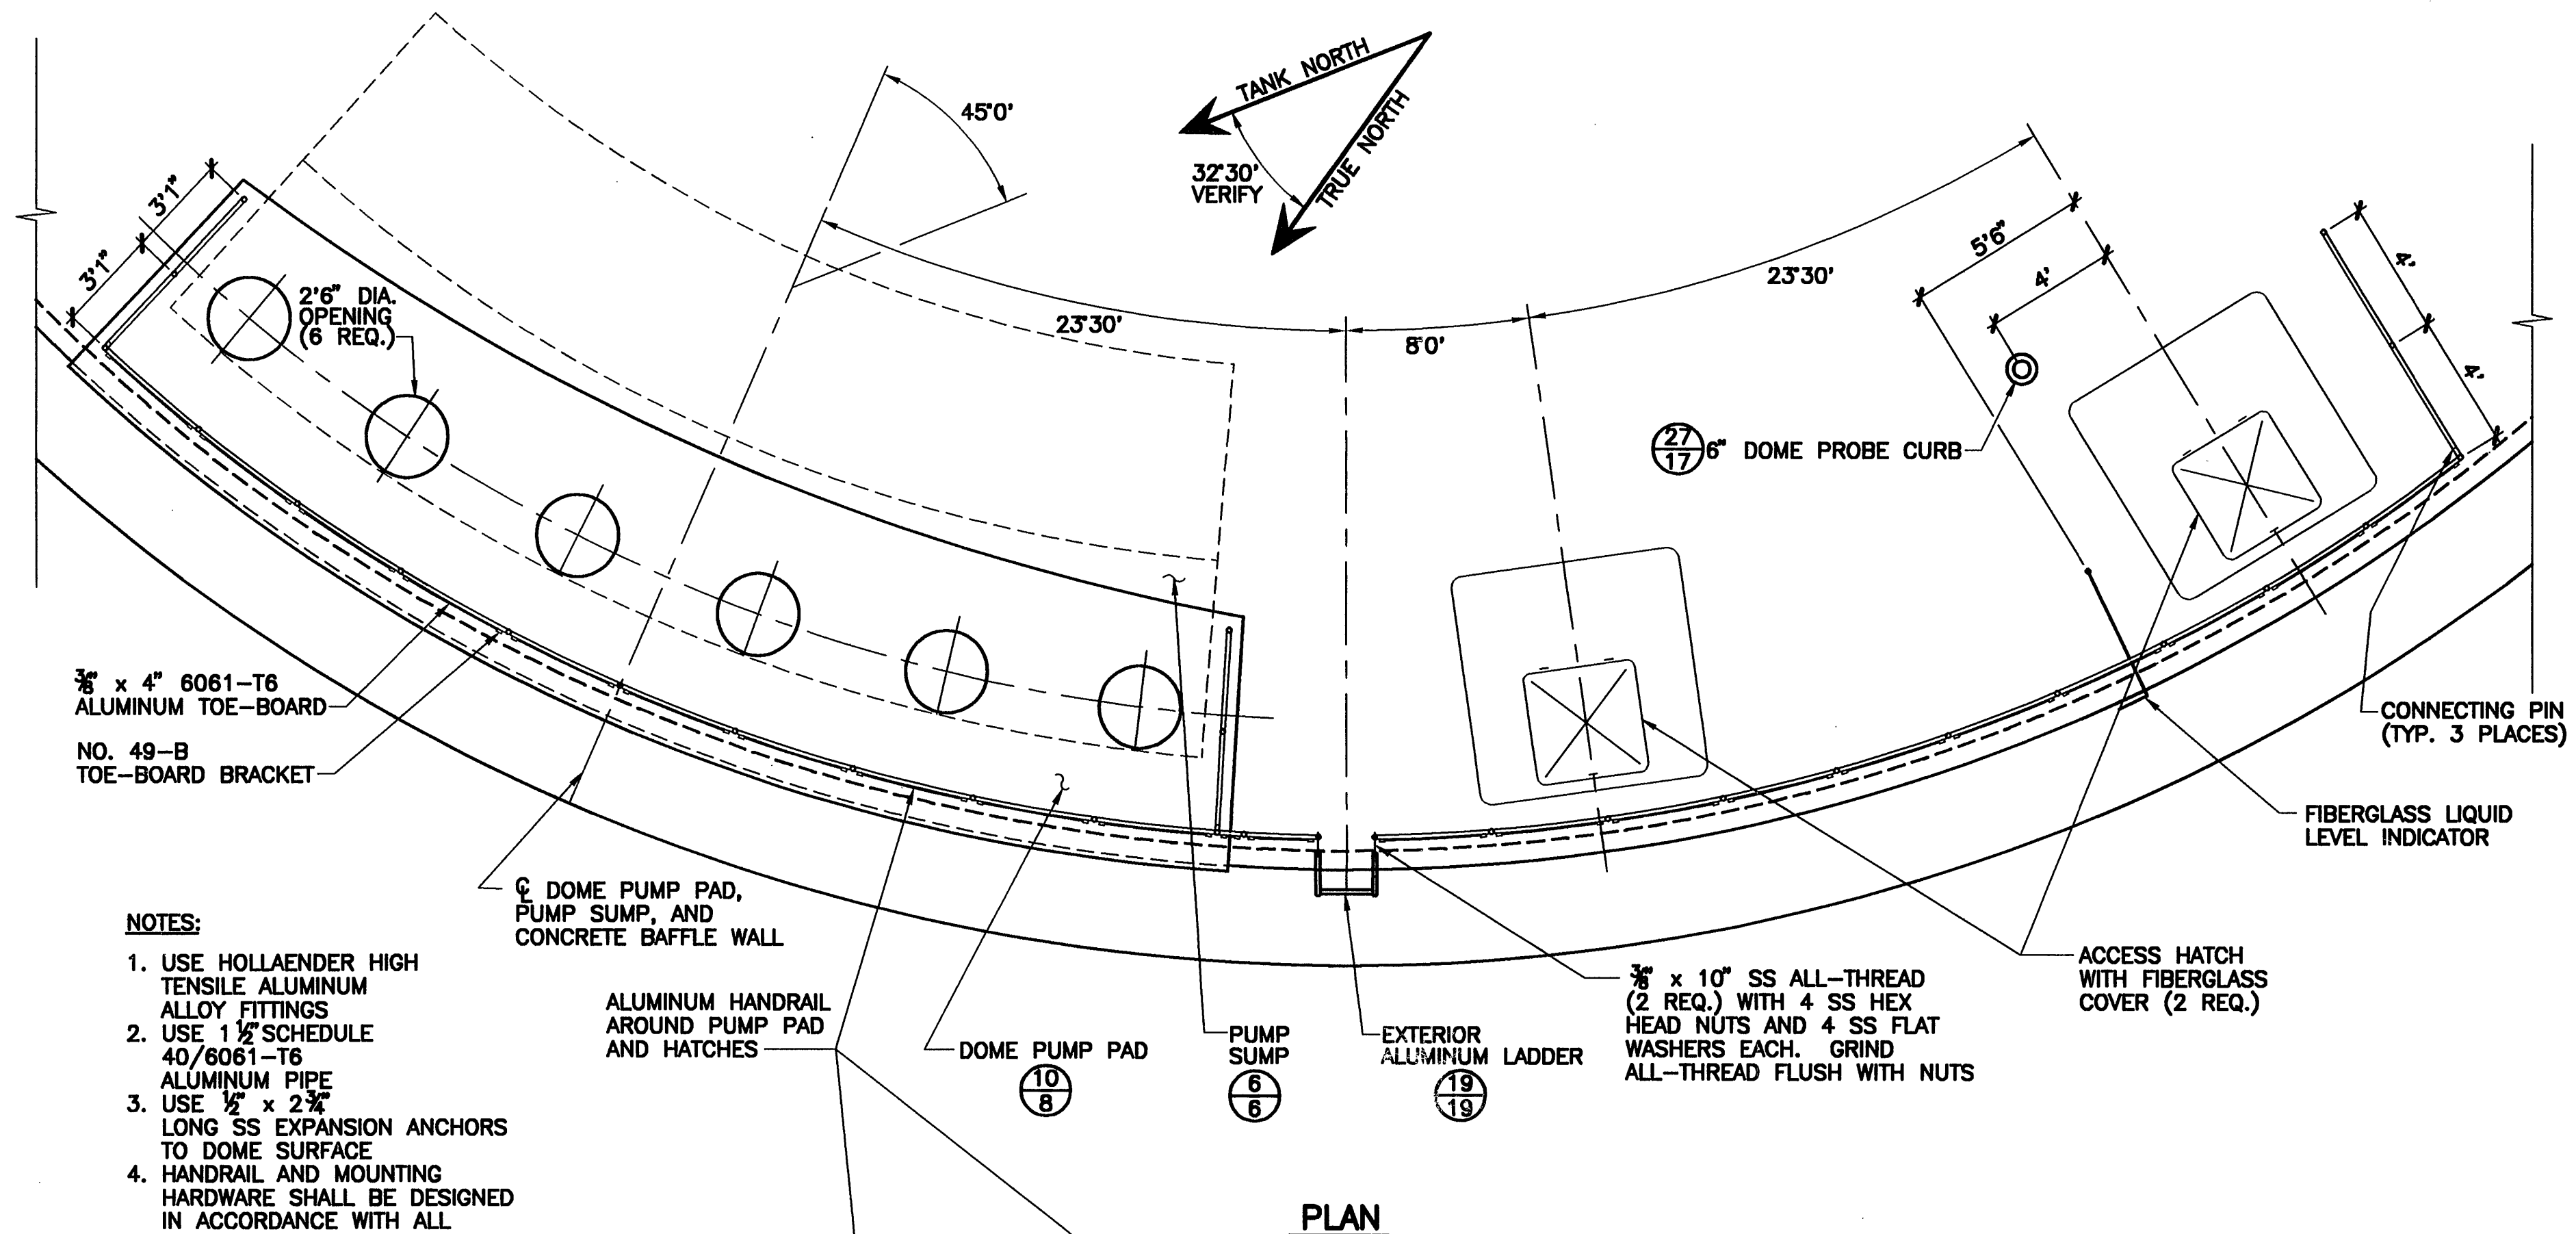

NOTES:

1. USE HOLLANDER HIGH TENSILE ALUMINUM ALLOY FITTINGS
2. USE 1 1/2" SCHEDULE 40/6061-T6 ALUMINUM PIPE
3. USE 1/2" x 2 3/4" LONG SS EXPANSION ANCHORS TO DOME SURFACE
4. HANDRAIL AND MOUNTING HARDWARE SHALL BE DESIGNED IN ACCORDANCE WITH ALL BOCA AND OSHA CODES AND REQUIREMENTS

PLAN

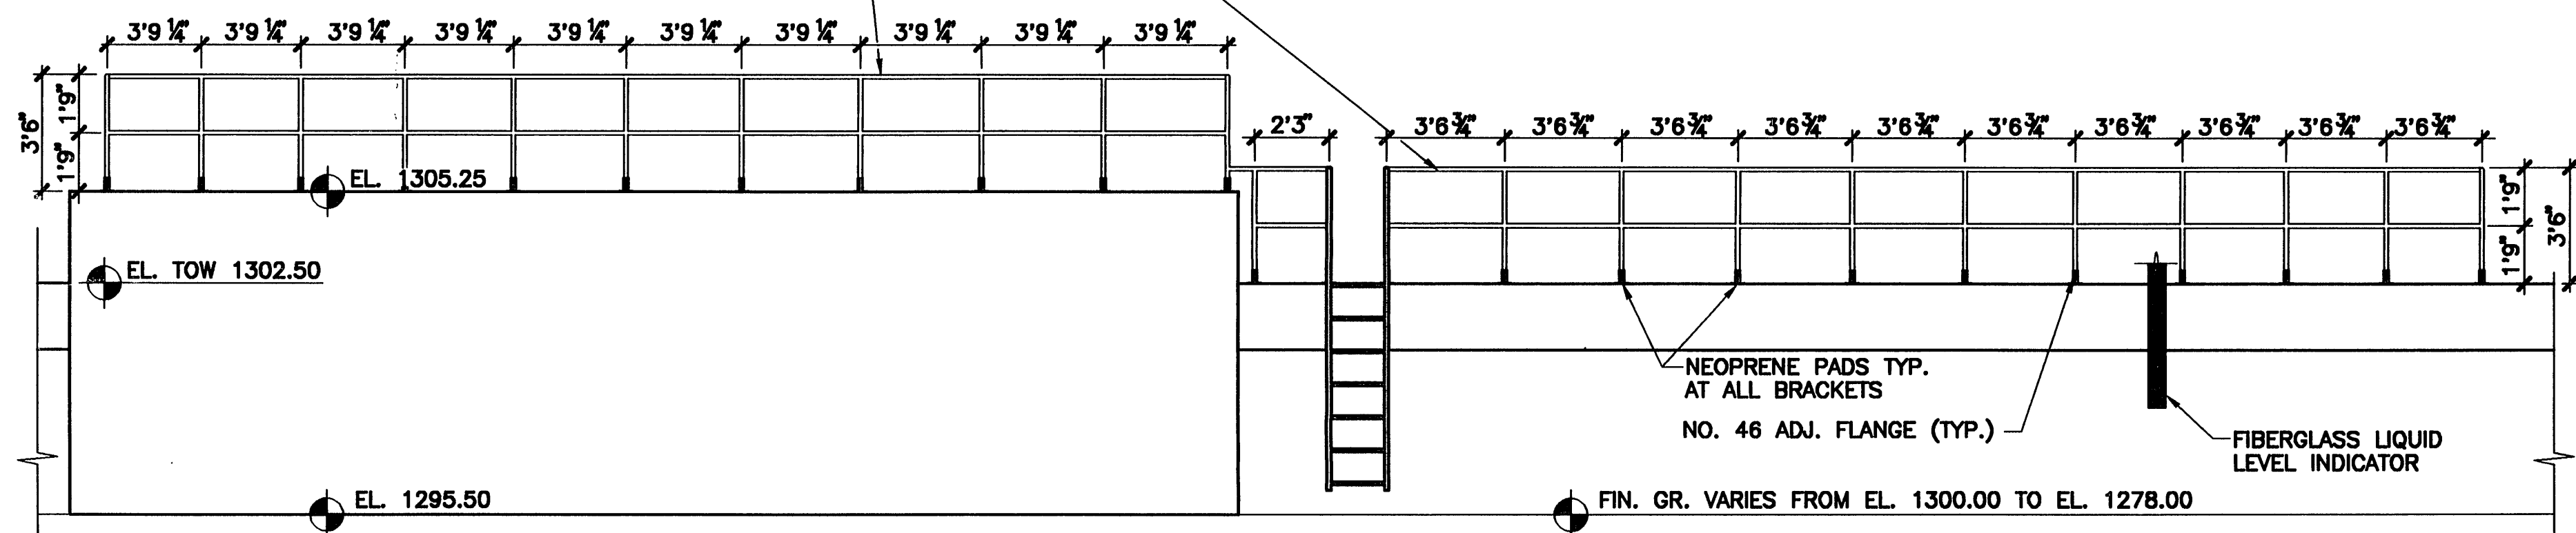

ELEVATION

12 ALUMINUM HANDRAIL