


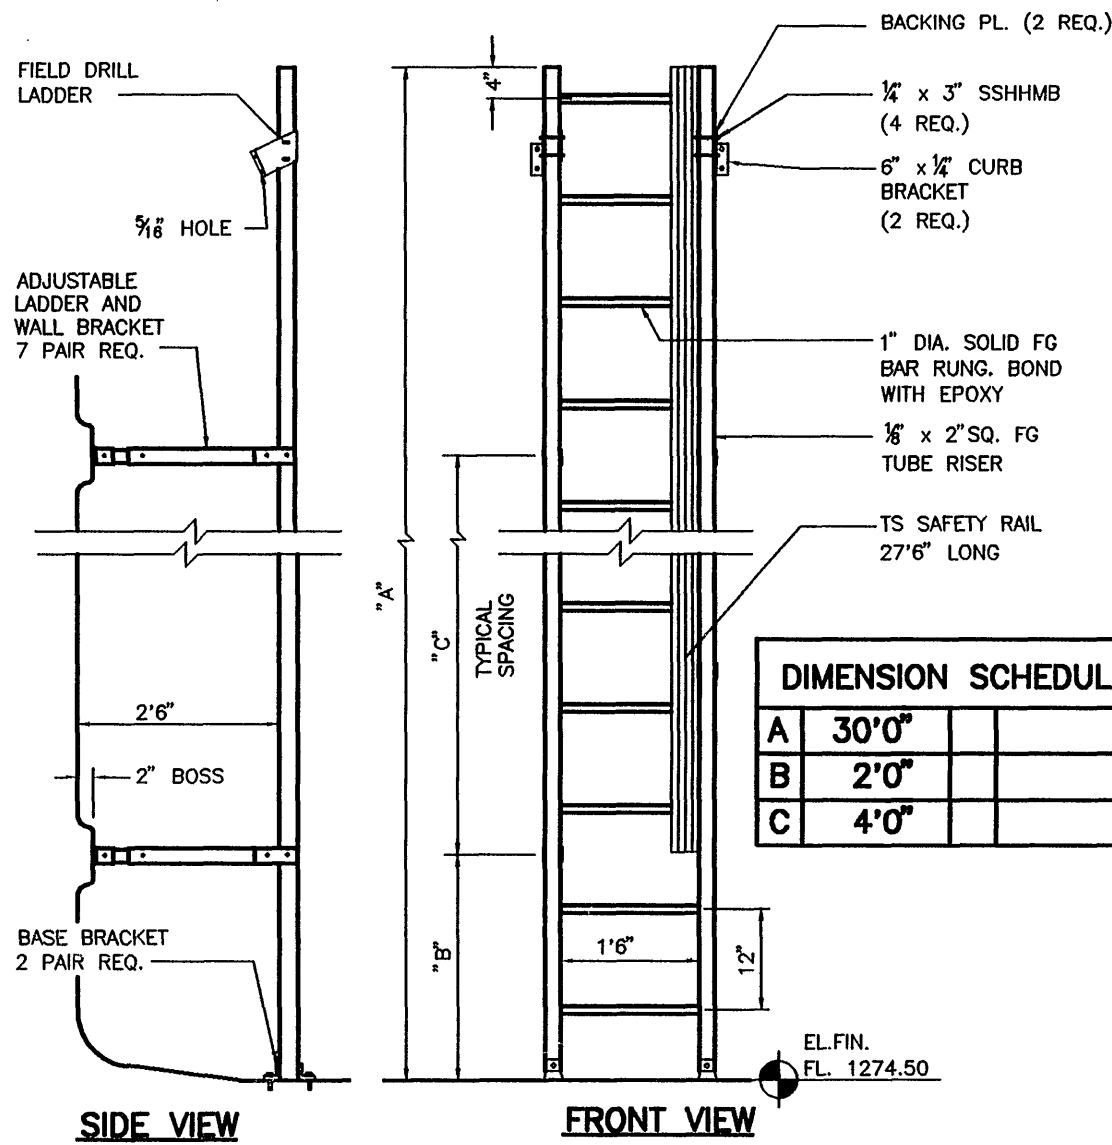
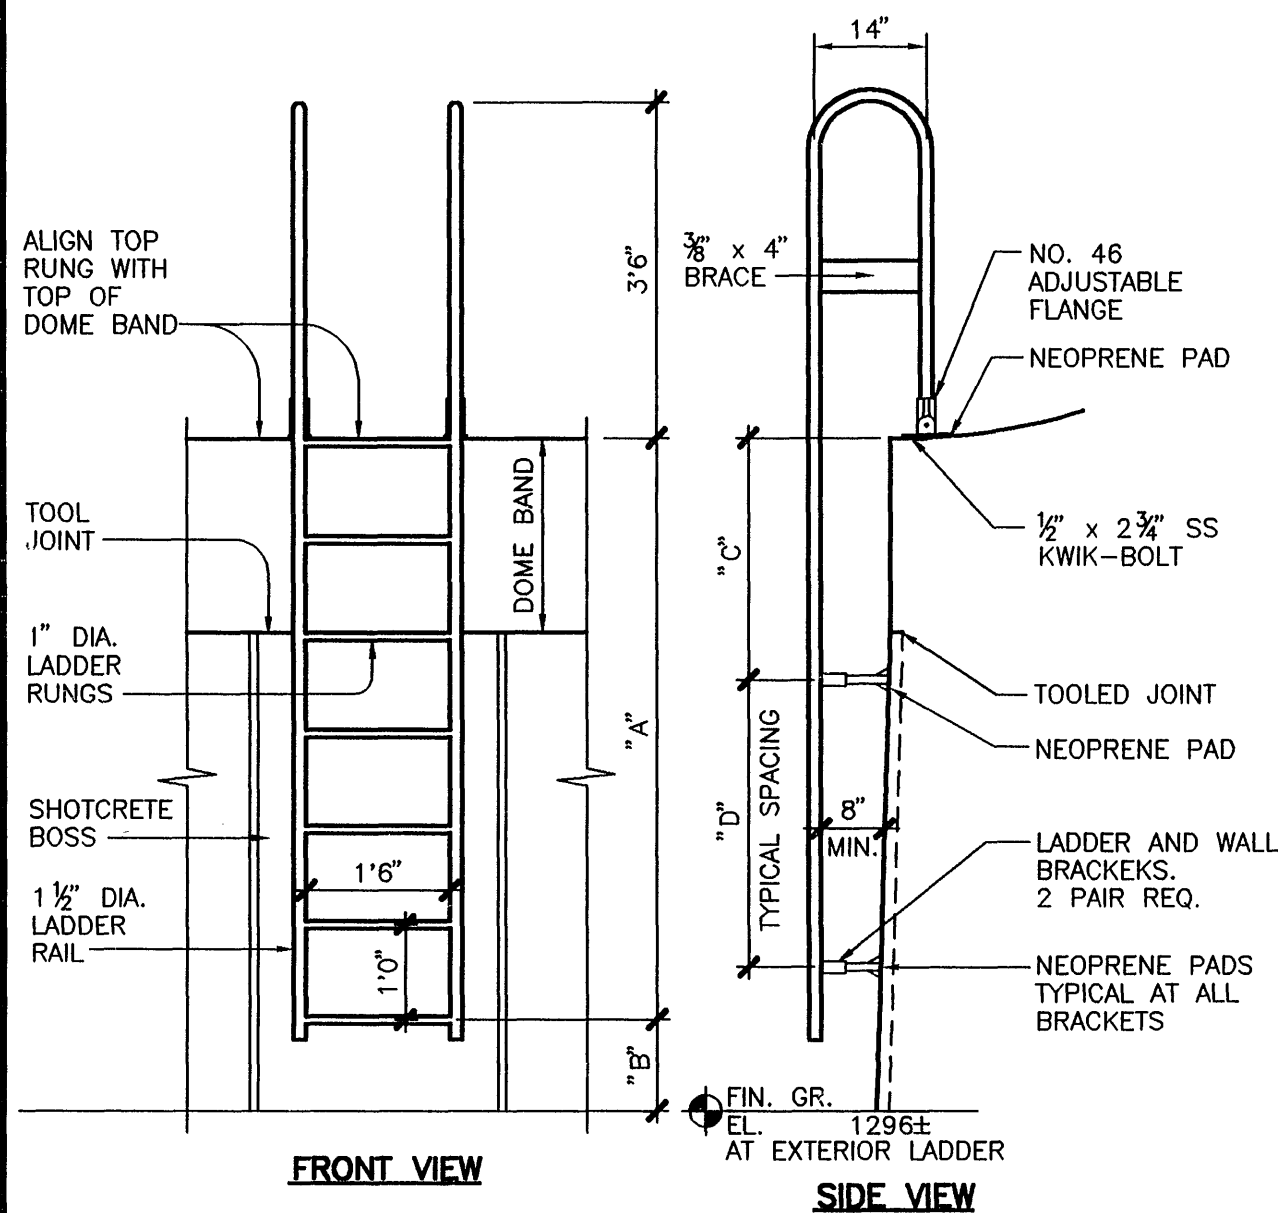


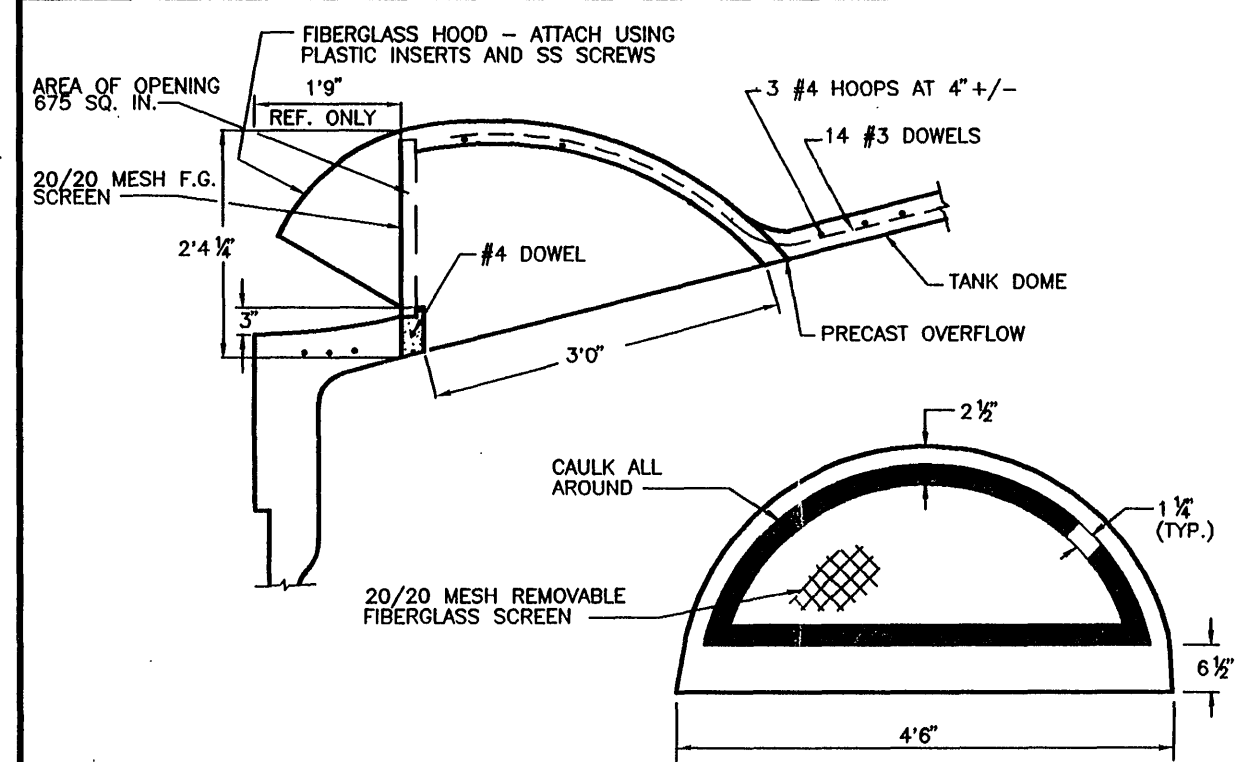



NOTE: 1/4" x 2" FLAT BAR FIBERGLASS CROSS-BRACE TO BE PROVIDED FOR BRACING WALL BRACKET SUPPORTS ON LADDERS OVER 20'0" TALL. INSTALL ON EVERY OTHER BRACKET.

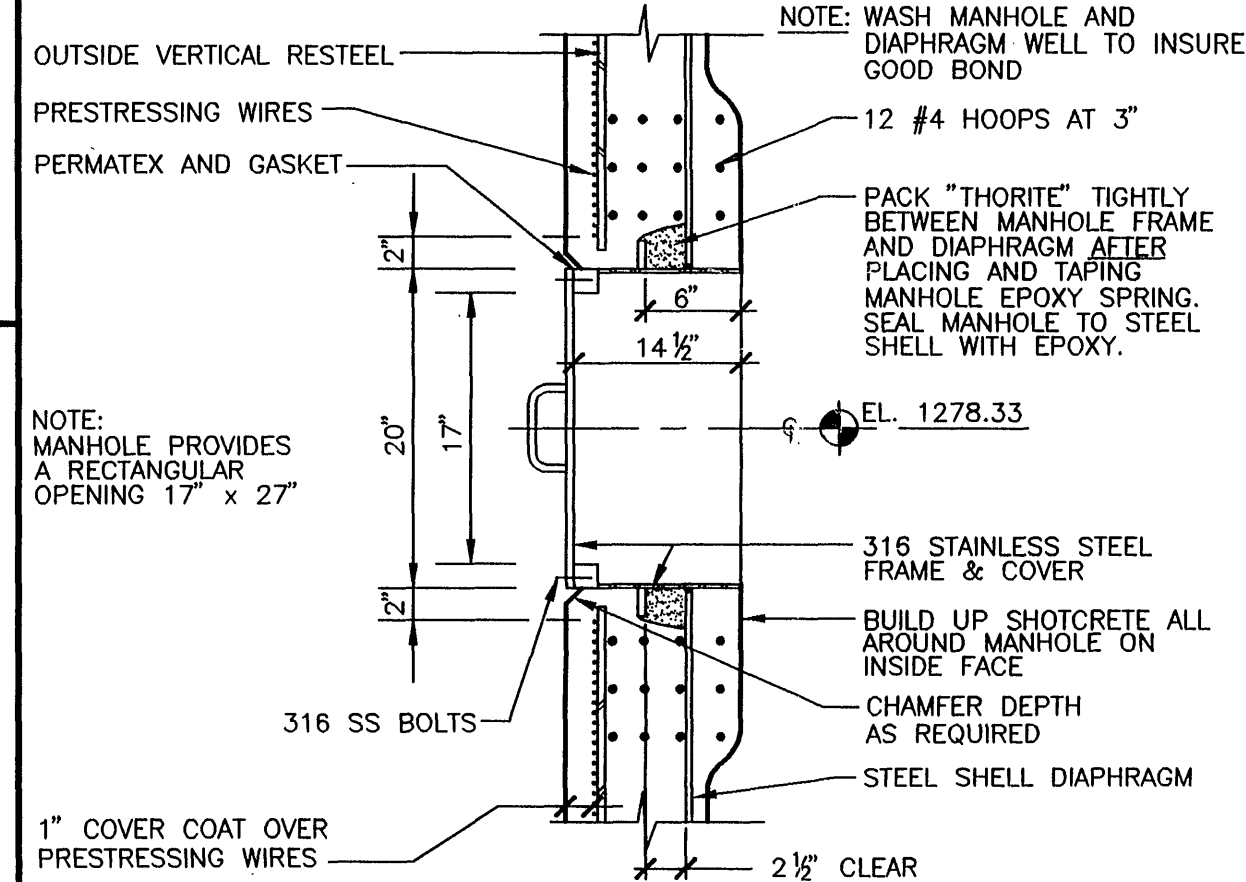

NOTES: 1. ALL TUBULAR MATERIAL TO BE NOMINAL DIAMETER SCHEDULE 40 ALUMINUM PIPE 6061 - T6
2. PLATES AND GUSSETS TO BE STRUCTURAL GRADE ALUMINUM 6061 - T6

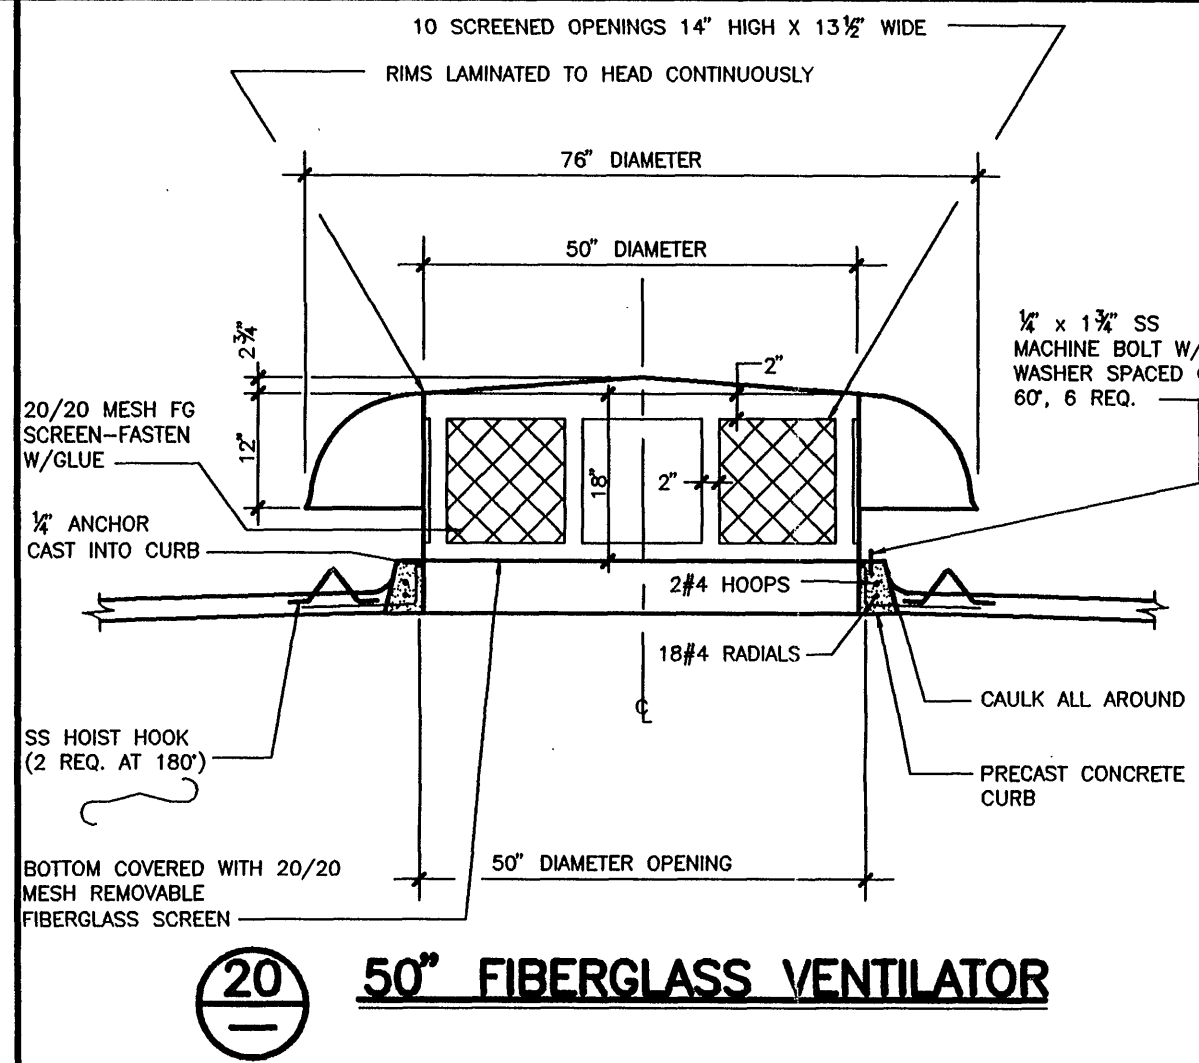

NOTE: KEEP SHOTCRETE REBOUND CLEANED OFF OF OVERFLOW. LEAVE PLYWOOD COVER IN PLACE UNTIL ALL SHOTCRETING IS COMPLETE

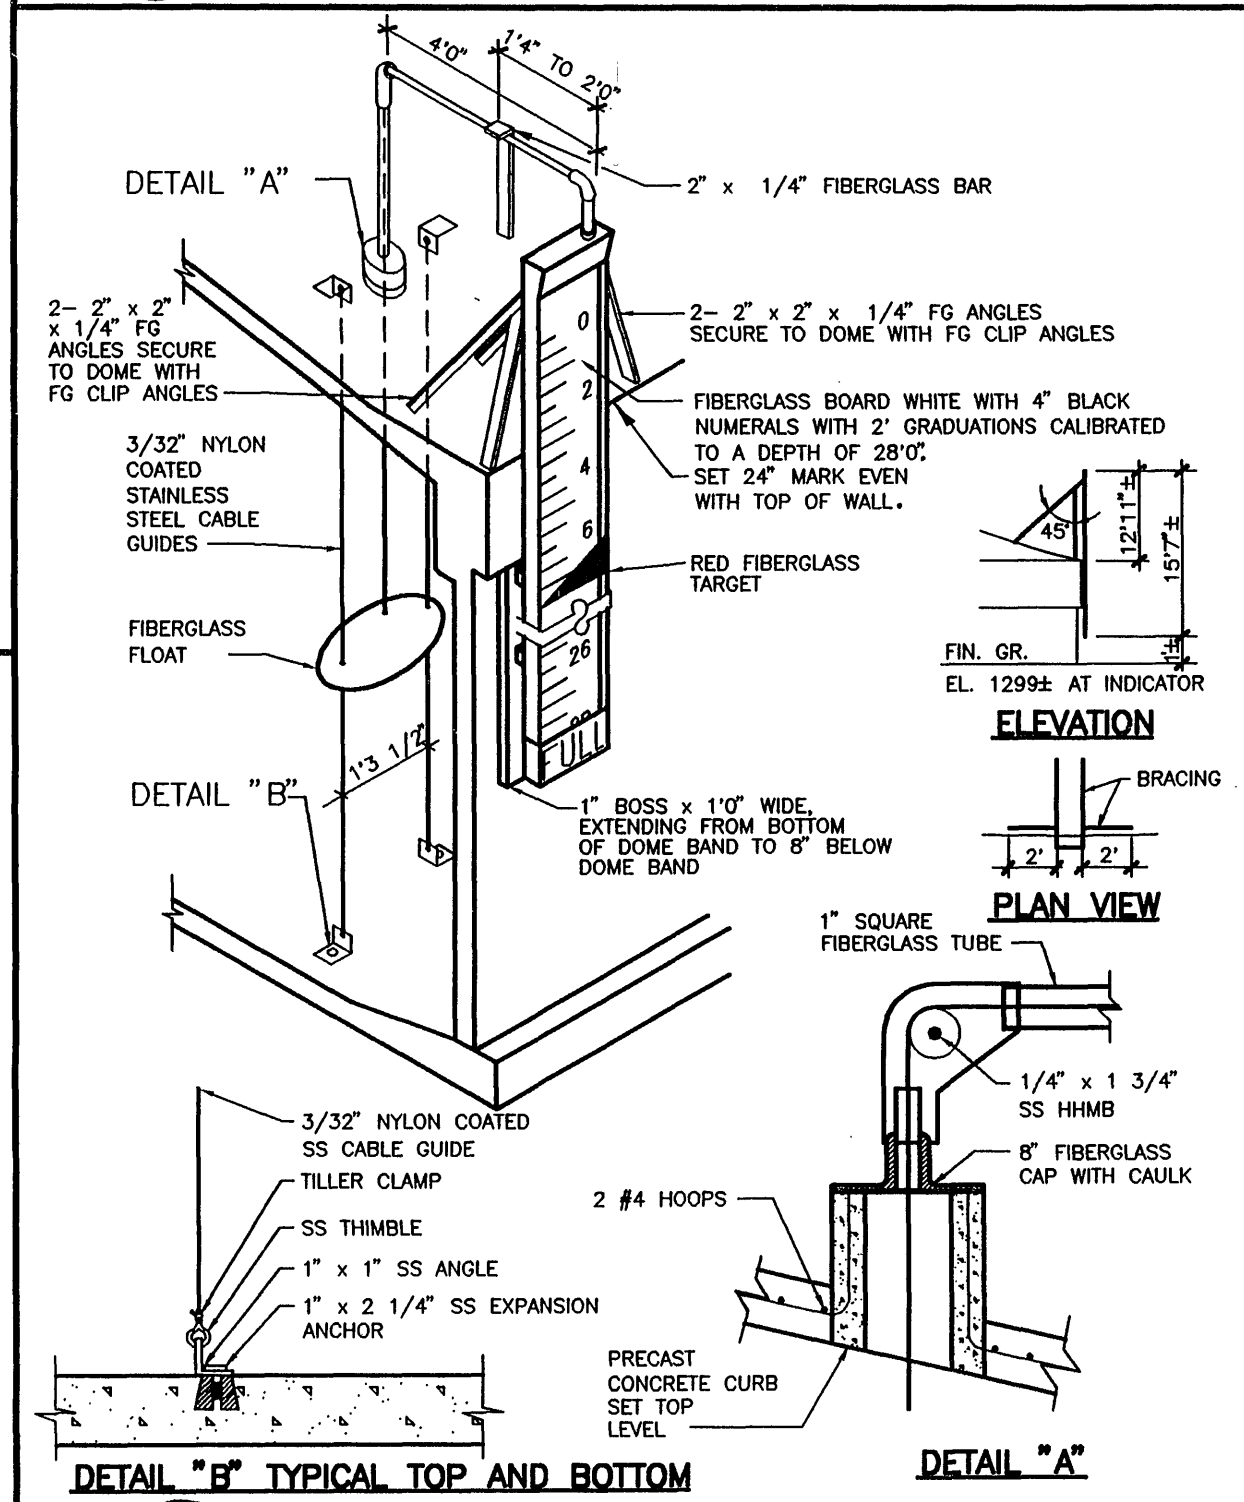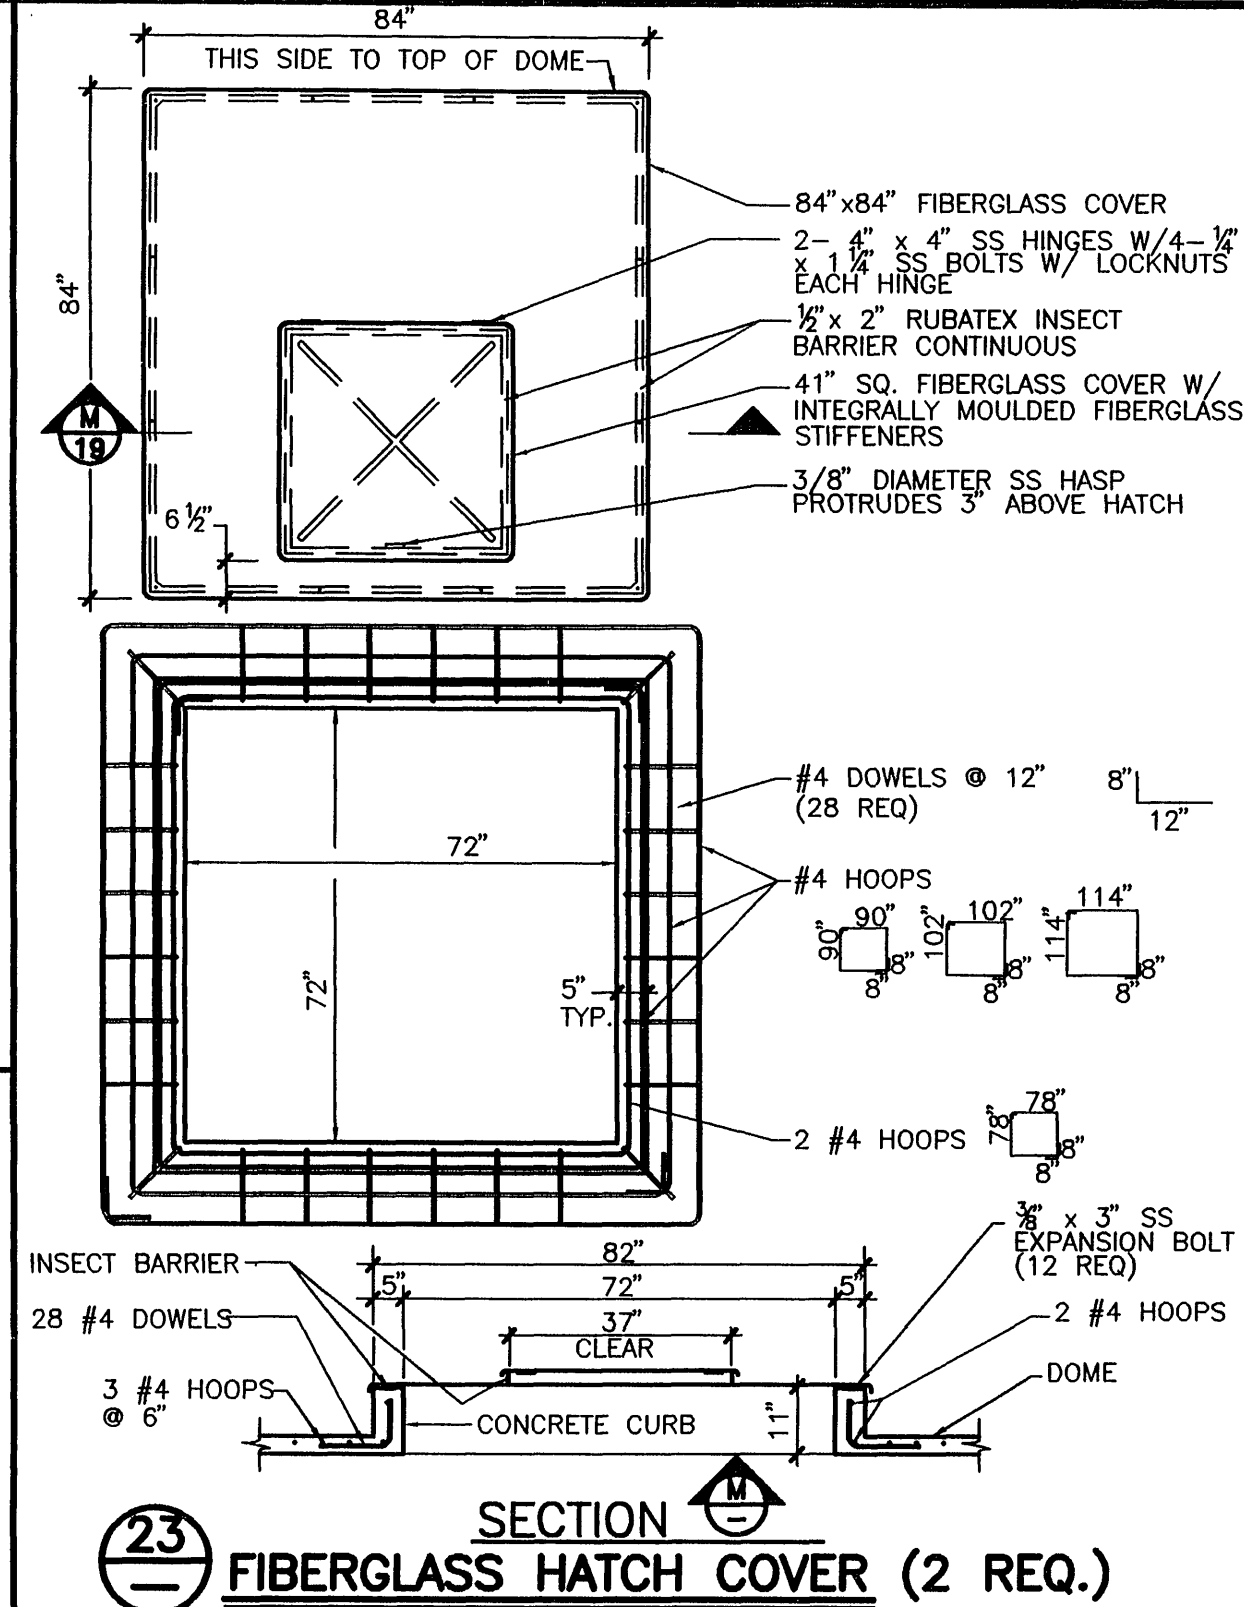

COPYRIGHT © 1995 BY THE CROM CORPORATION-ALL RIGHTS RESERVED



DATE: 03-21-95
DRAWN: PSM
CHECKED: [Signature]
APPROVED: [Signature]
DESIGNED: JSW

TANK DESCRIPTION:
2.0-MG CLEAR WELL

TANK DIMENSIONS:
112'0" ID x 28'0" SWD

TANK BUILDER:
THE CROM CORPORATION GAINESVILLE, FLORIDA

OWNER:
COUNTY OF ROANOKE VIRGINIA

CONSULTING ENGINEER:
ROANOKE COUNTY UTILITY DEPARTMENT

REV. DESCRIPTION DATE

WHERE STANDARD SPECIFICATIONS ARE IN CONFLICT WITH CROM CORPORATION SPECIFICATIONS OR WITH GOOD PRE-STRESSING OR SHOTCRETE PRACTICES THE STANDARD SPECIFICATIONS SHALL BE SUBORDINATED. THIS DESIGN AND DRAWING ORIGINATED BY AND THE EXCLUSIVE PROPERTY OF THE CROM CORPORATION.

BAR IS ONE INCH ON ORIGINAL DRAWINGS 0 1"

SCALE:
NTS

FILE NO. **9449.2**

SHEET **19** OF **19**