

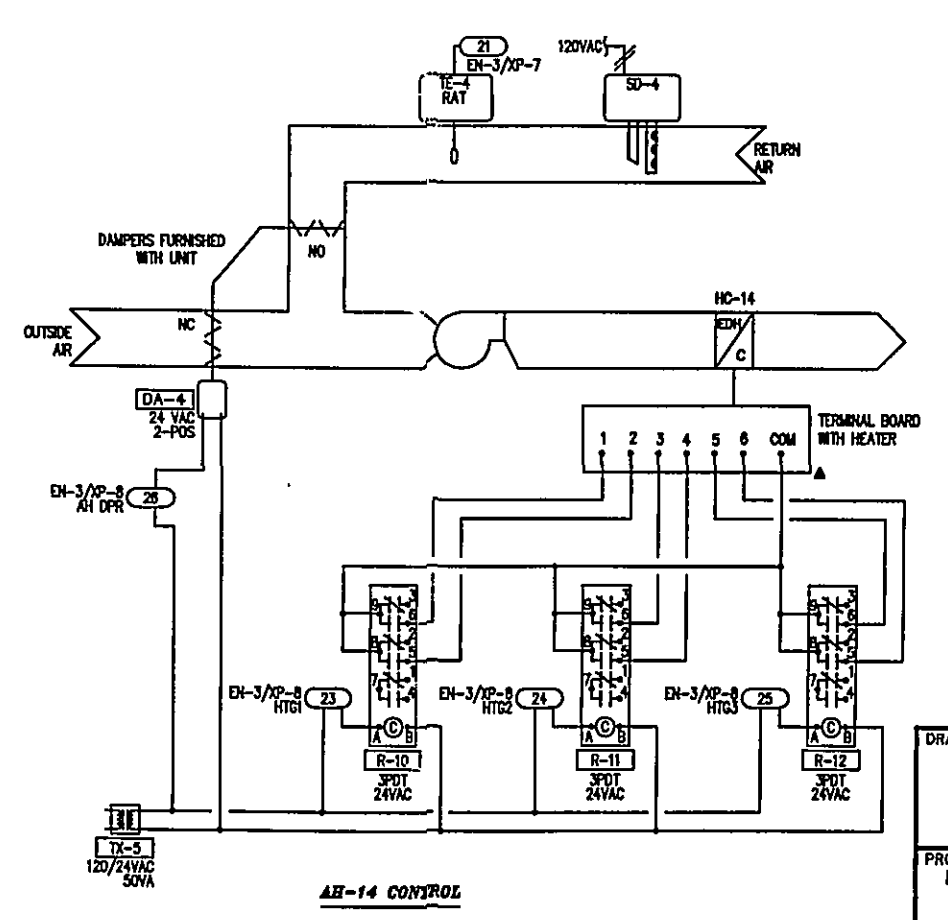
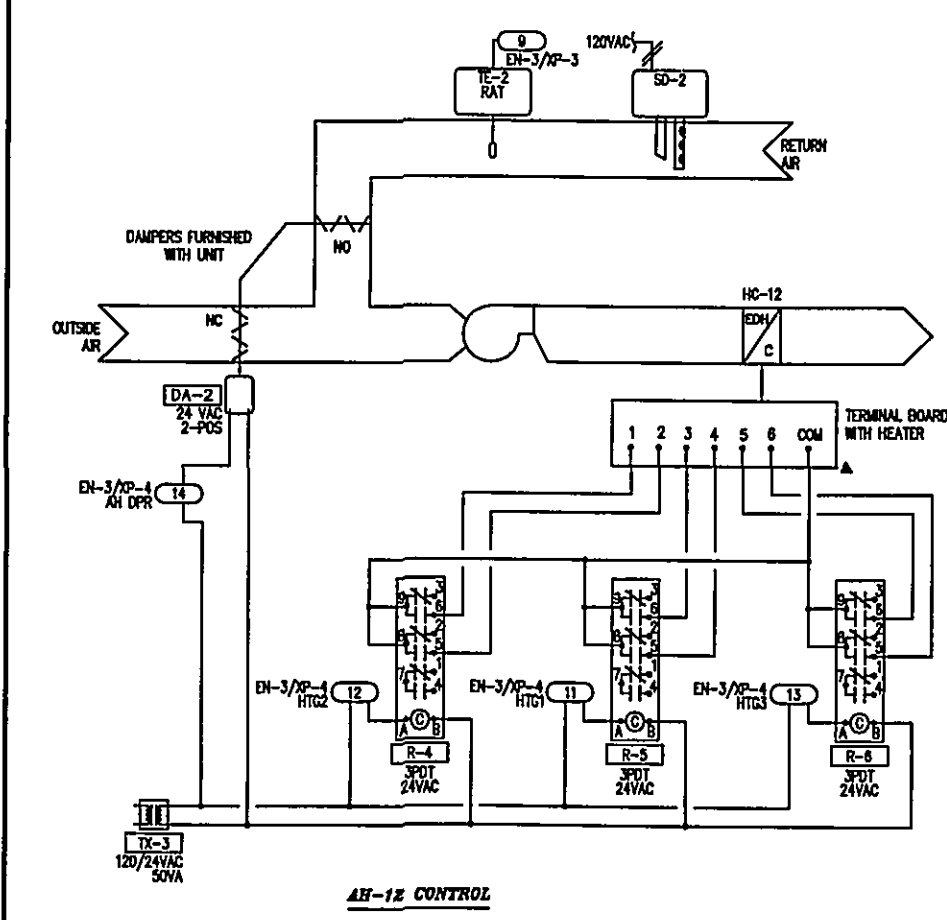
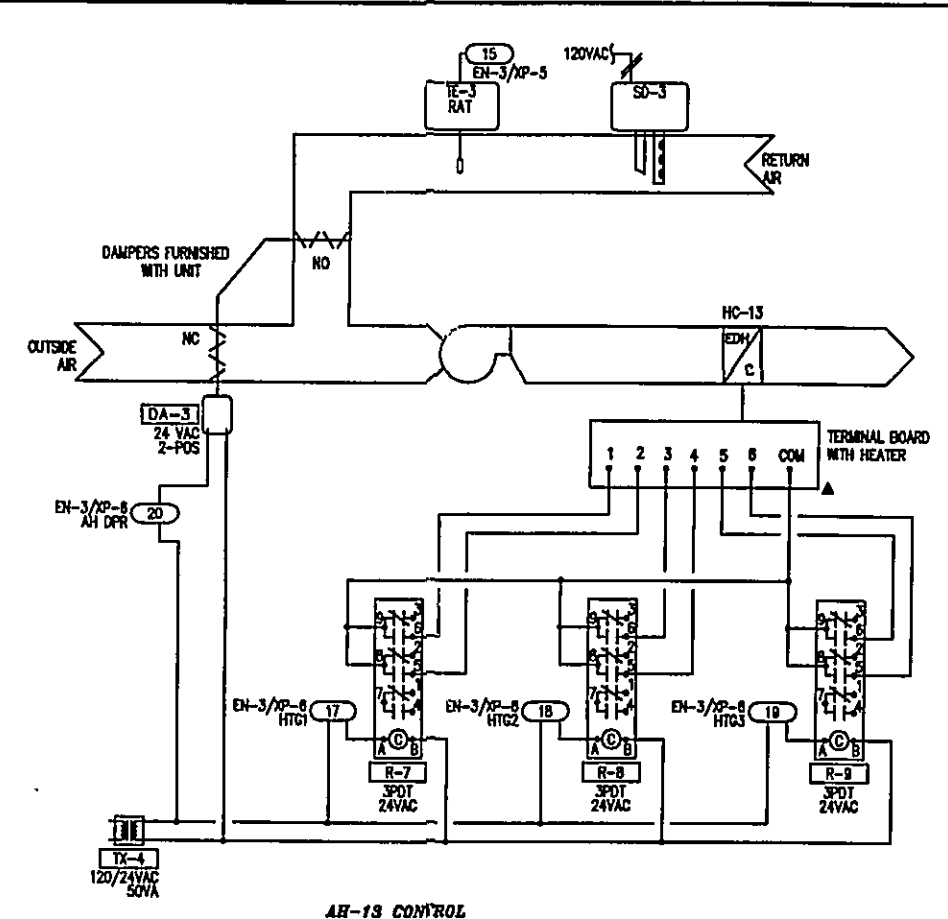


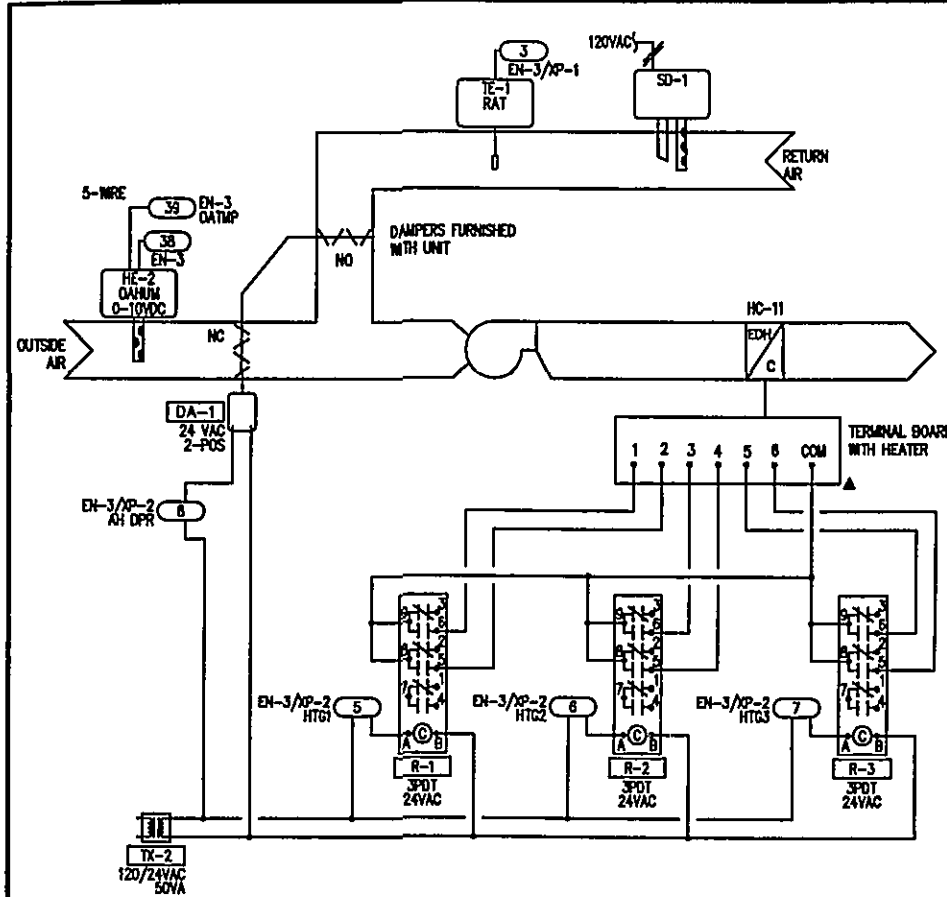

FIELD MATERIAL

DEVICE TAG	QTY	CODE NUMBER	DESCRIPTION
DA-1-DA-4	4	AF24	ELEC ACTUATOR-BELIND
HE-1	1	HE-6310-2	TRANS RH/TEMP/VALL 0/100%
HE-2	1	HE-1810-9600	VALL HTG BOX KIT
R-1, R-4, R-7, R-10	4	PD-109-21	TRANS RH/TEMP/DUCT 0/100% RELAY, PLUG IN 3PDT
R-2-R-3, R-5-R-6, R-8-R-9, R-11-R-13	8	BZ-1010-11	UTILITY ENCLOSURE
SD-1-SD-4	4	PD-101-35	RELAY SOCKET, 11PIN BLADE
SP-1-SP-4	4	PD-101-35	RELAY SOCKET, 11PIN BLADE
TE-1-TE-4	4	DH400ACDC1	DUCT DETECTOR, 10M, SAMPLING TUBE FOR
TX-2-TX-5	4	ST-5	TEMP SENSOR, 1000 OHM, NI TRANSFORMER
	4	TE-6311P-1	
	4	Y63AJJ-1C	

BAY	TERM	CONDUIT	DEVICE	SYSTEM	OBJECT	EXPANDED ID	REFERENCE DETAIL
CONTROLLER: EN-3							
AI	A11		HE-1	AH	SPHUM	SPACE HUMIDITY	L-HE-63x0-3TWIST
AI	A12		HE-1	AH	SPHUM	SPACE TEMPERATURE	L-RTD-2TWIST
AI	A13		HE-2	AH	DAHUM	OUTSIDE HUMIDITY	L-HE-63x0-3TWIST
AI	A14		HE-2	AH	DAHUM	OUTSIDE TEMPERATURE	L-RTD-2TWIST
CONTROLLER: EN-3/XP-1							
AI	A11		TE-1	AH	RAT	RETURN AIR TEMP	L-XP9102
BO	B01		R-13	AH	AHS/S	AH-11 START/STOP	L-XP9103
BO	B02		R-1	AH	HTG1	HEATING 1	L-XP9103
BO	B03		R-2	AH	HTG2	HEATING 2	L-XP9103
BO	B04		R-3	AH	HTG3	HEATING 3	L-XP9103
BO	B05		DA-1	AH	AH DPR	AH-11 DAMPER	L-XP9103
CONTROLLER: EN-3/XP-2							
AI	A11		TE-2	AH	RAT	RETURN AIR TEMP	L-XP9102
BO	B01		R-14	AH	AHS/S	AH-12 START/STOP	L-XP9103
BO	B02		R-4	AH	HTG1	HEATING 1	L-XP9103
BO	B03		R-5	AH	HTG2	HEATING 2	L-XP9103
BO	B04		R-6	AH	HTG3	HEATING 3	L-XP9103
BO	B05		DA-2	AH	AH DPR	AH-12 DAMPER	L-XP9103
CONTROLLER: EN-3/XP-3							
AI	A11		TE-3	AH	RAT	RETURN AIR TEMP	L-XP9102
BO	B01		R-15	AH	AHS/S	AH-13 START/STOP	L-XP9103
BO	B02		R-7	AH	HTG1	HEATING 1	L-XP9103
BO	B03		R-8	AH	HTG2	HEATING 2	L-XP9103
BO	B04		R-9	AH	HTG3	HEATING 3	L-XP9103
BO	B05		DA-3	AH	AH DPR	AH-13 DAMPER	L-XP9103
CONTROLLER: EN-3/XP-4							
AI	A11		TE-4	AH	RAT	RETURN AIR TEMP	L-XP9102
BO	B01		R-16	AH	AHS/S	AH-14 START/STOP	L-XP9103
BO	B02		R-10	AH	HTG1	HEATING 1	L-XP9103
BO	B03		R-11	AH	HTG2	HEATING 2	L-XP9103
BO	B04		R-12	AH	HTG3	HEATING 3	L-XP9103
BO	B05		DA-4	AH	AH DPR	AH-14 DAMPER	L-XP9103

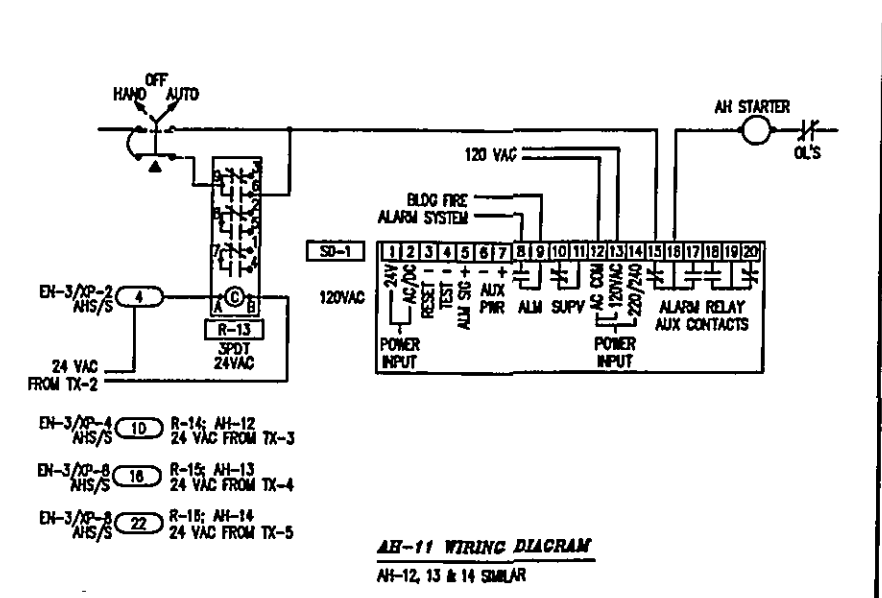

▲ ITEMS NOT FURNISHED BY JCI

DRAWING TITLE AH-11, 12, 13 & 14 CONTROL TREATMENT BUILDING		GEN REV		DATE 1 BY	
PROJECT ROANOKE COUNTY WATER TREATMENT FACILITY		SALES ENGINEER RC		DATE 1 BY	
JOHNSON CONTROLS Systems & Services Division		JOHNSON CONTROLS INC 2630 BROADWAY S.W. ROANOKE, VA 24014 703-344-8291		CONTRACT NUMBER 95066-0013 DRAWING NUMBER 5 OF 14	