


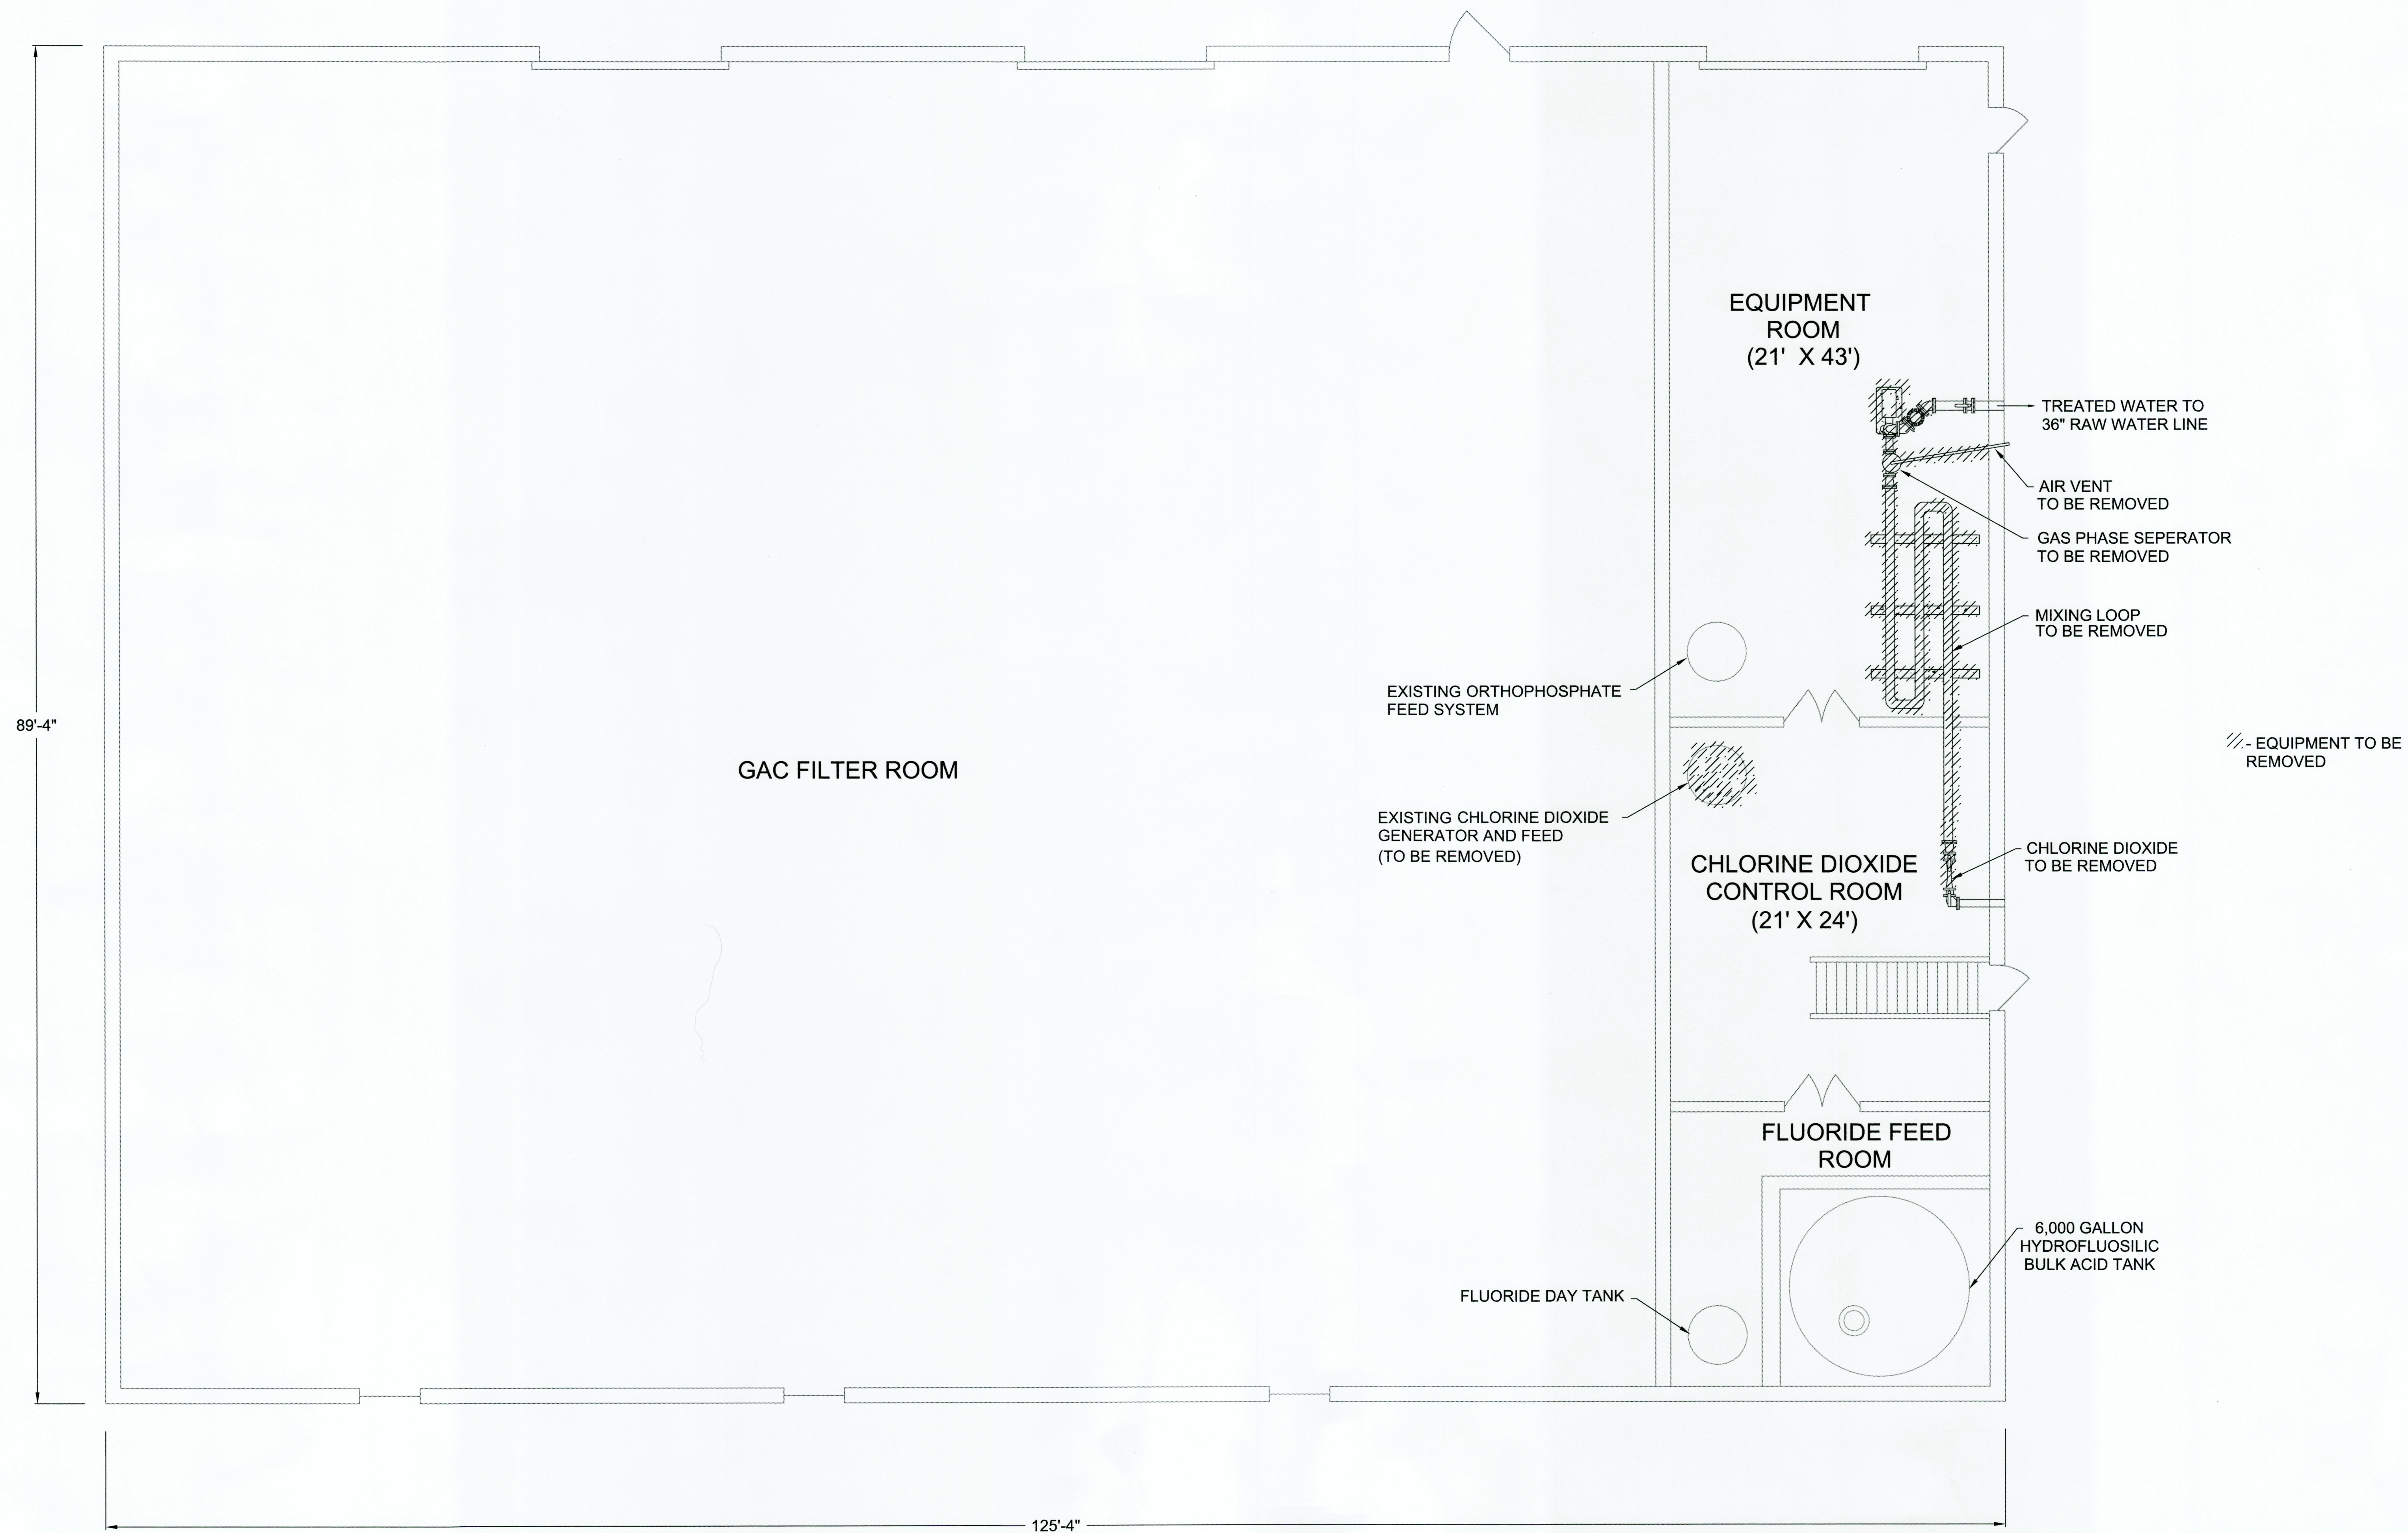

GAC BUILDING DEMO PLAN

EQUIPMENT
ROOM
(21' X 43')

FLUORIDE FEED
ROOM

→ TREATED WATER TO
36" RAW WATER LINE

6,000 GALLON
HYDROFLUOSILIC
BULK ACID TANK