

Note: old line is/was on north of new line - not as indicated on this sheet.


DATE STARTED	8-15-91			
DATE COMP.	9-6-91			
FEET MAIN	SIZE	VALVE	VAULT	BOX
414'	6"	1	1	
F. H. COMP.	1	4 1/2"	6"	1
F. H. STUB ONLY	0			
SERV. INS. BY:	C.O. DAME			
NO. 3/4" SERV. INS.	CITY			
DEPT. INSP.	U.L.S.			

INSTALL 6" TAPPING SLEEVE & VALVE.

INSTALL FIRE HYDRANT

MAINS TO BE ABANDONED - 1/2", 3/4", 1/2"
2/20/92 BY E. GUNTER W.O. #0605
110' OF 1/2"
210' OF 3/4"

NOTE: ALL UTILITIES SHALL BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION.

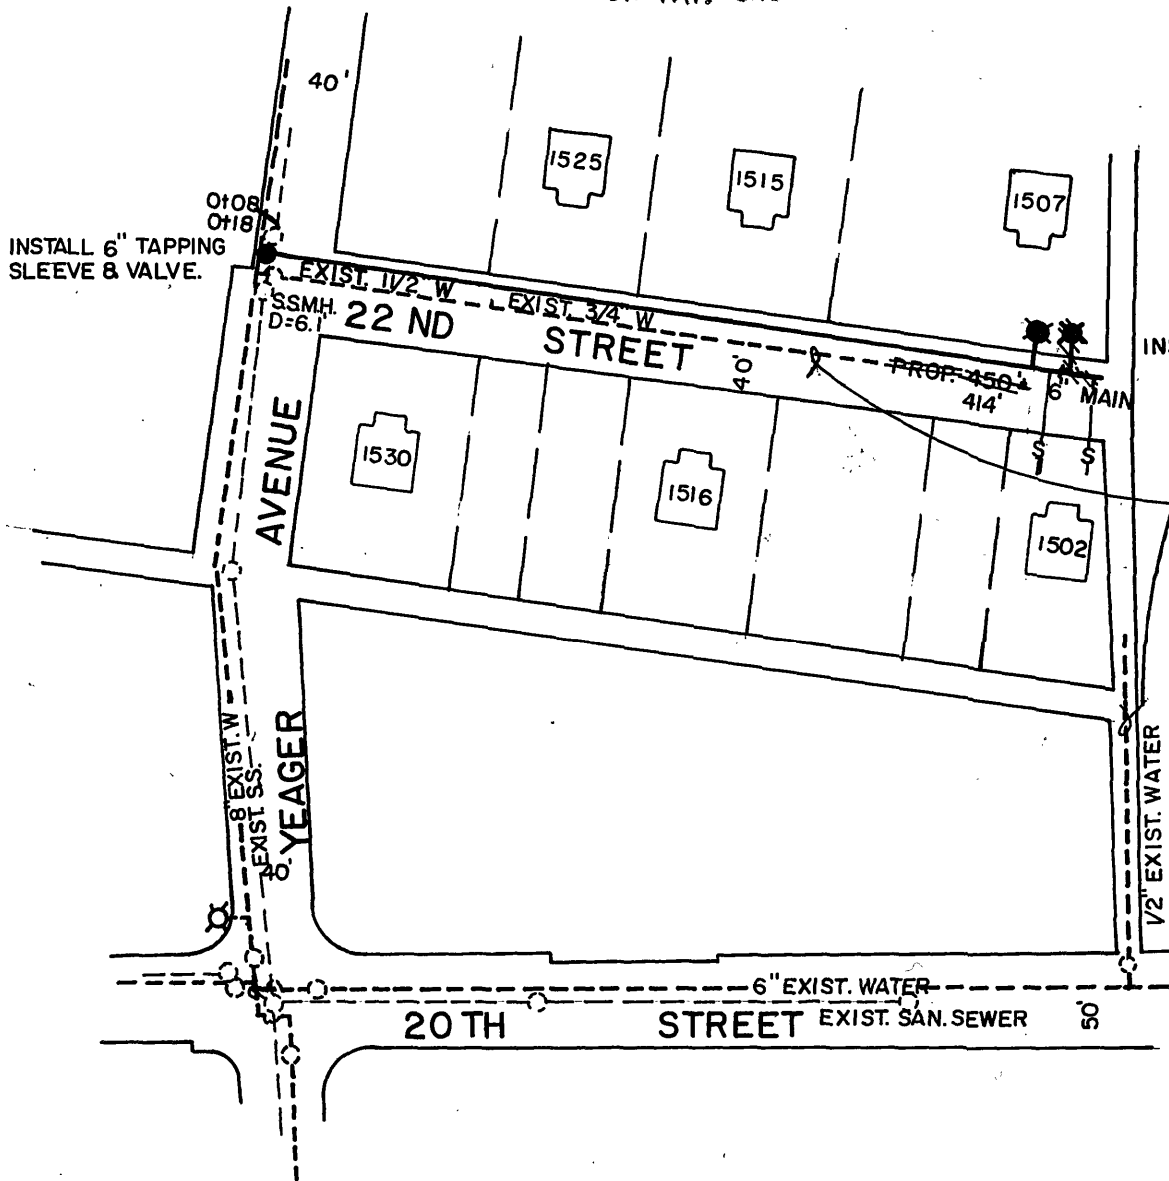

WATER DEPARTMENT
ROANOKE VIRGINIA

22 ND STREET; N.E.
(YEAGER - EASTERLY TO ALLEY)

SCALE: 1"=100'
DATE: 8/9/91
DIST. MAP: 334
PLAN NO.: 91-06

Replacement
M. Craig 8/5/91
DIRECTOR UTILITIES & OPERATIONS DATE
Mgr. Water Dept
DIRECTOR OF PUBLIC WORKS DATE

[Signature]
MANAGER UTILITY LINE SERVICES