




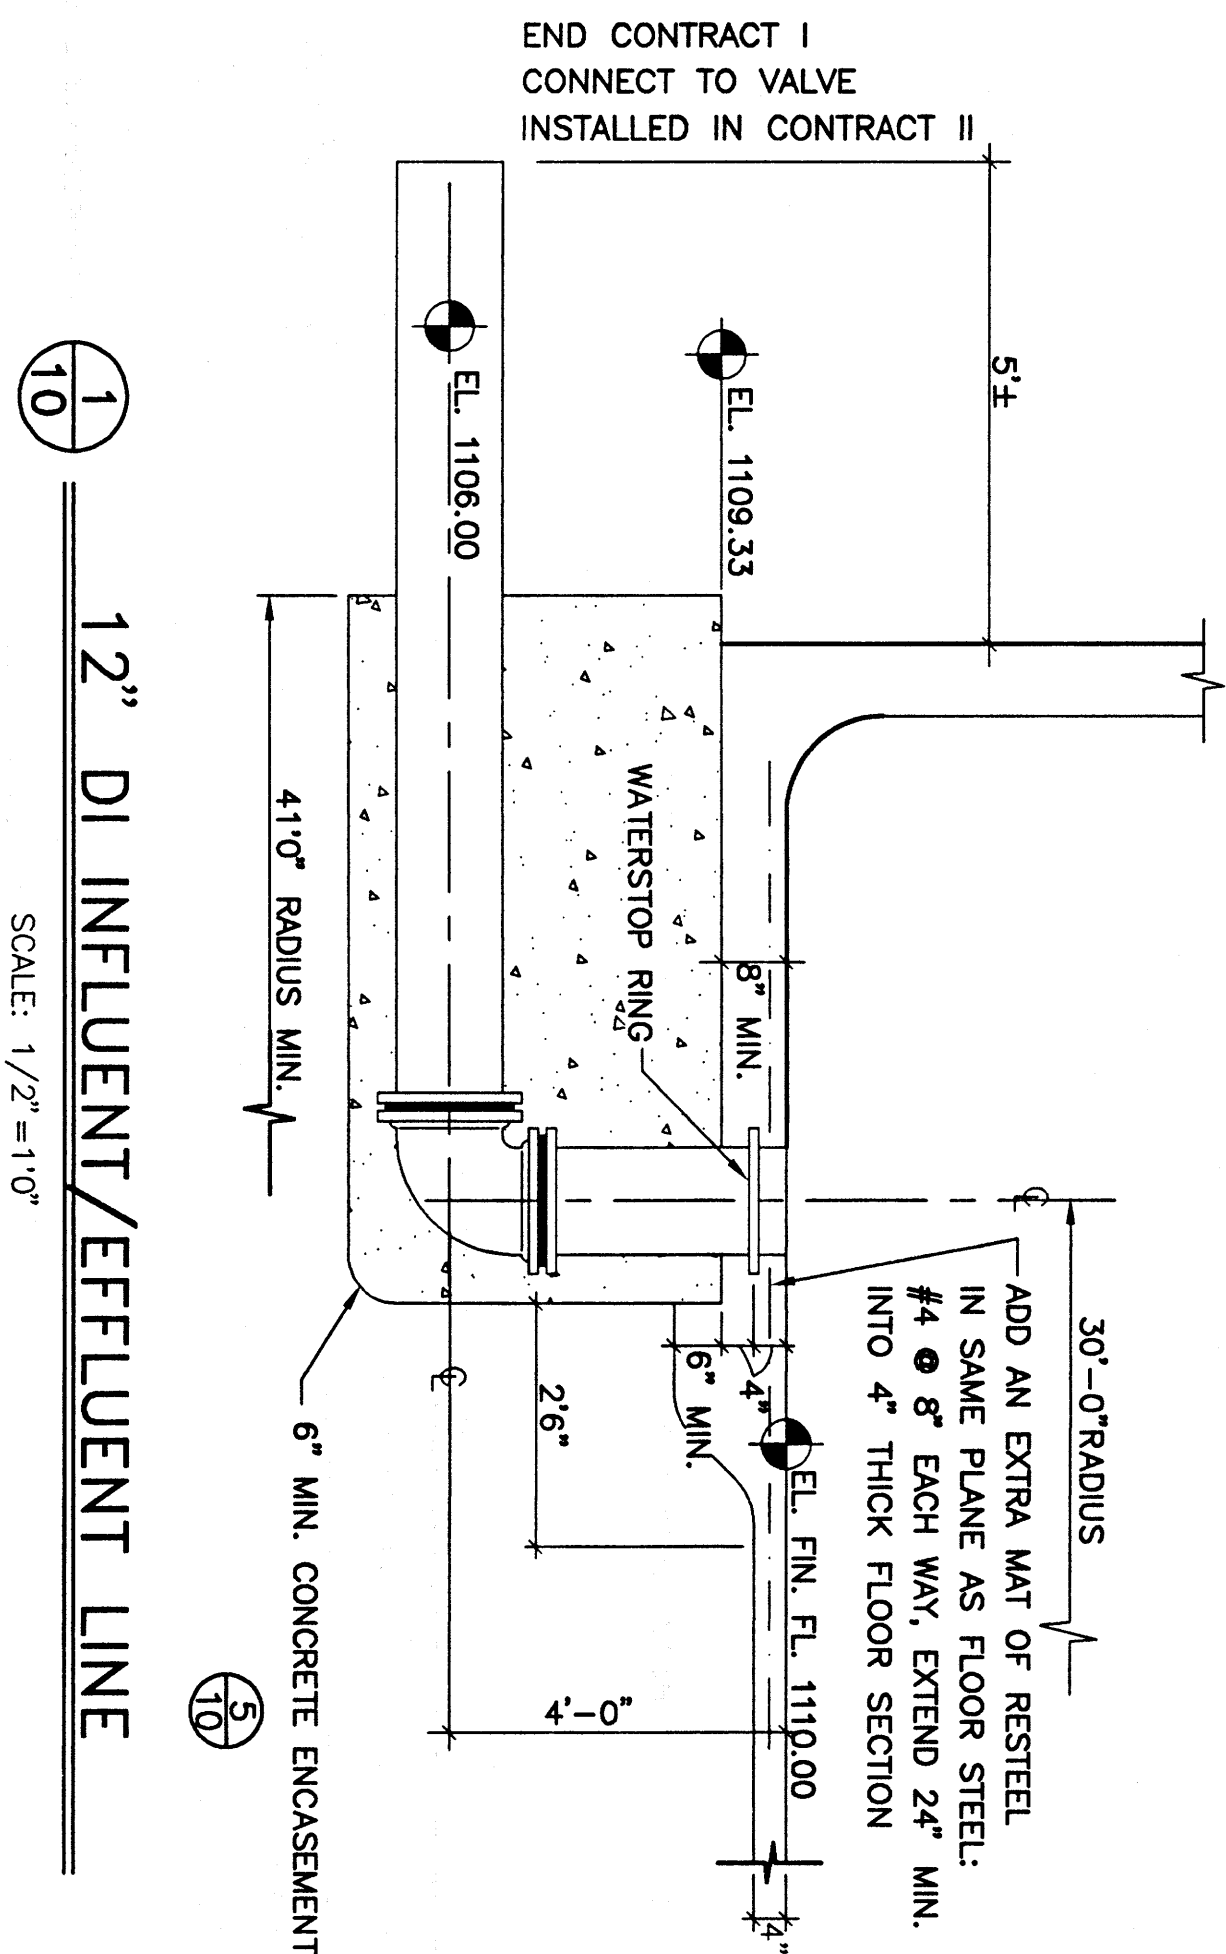


1 10 12" DI INFLUENT/EFFLUENT LINE
SCALE: 1/2"=1'-0"

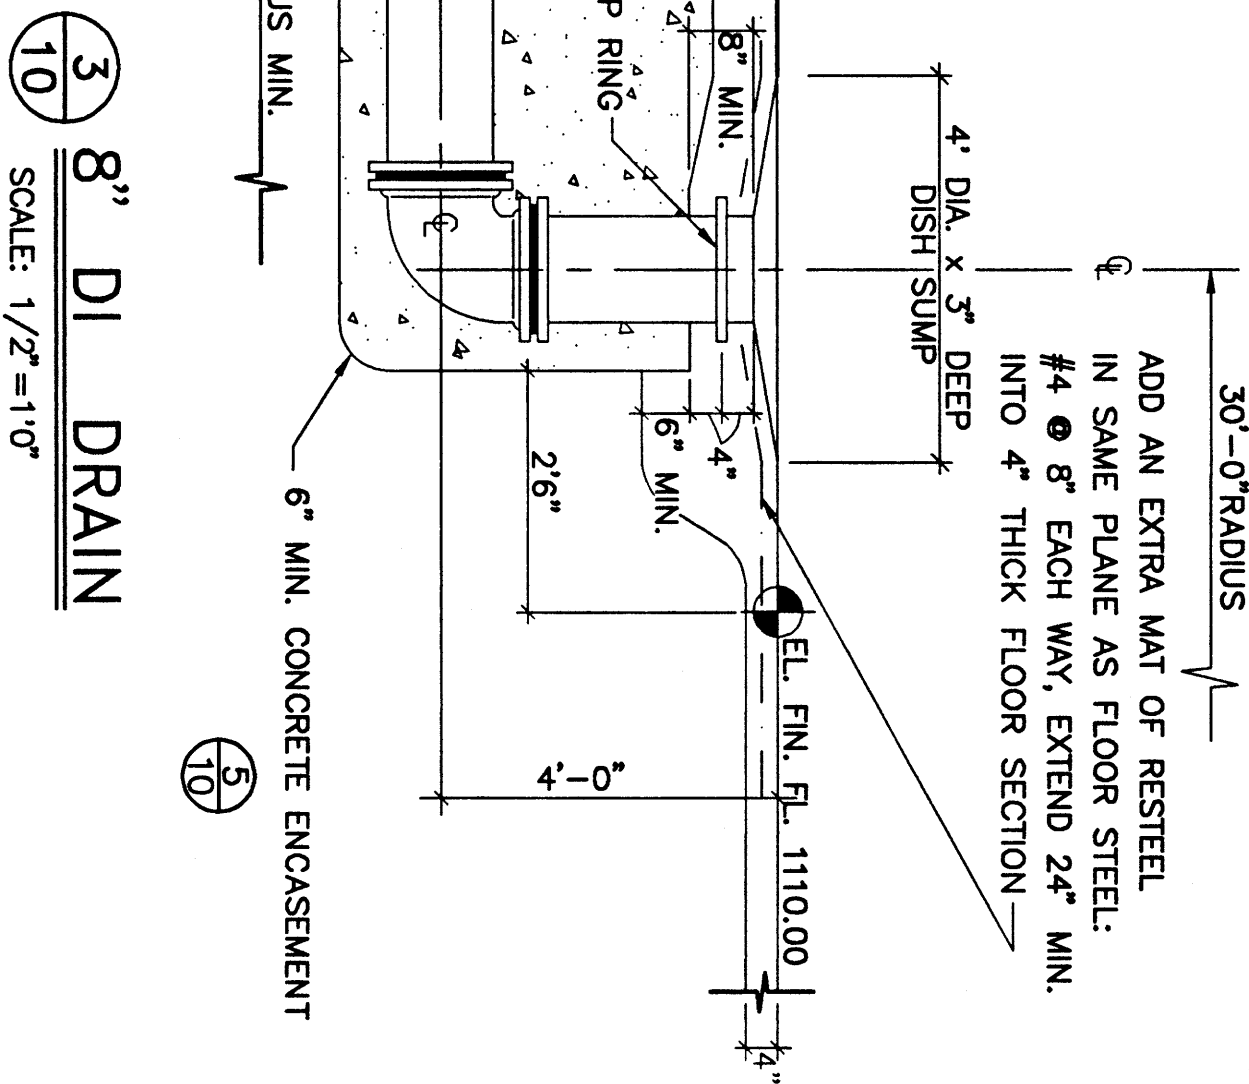


3 10 8" DI DRAIN
SCALE: 1/2"=1'-0"

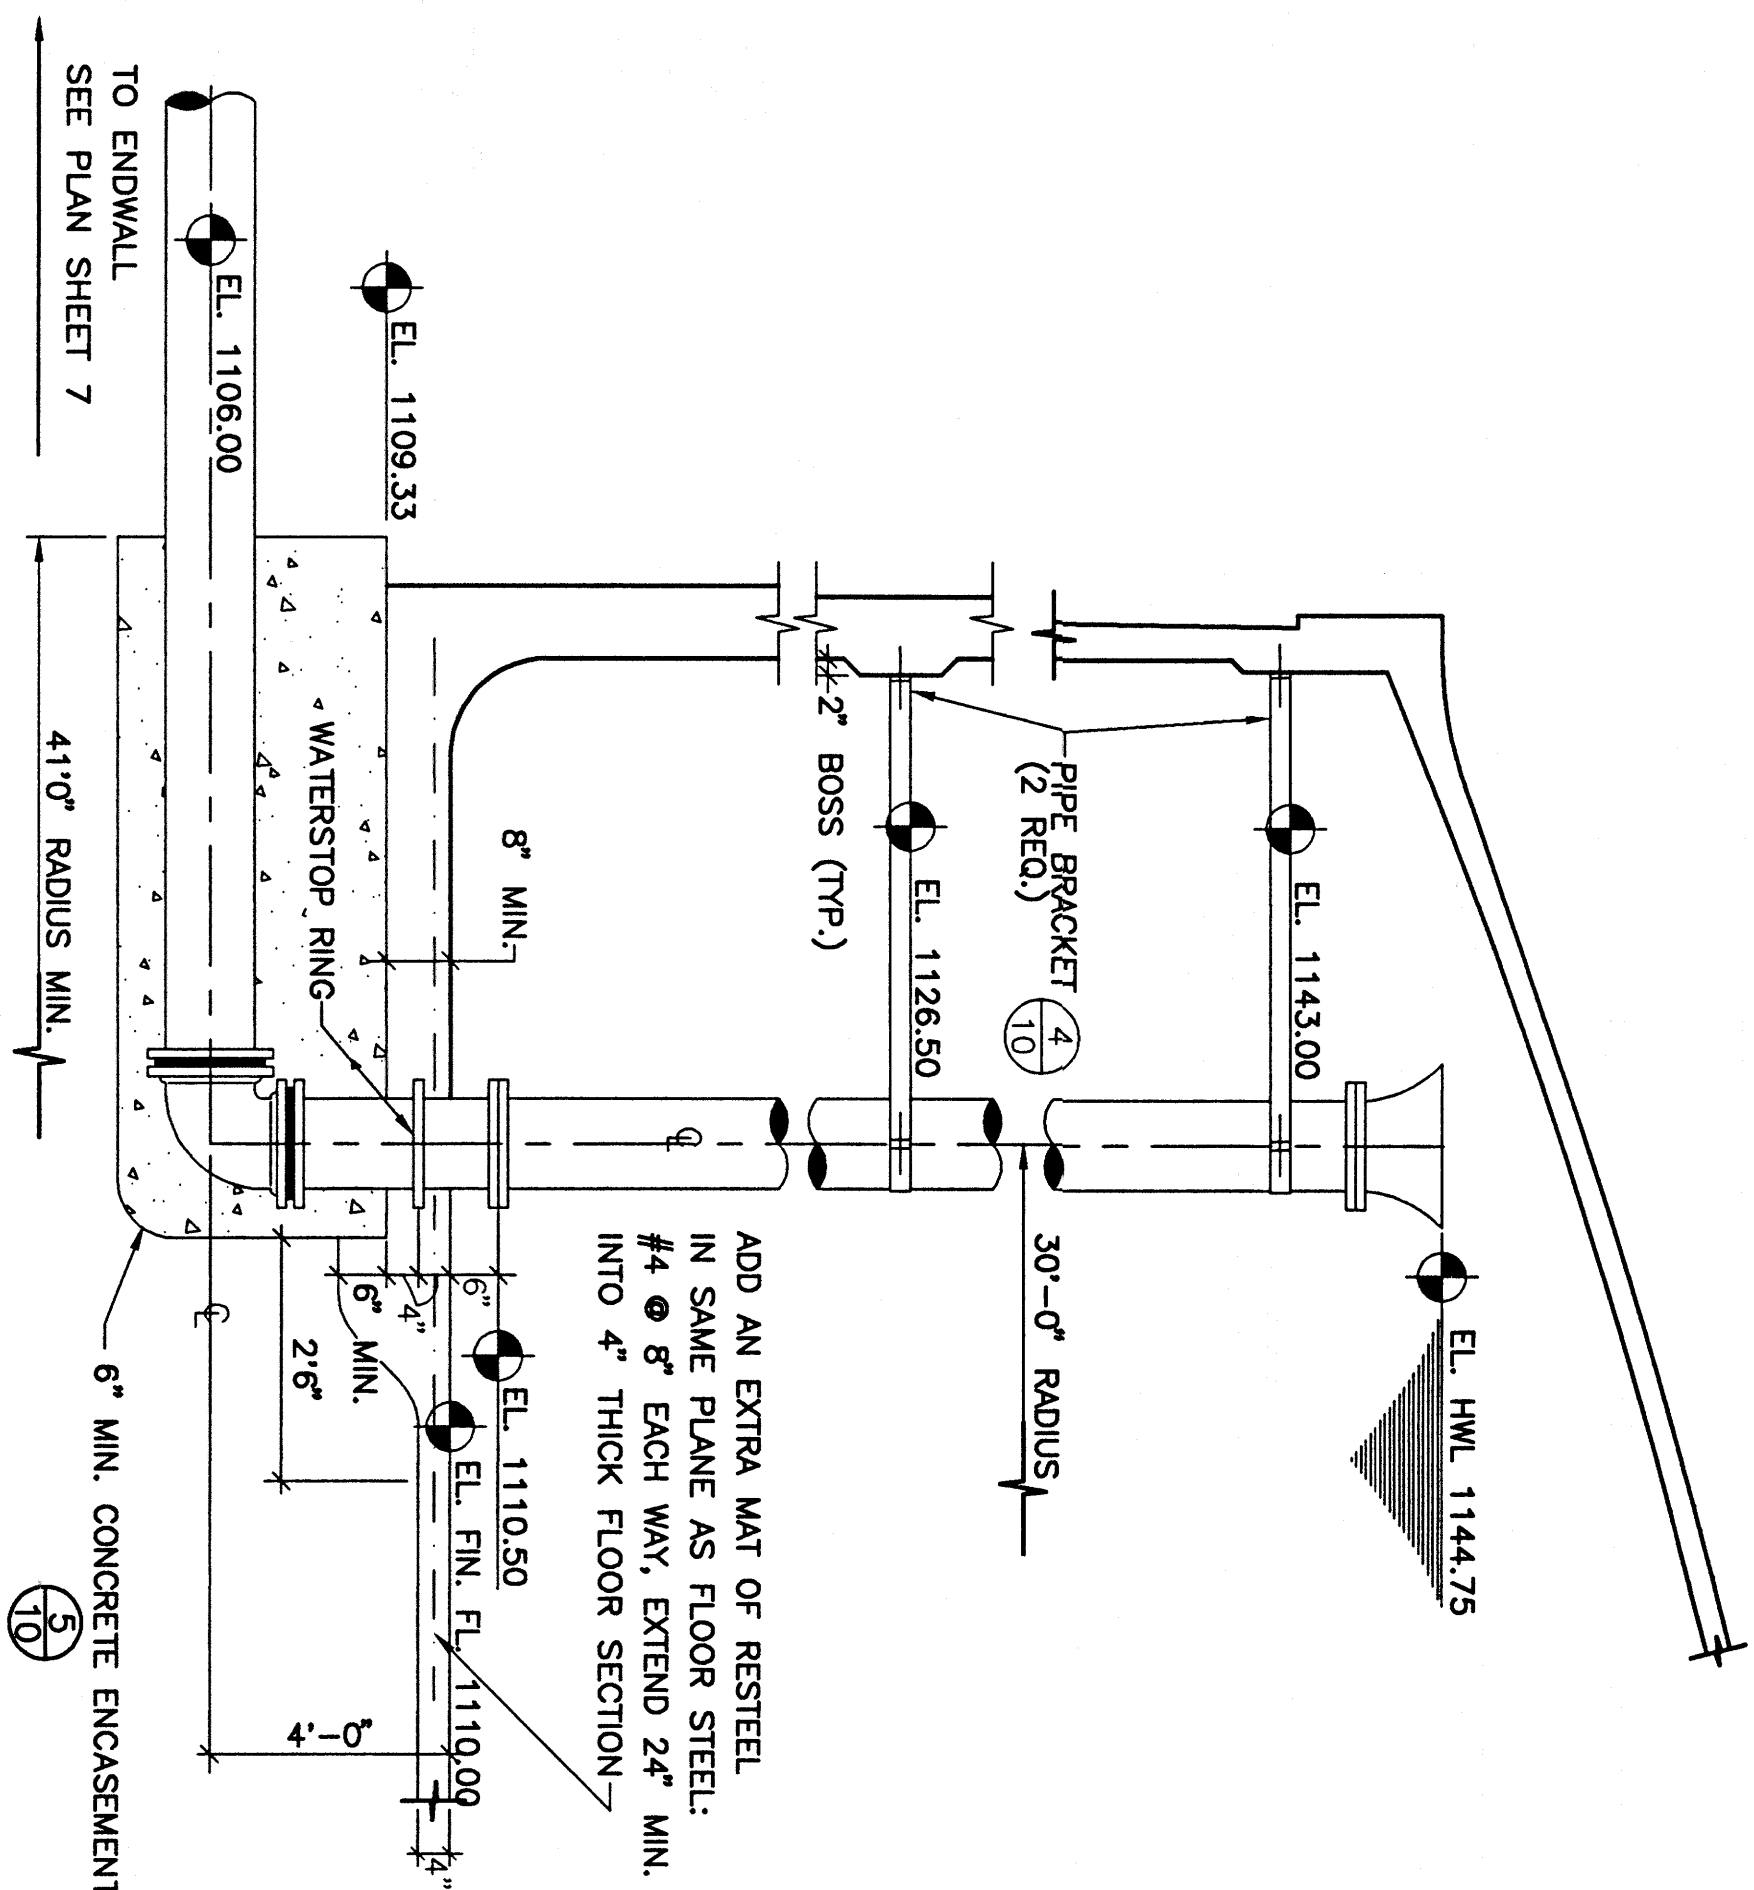


2 10 12" DI OVERFLOW
SCALE: 1/2"=1'-0"

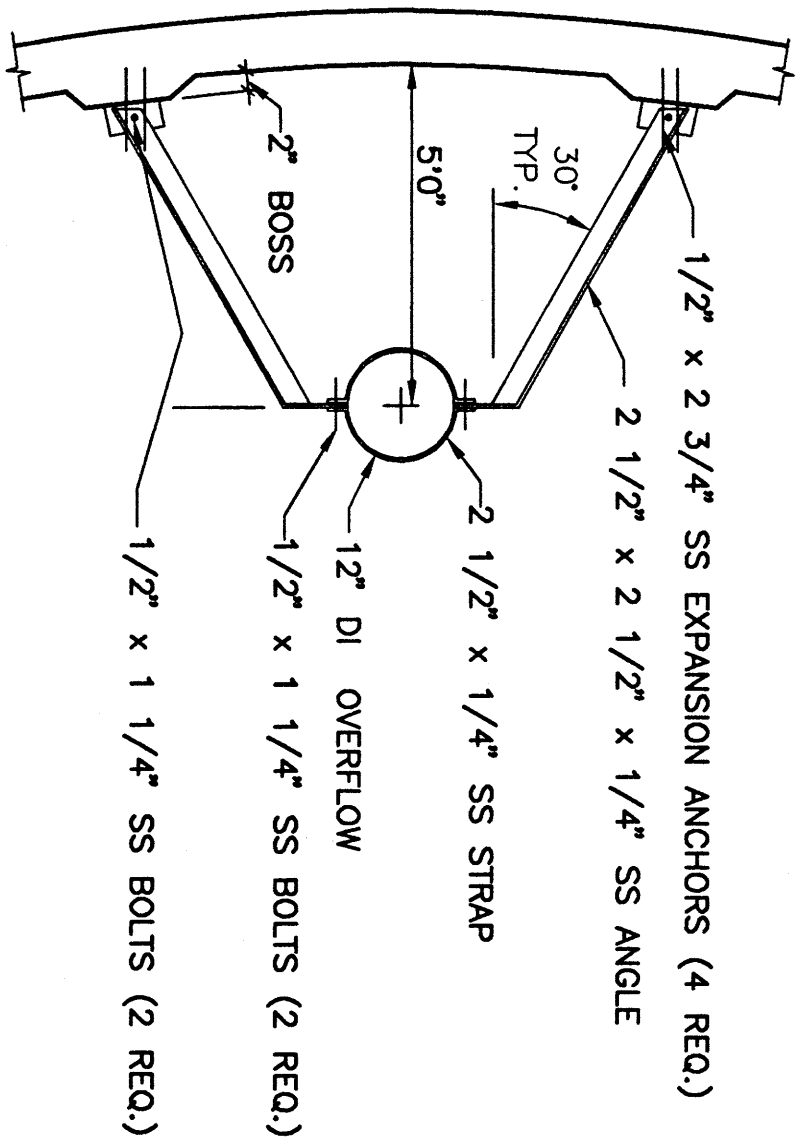

4 10 PIPE BRACKET (2 REQ.)
NTS

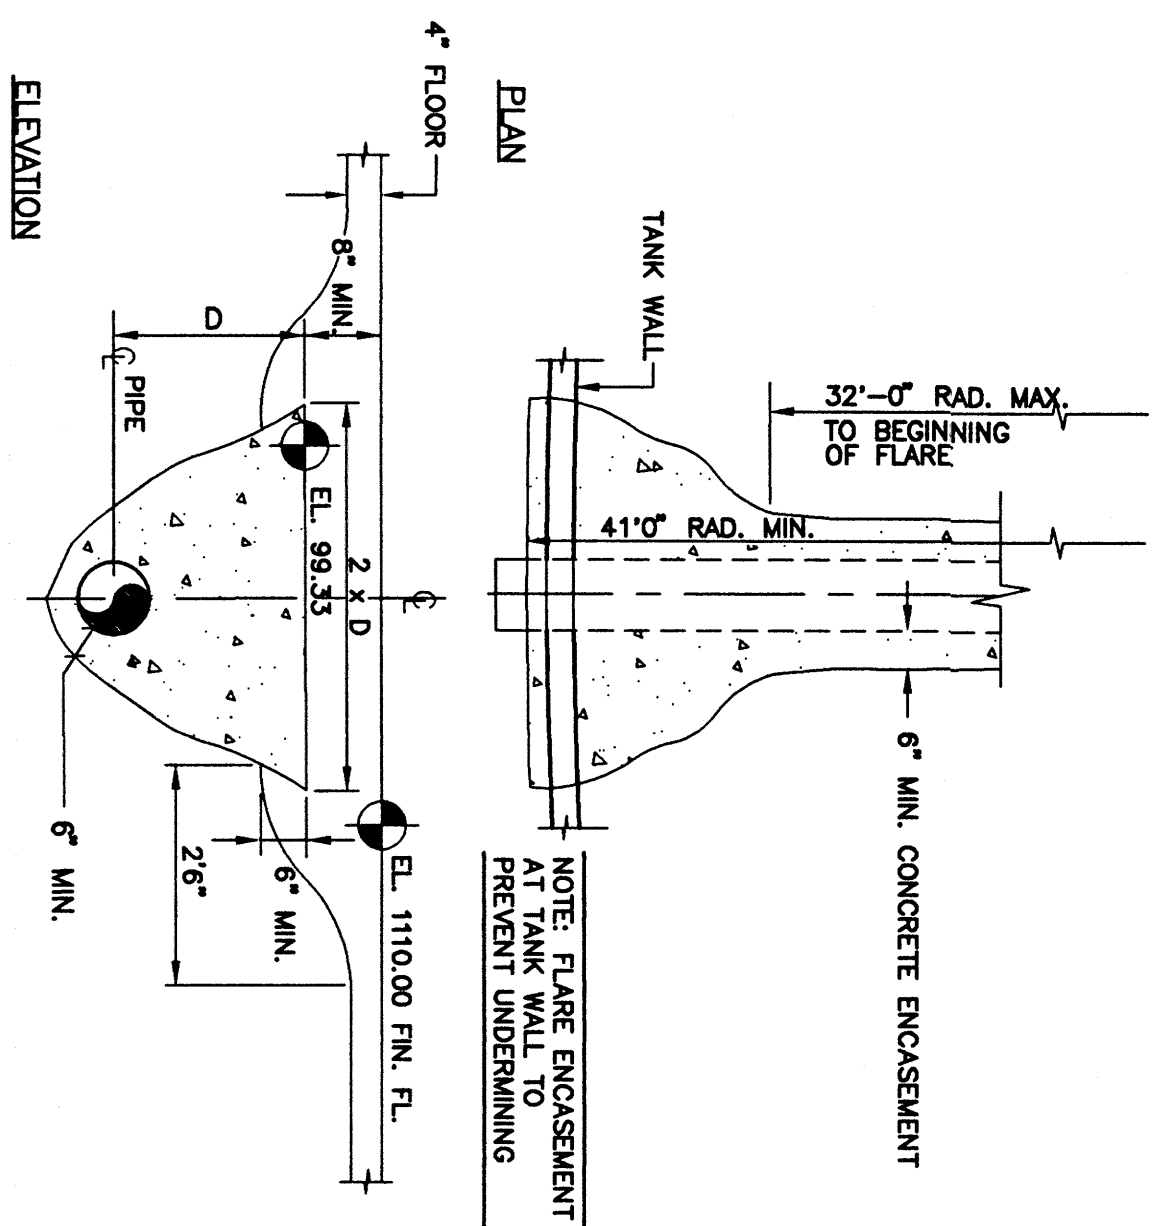

5 10 TYPICAL PIPE ENCASEMENT AT WALL
NTS

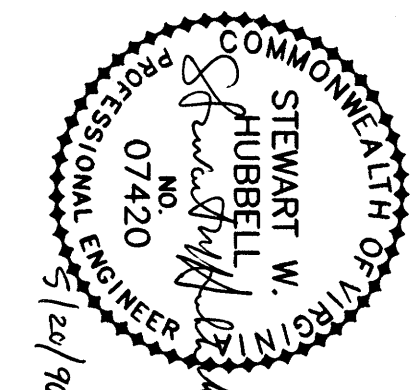

REV	DATE	DESCRIPTION	BY	APP
1		THIRD STREET WATER TANK AND WATER MAIN PROJECTS		
2				
3				
4				
5				
6				
7				
8				
9				
10				

Matern & Craig
 CONSULTING ENGINEERS • ARCHITECTS
 1000 N. 10TH ST. SUITE 100
 FARMERSVILLE, VIRGINIA 22434
 541-4444 FAX

SCALE: AS SHOWN
 DATE: MAY, 1996
 SHEET 10

COMM.
 NO. 1485B