


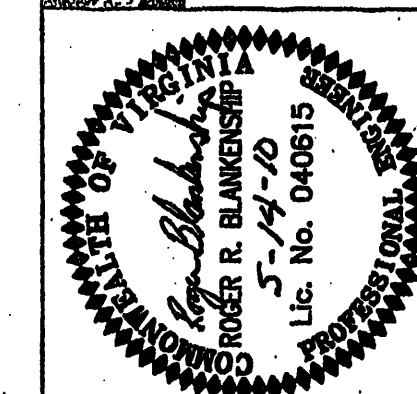

BELLE HAVEN WATERLINE
CIVIL/SITE WORK
PLAN

Rev	Description	Date	By
1	REVISED PER CO 5/14/10		
2			
3			
4			
5			
6			
7			
8			
9			
10			


Designed: AAS
 Drawn: AAS
 Checked: RRB
 Approved:
 Date: 4/23/10
 Project:

Sheet 3 of 5

FH tee to FH 19.5'
 FH tee to ARV 214.5'
 FH tee to 45° bend 379.0'
 FH tee to sleeve 527.5'
 FH tee to tie-in 649.0'
 on existing line
 off Buckland Mill Rd.
 (open-cut, C900 portion
 of project)

Valve on Buckland Mill 157.5'
 Rd. to sleeve

CONTRACTOR TO
 REMOVE PERMANENT
 BLOWOFF AND CONNECT
 PROPOSED LINE TO EXISTING LINE

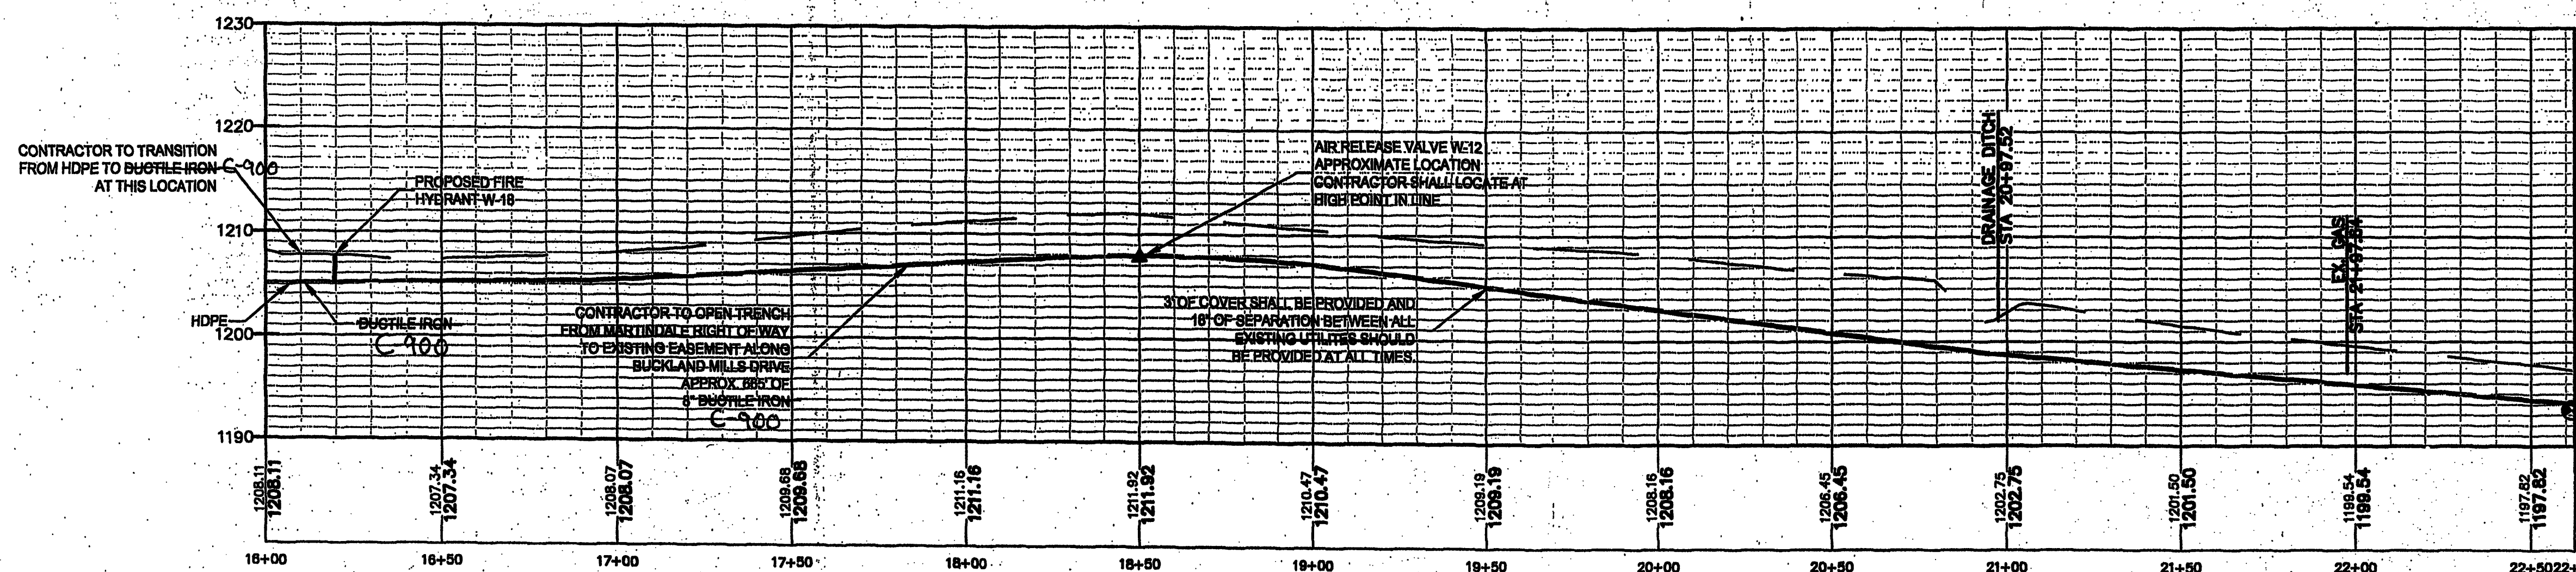

BELLE HAVEN WATER PROFILE
 SCALE
 VERTICAL: 1" = 10'
 HORIZONTAL: 1" = 30'

Note: All pipe from end of HOPE
 to 8" gate valve has bell restraints
 and megalugs, and from 8"x8" Tee
 to the 8"x6" Tee.

Also, 8" gate valve has rods and megalugs to 8"x8" Tee.
 8" gate valve has 8" C-900 stub with bell end 4-ft.
 from center of valve for future line connection.

