


WORK BY OTHERS:

1. MOVE 100 HP PUMP FROM WELL #4 TO WELL #3 & REINSTALL. INSTALL NEW PUMP IN WELL #4.
2. EX. PUMP IN WELL #3 TO BE REMOVED AND DELIVERED TO BOTETOURT COUNTY.

NOTE: EX. WELL #3 PITLESS UNIT MODEL NUMBER IS 3PS1012WBWE06T6

MODEL 3PS-1014WB-W-E16-F6*S FOR WELL #4 AS MANUFACTURED BY MONITOR DIVISION OF BAKER MANUFACTURING COMPANY OR APPROVED EQUAL

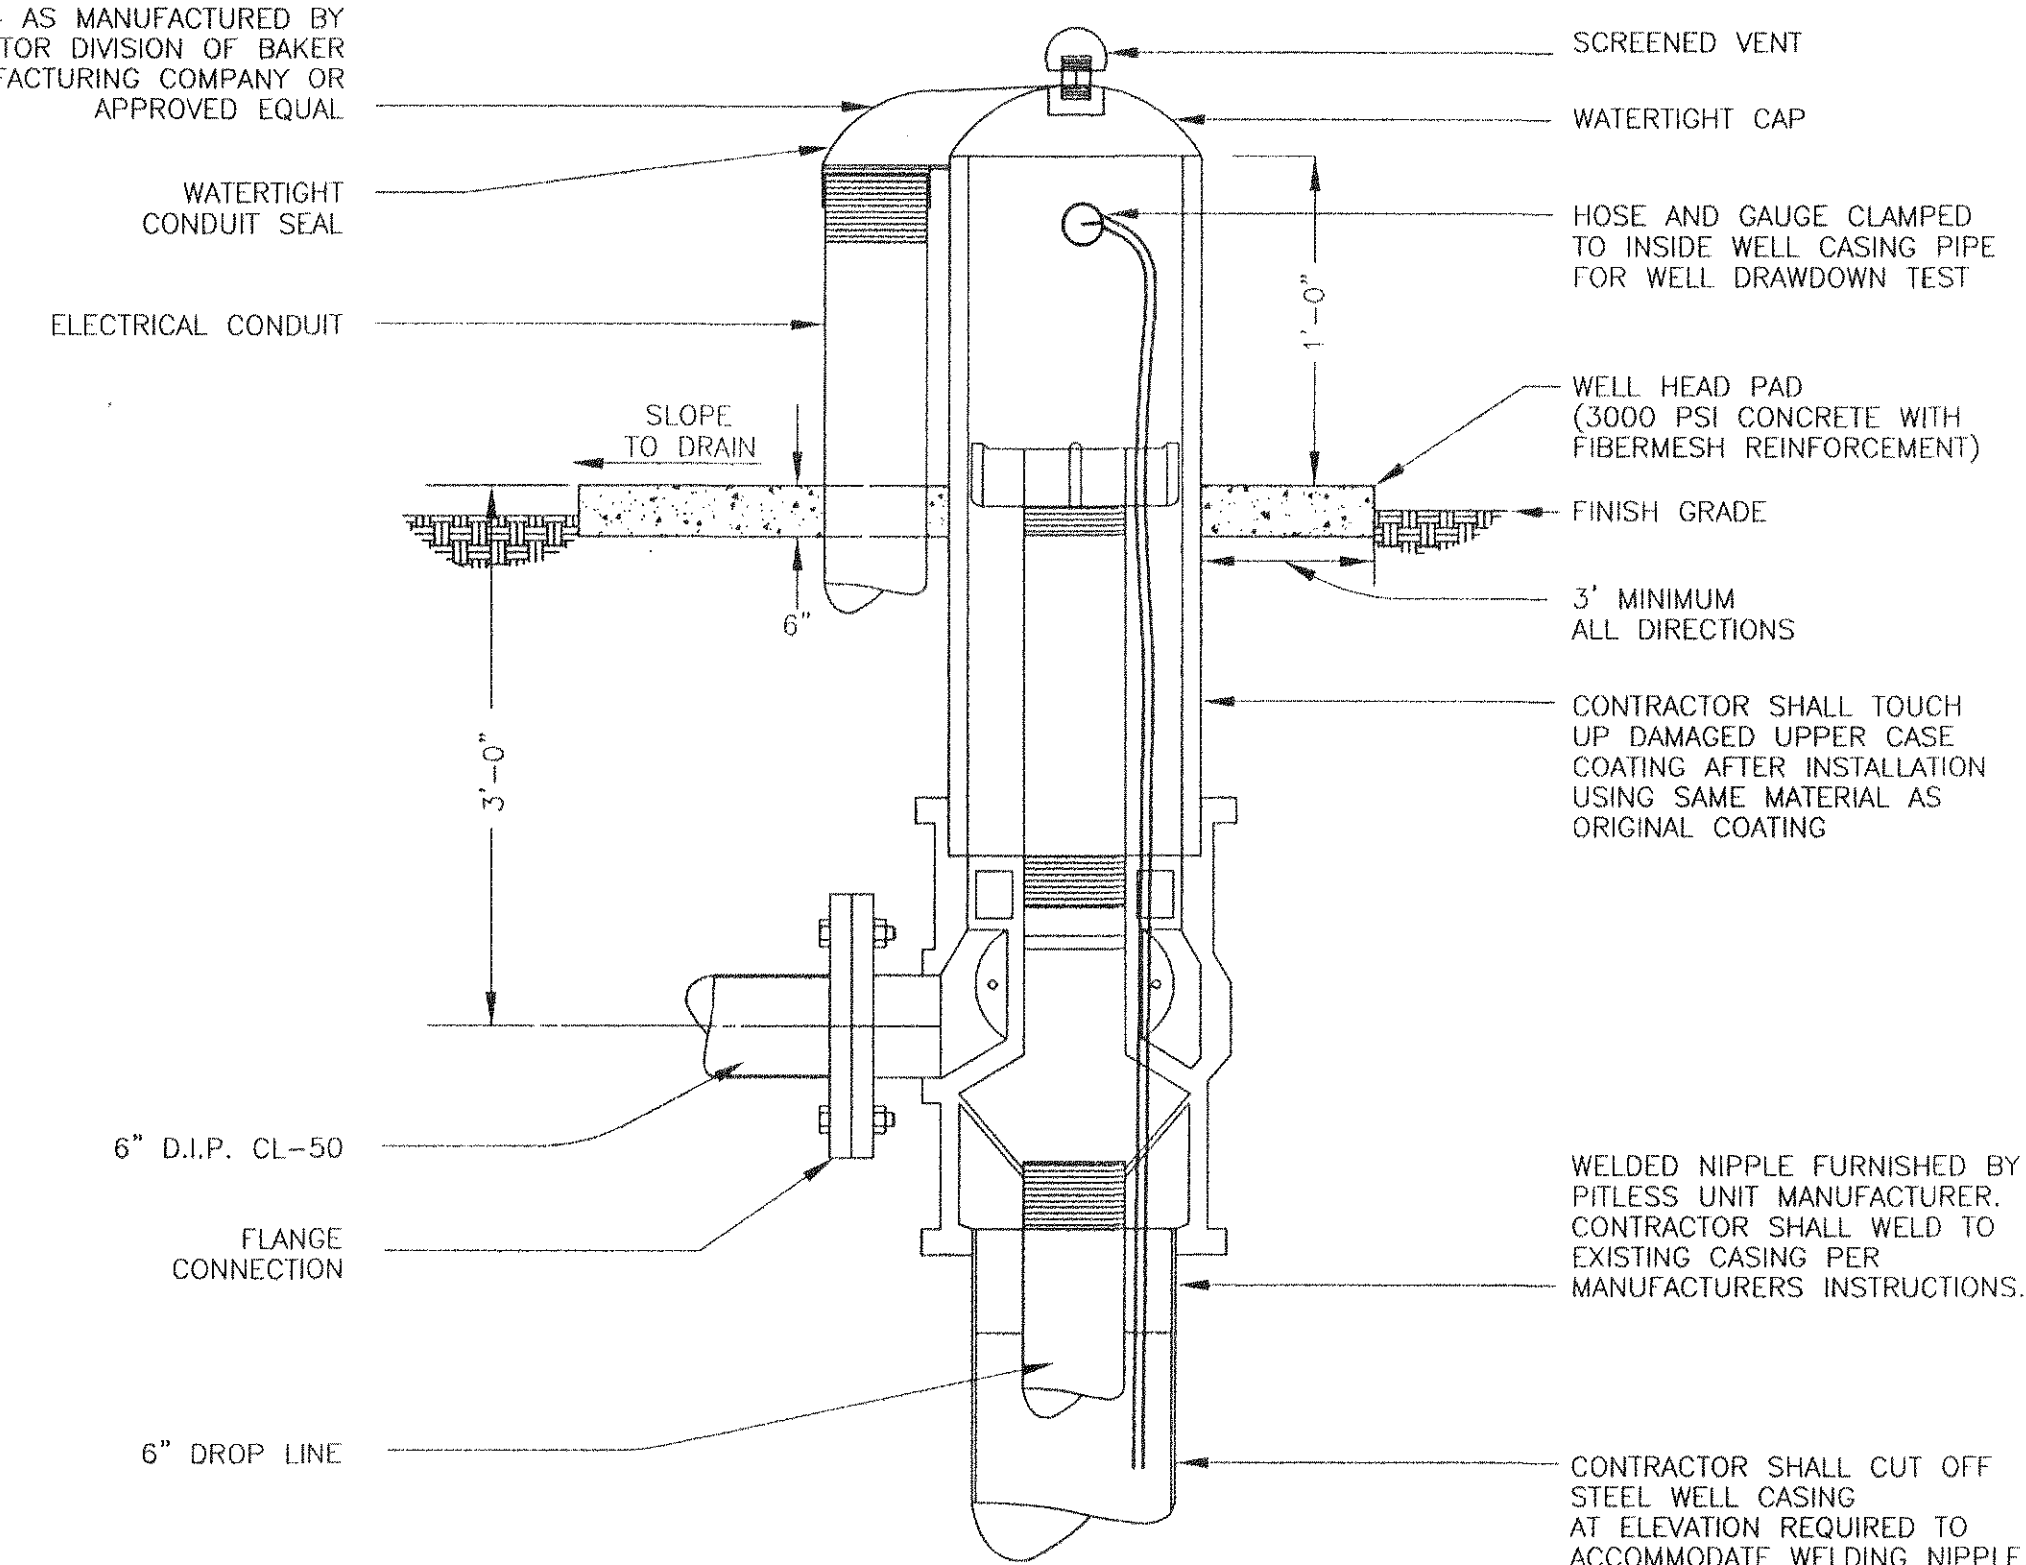

PITLESS UNIT

NOT TO SCALE
(BY OTHERS)

No.	Revision	By	Appd.	Date	Drawn	PSN
1	NOTE ADDED	PSN	JST	7-16-99	Designed	PSN
					Checked	JST
					Approved	JST