CONTRACTOR SHALL CONDUCT EXPLORATORY EXCAVATION OUTSIDE OF PAVEMENT TO CONFIRM LOCATION OF EXISTING 6-INCH WATERLINE. ALL MATERIALS AND EQUIPMENT NECESSARY FOR THE CONNECTION SHALL BE ON-SITE AND INSPECTED BY THE AUTHORITY'S CONSTRUCTION INSPECTOR BEFORE REQUESTING THE WET TAP.

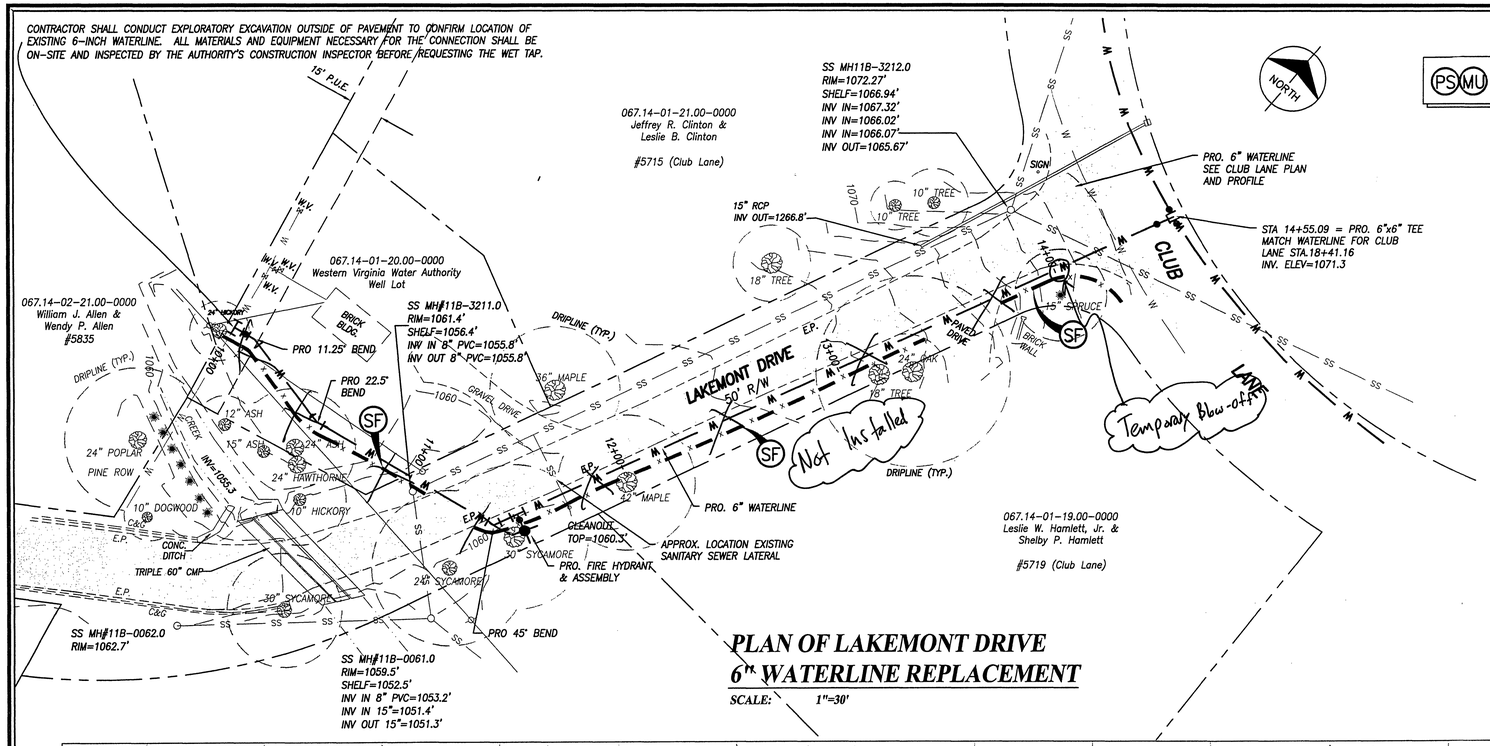

PS MU **NOTE:** ALL DISTURBED AREAS NOT TO RECEIVE HARDSCAPE MATERIAL SHALL BE SEEDED AND MULCHED IMMEDIATELY AFTER CONSTRUCTION.

EXISTING WATER METERS SHALL BE EXAMINED AND APPROVED FOR RE-INSTALLATION BY THE AUTHORITY. CONTRACTOR SHALL INSTALL APPROVED EXISTING METERS IN NEW WATER SERVICES. THE AUTHORITY'S CONSTRUCTION INSPECTOR SHALL BE PRESENT WHEN EXISTING METERS ARE TRANSFERRED TO NEW WATER SERVICES TO ENSURE EXISTING METER CONTINUES TO SERVE THE DESIGNATED CUSTOMER.

PLAN OF LAKEMONT DRIVE 6" WATERLINE REPLACEMENT

SCALE: 1"=30'

COMMONWEALTH OF VIRGINIA
MICHAEL W. LYNCH
Lic. No. 027276
10/21/09
PROFESSIONAL ENGINEER

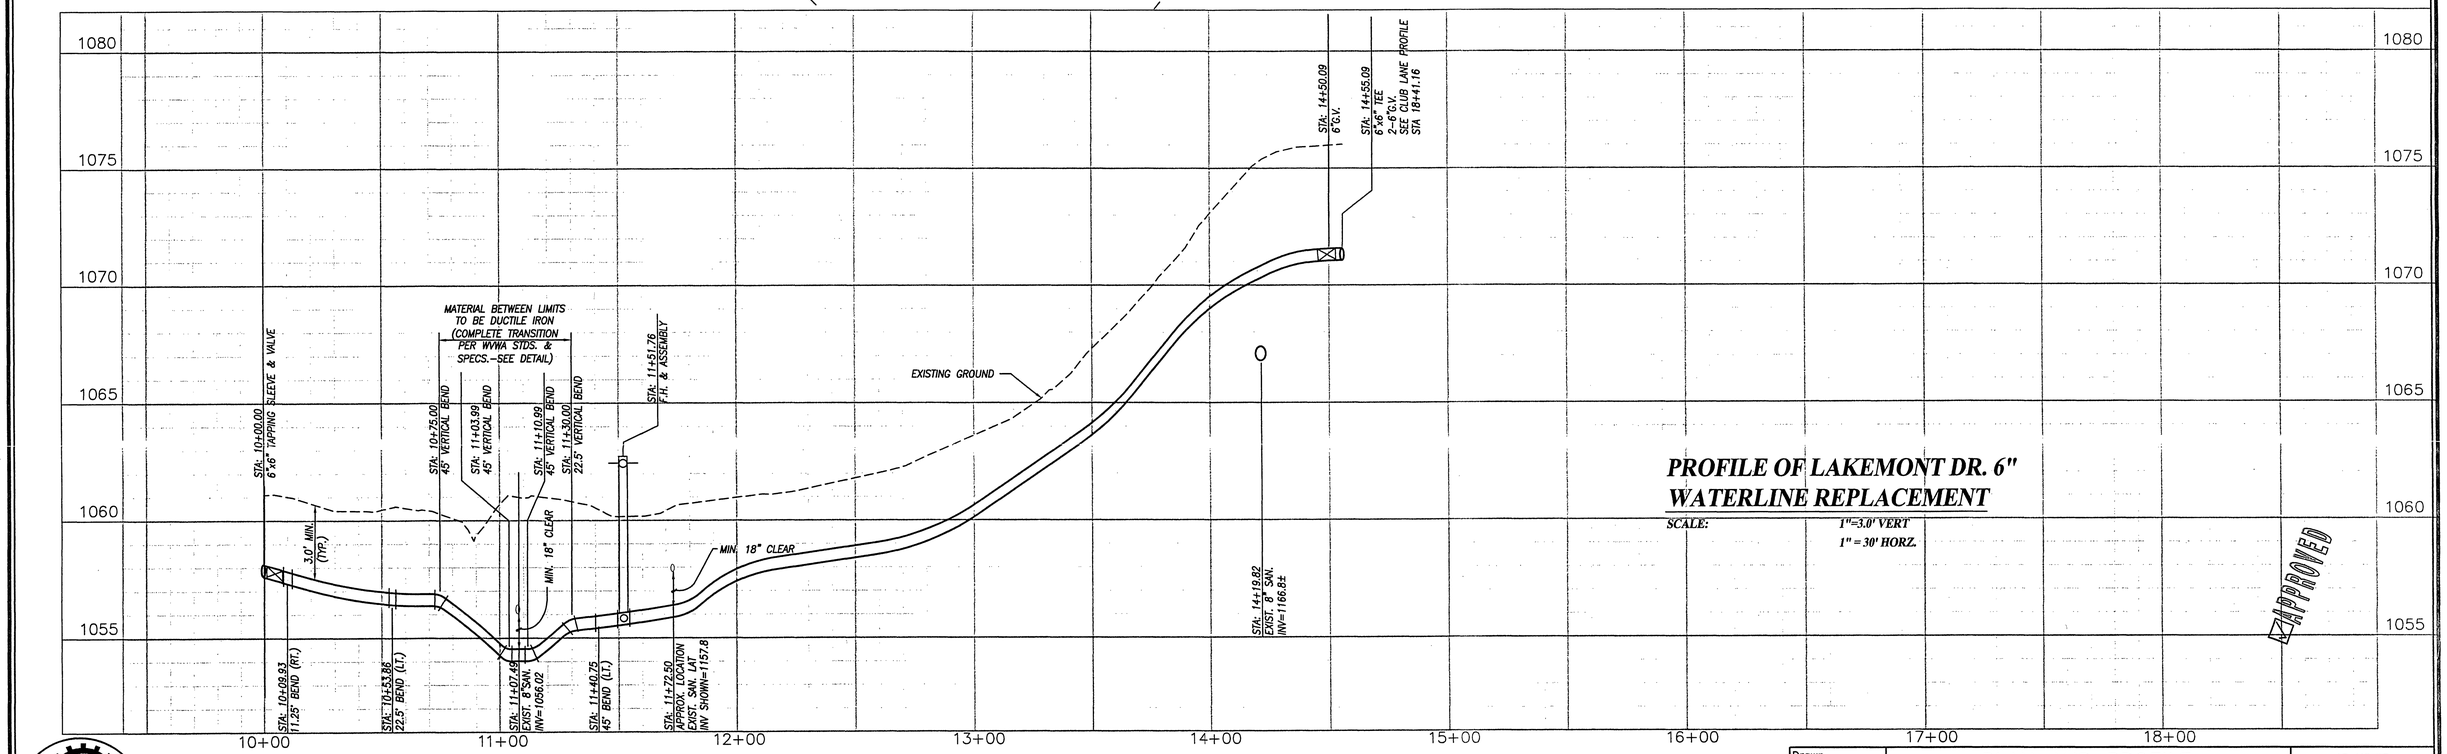

PROFILE OF LAKEMONT DR. 6" WATERLINE REPLACEMENT

SCALE: 1"=3.0' VERT
1" = 30' HORZ.

APPROVED

ENGINEERING CONCEPTS, INC.
20 S. ROANOKE ST., PO BOX 619
FINCASTLE, VIRGINIA 24090
540.473.1253 FAX: 540.473.1254

Drawn MWL	PLAN AND PROFILE LAKEMONT DRIVE 6" WATERLINE	AS NOTED	
Designed MWL		DATE: OCT. 9, 2009	
Checked MWL	WESTERN VA. WATER AUTHORITY	PROJECT: 07053	
Approved		5	