

NEW 8" PLASTIC WATER MAIN
 ----- C-909 plastic pipe

EXISTING SEWER MAIN

⊗ - FIRE HYDRANT


⋈ - 8" AND 6" VALVES

○ - 1" ARV

⊙ - 2" TEMP. BLOW OFF

----- 15' EXISTING EASEMENT

LAURELWOOD WATER PROJECT 2573'

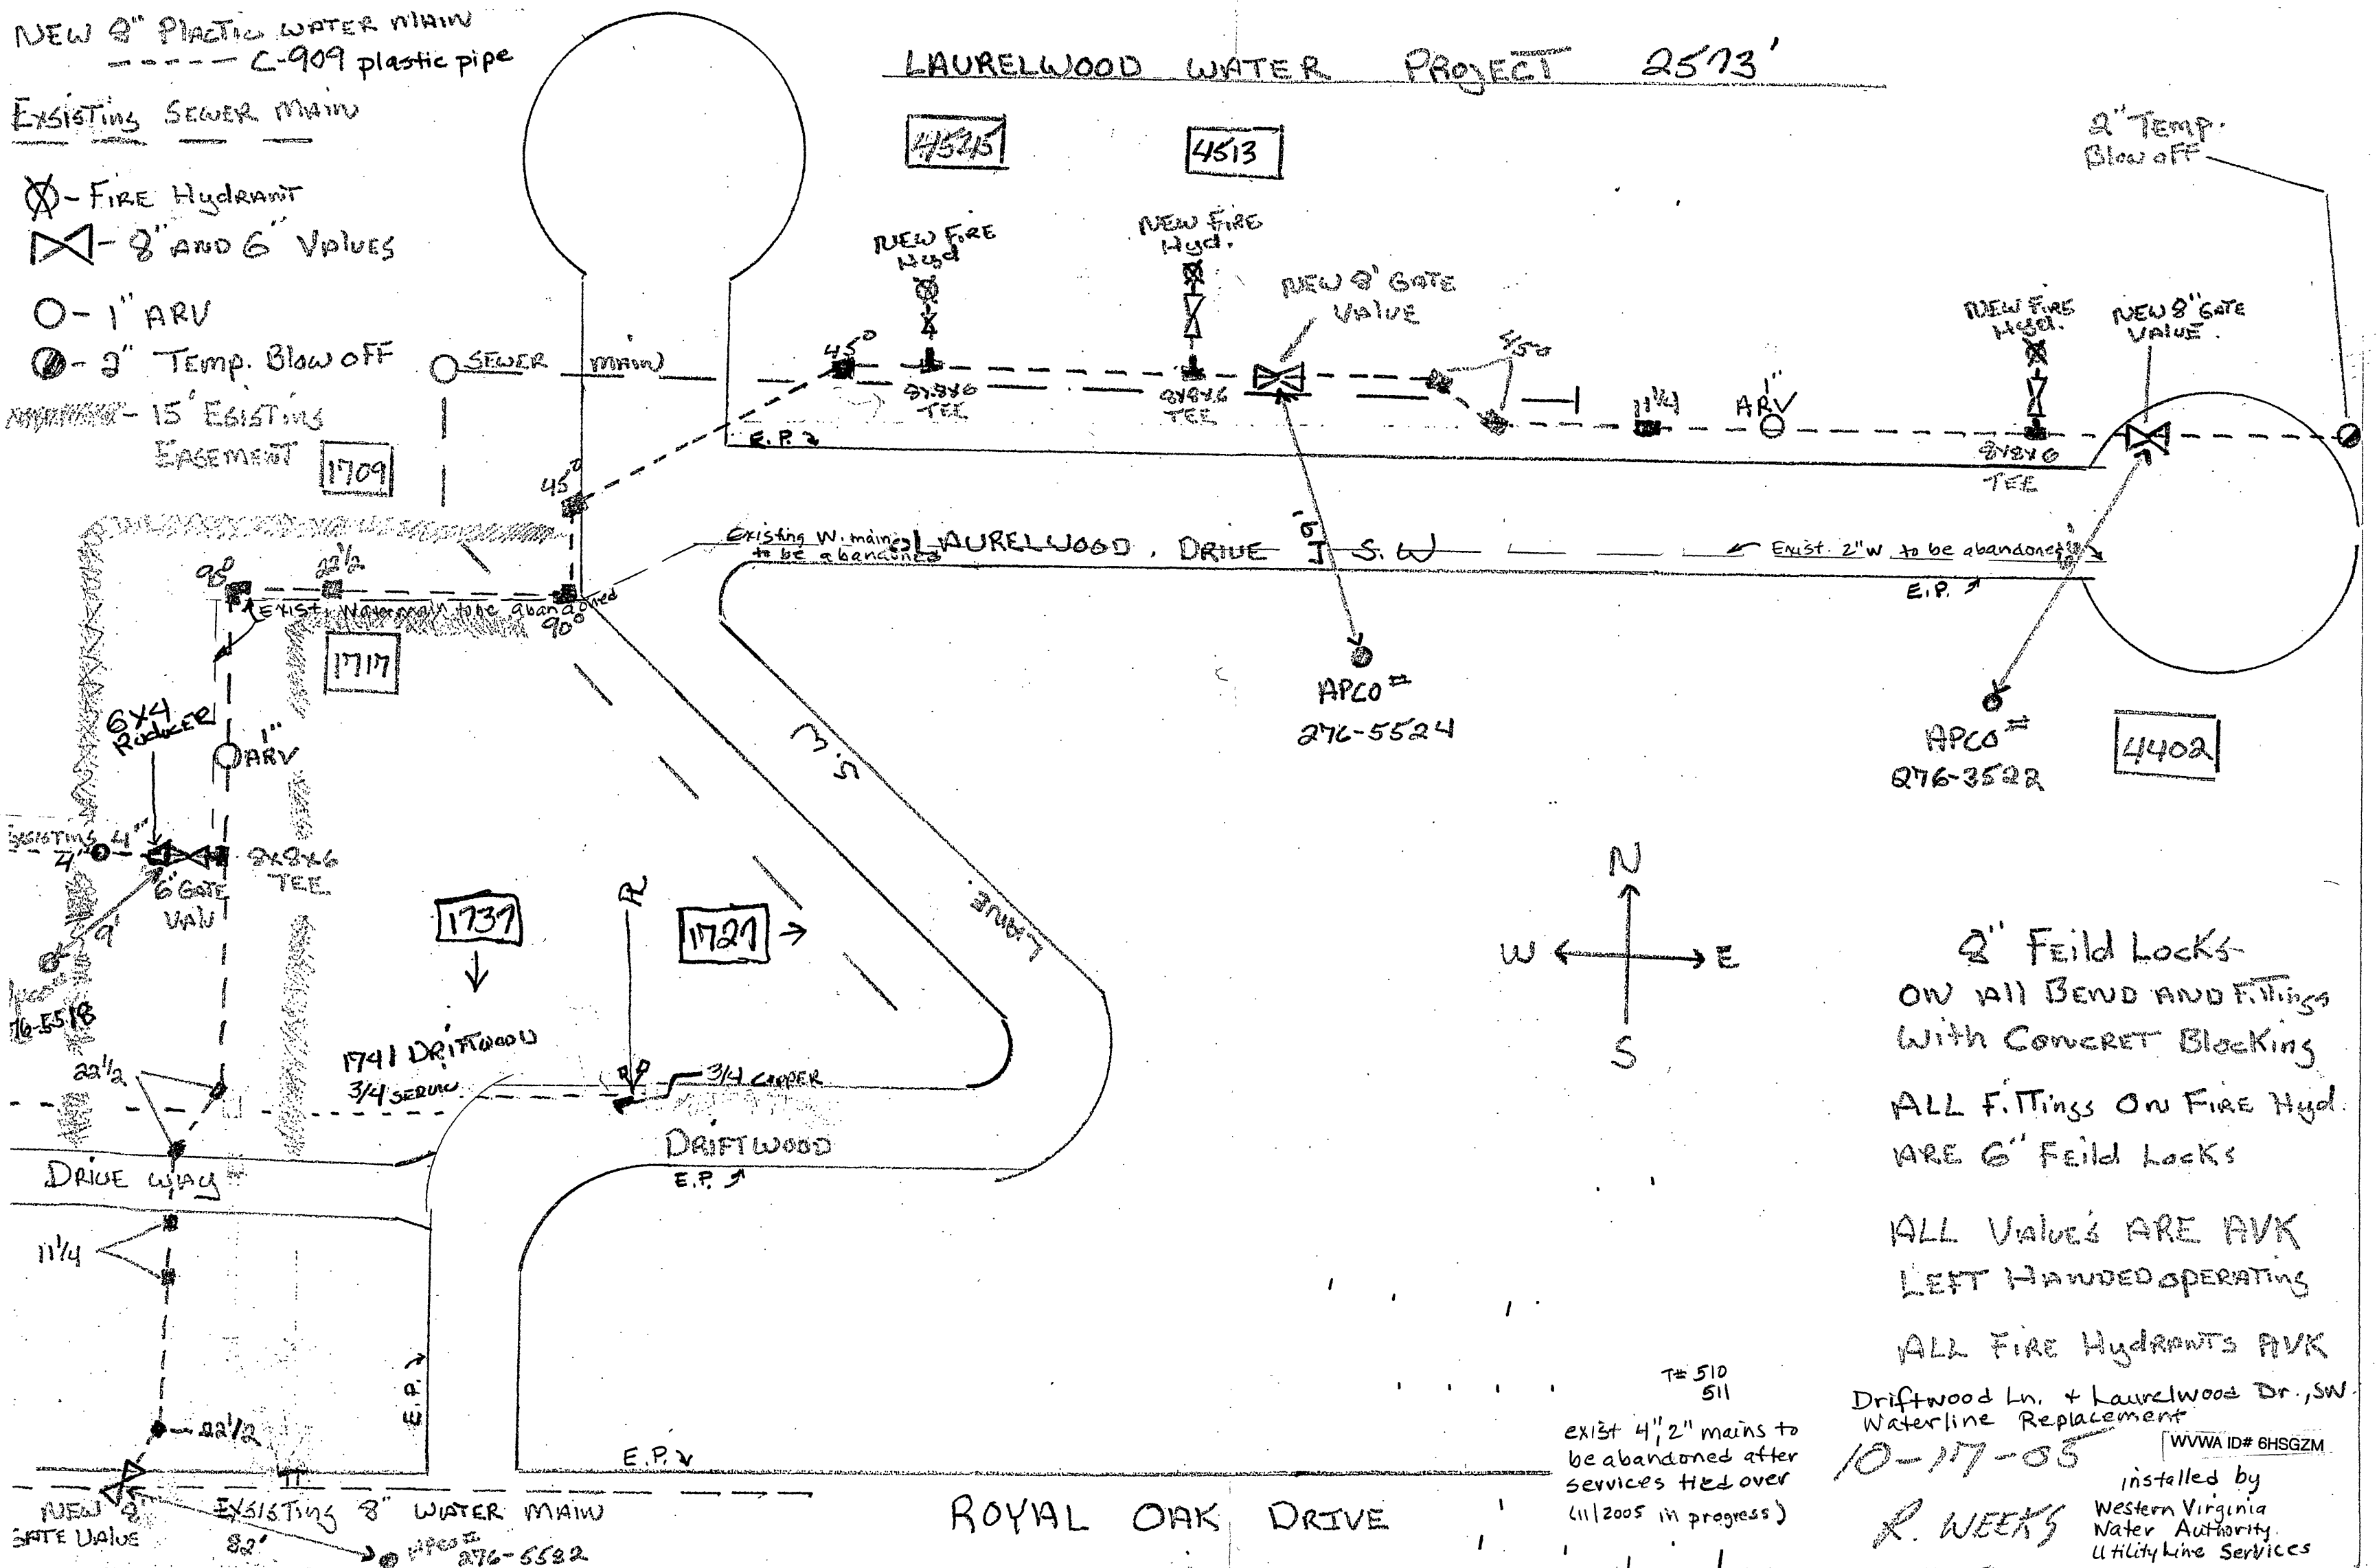

2" Field Locks
 ON ALL BEND AND FITTINGS
 WITH CONCRET BLOCKING
 ALL FITTINGS ON FIRE HYD.
 ARE 6" Field Locks

ALL VALVES ARE RVK
 LEFT HANDED OPERATING

ALL FIRE HYDRANTS RVK

Driftwood Ln. + Laurelwood Dr., SW.
 Waterline Replacement

10-17-05

R. WEEKS

WWVA ID# 6HSGZM
 installed by
 Western Virginia
 Water Authority
 Utility Line Services

TS 510
 511
 exist 4" 2" mains to
 be abandoned after
 services tied over
 (11/2005 in progress)

ROYAL OAK DRIVE