




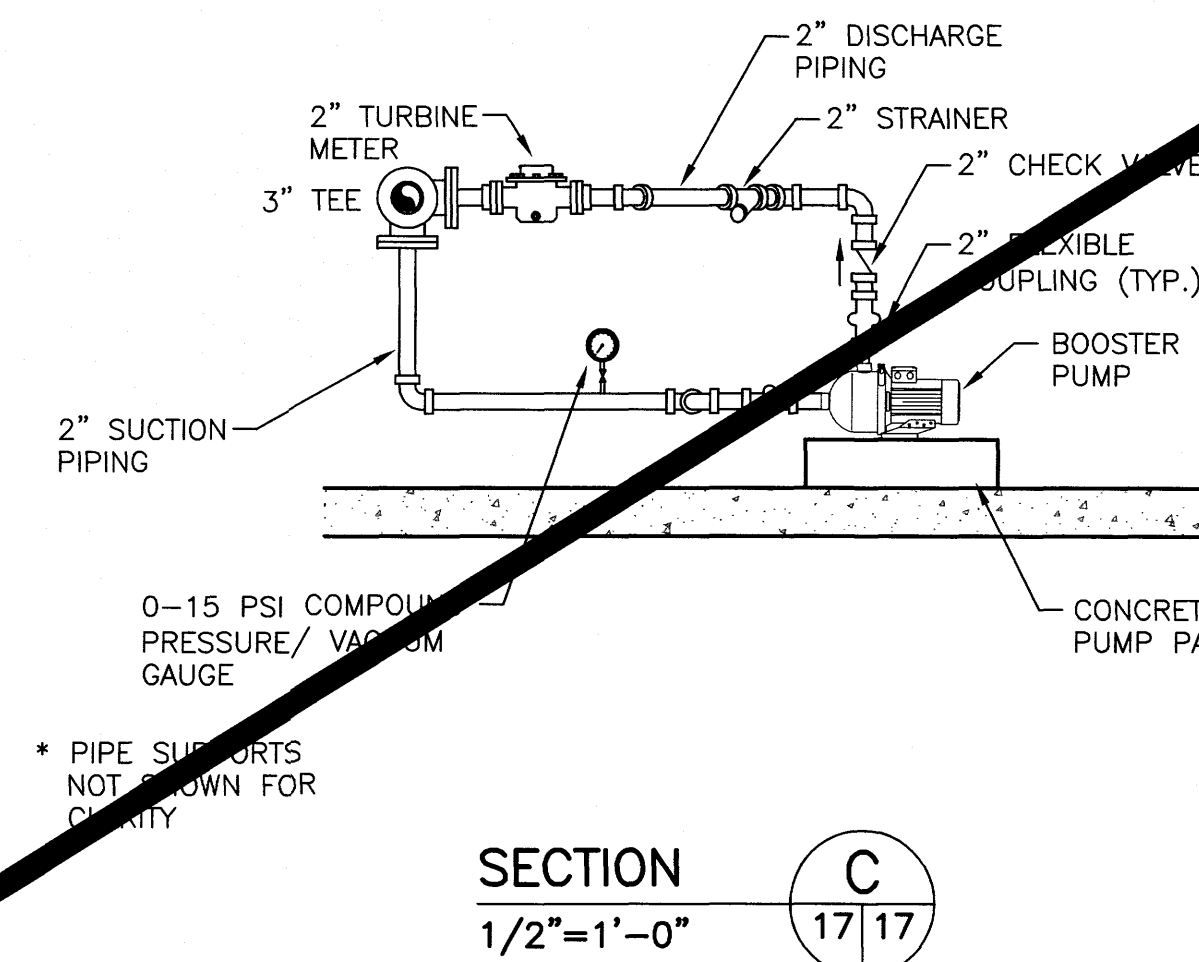

- NOTES:**
1. REFER TO SHEET C18 FOR BUILDING CONSTRUCTION DETAILS.
 2. SLOPE SLAB TO FLOOR DRAIN AT MINIMUM 1/8" PER FOOT SLOPE. EXTEND DRAIN TO DAYLIGHT AT MINIMUM 1% SLOPE.
 3. EACH PUMP PAD SHALL BE CONSTRUCTED WITH VERTICAL #4 BARS AT EACH CORNER AND HORIZONTAL #4 BAR EACH WAY. BARS SHALL HAVE MINIMUM 2" CONCRETE COVER.
 4. RESTRAIN ALL PRESSURE PIPE PENETRATIONS THROUGH SLAB WITH THREADED ROD. PROVIDE CONCRETE THRUST BLOCKS AT ALL FITTINGS BENEATH SLAB.
 5. INSTALL CONTROL UNITS (RESTRAINTS) ON ALL EXPANSION JOINTS.
 6. 2" PIPING MAY BE EITHER FLANGED OR THREADED STEEL. WHERE THREADED PIPE IS USED UNIONS SHALL BE UTILIZED TO ALLOW DISASSEMBLY OF SECTIONS.

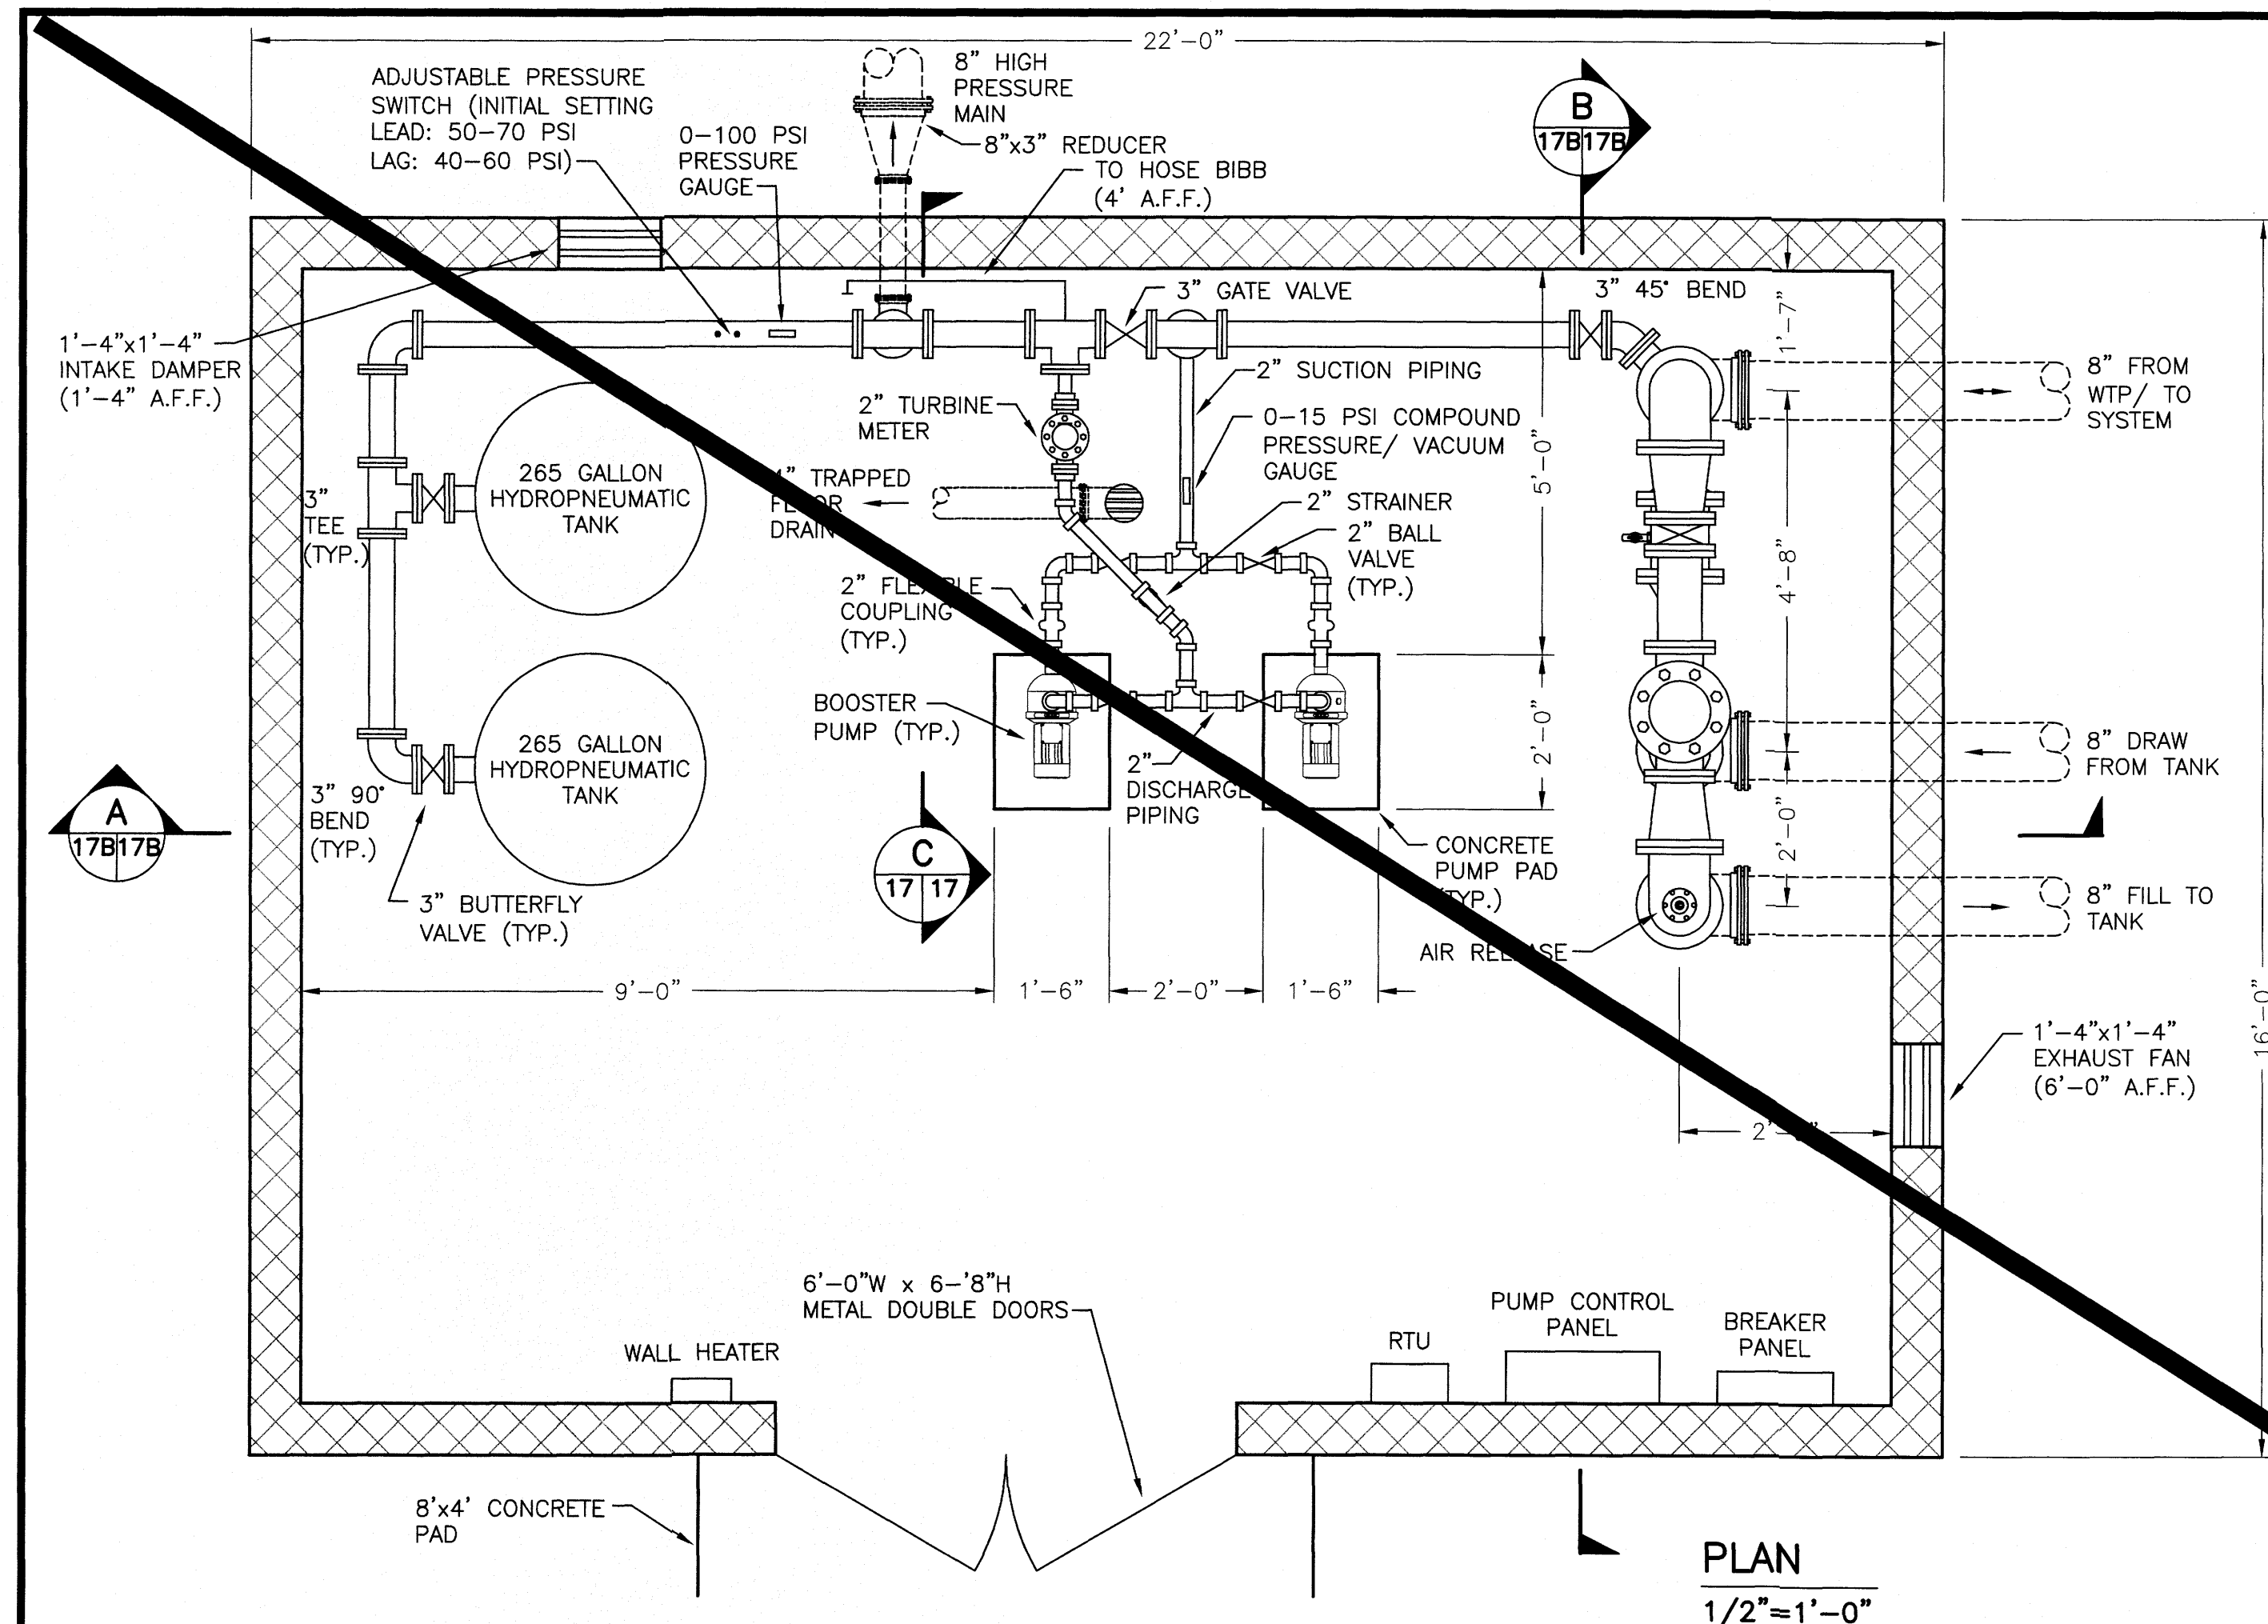

**NOT
CONSTRUCTED**

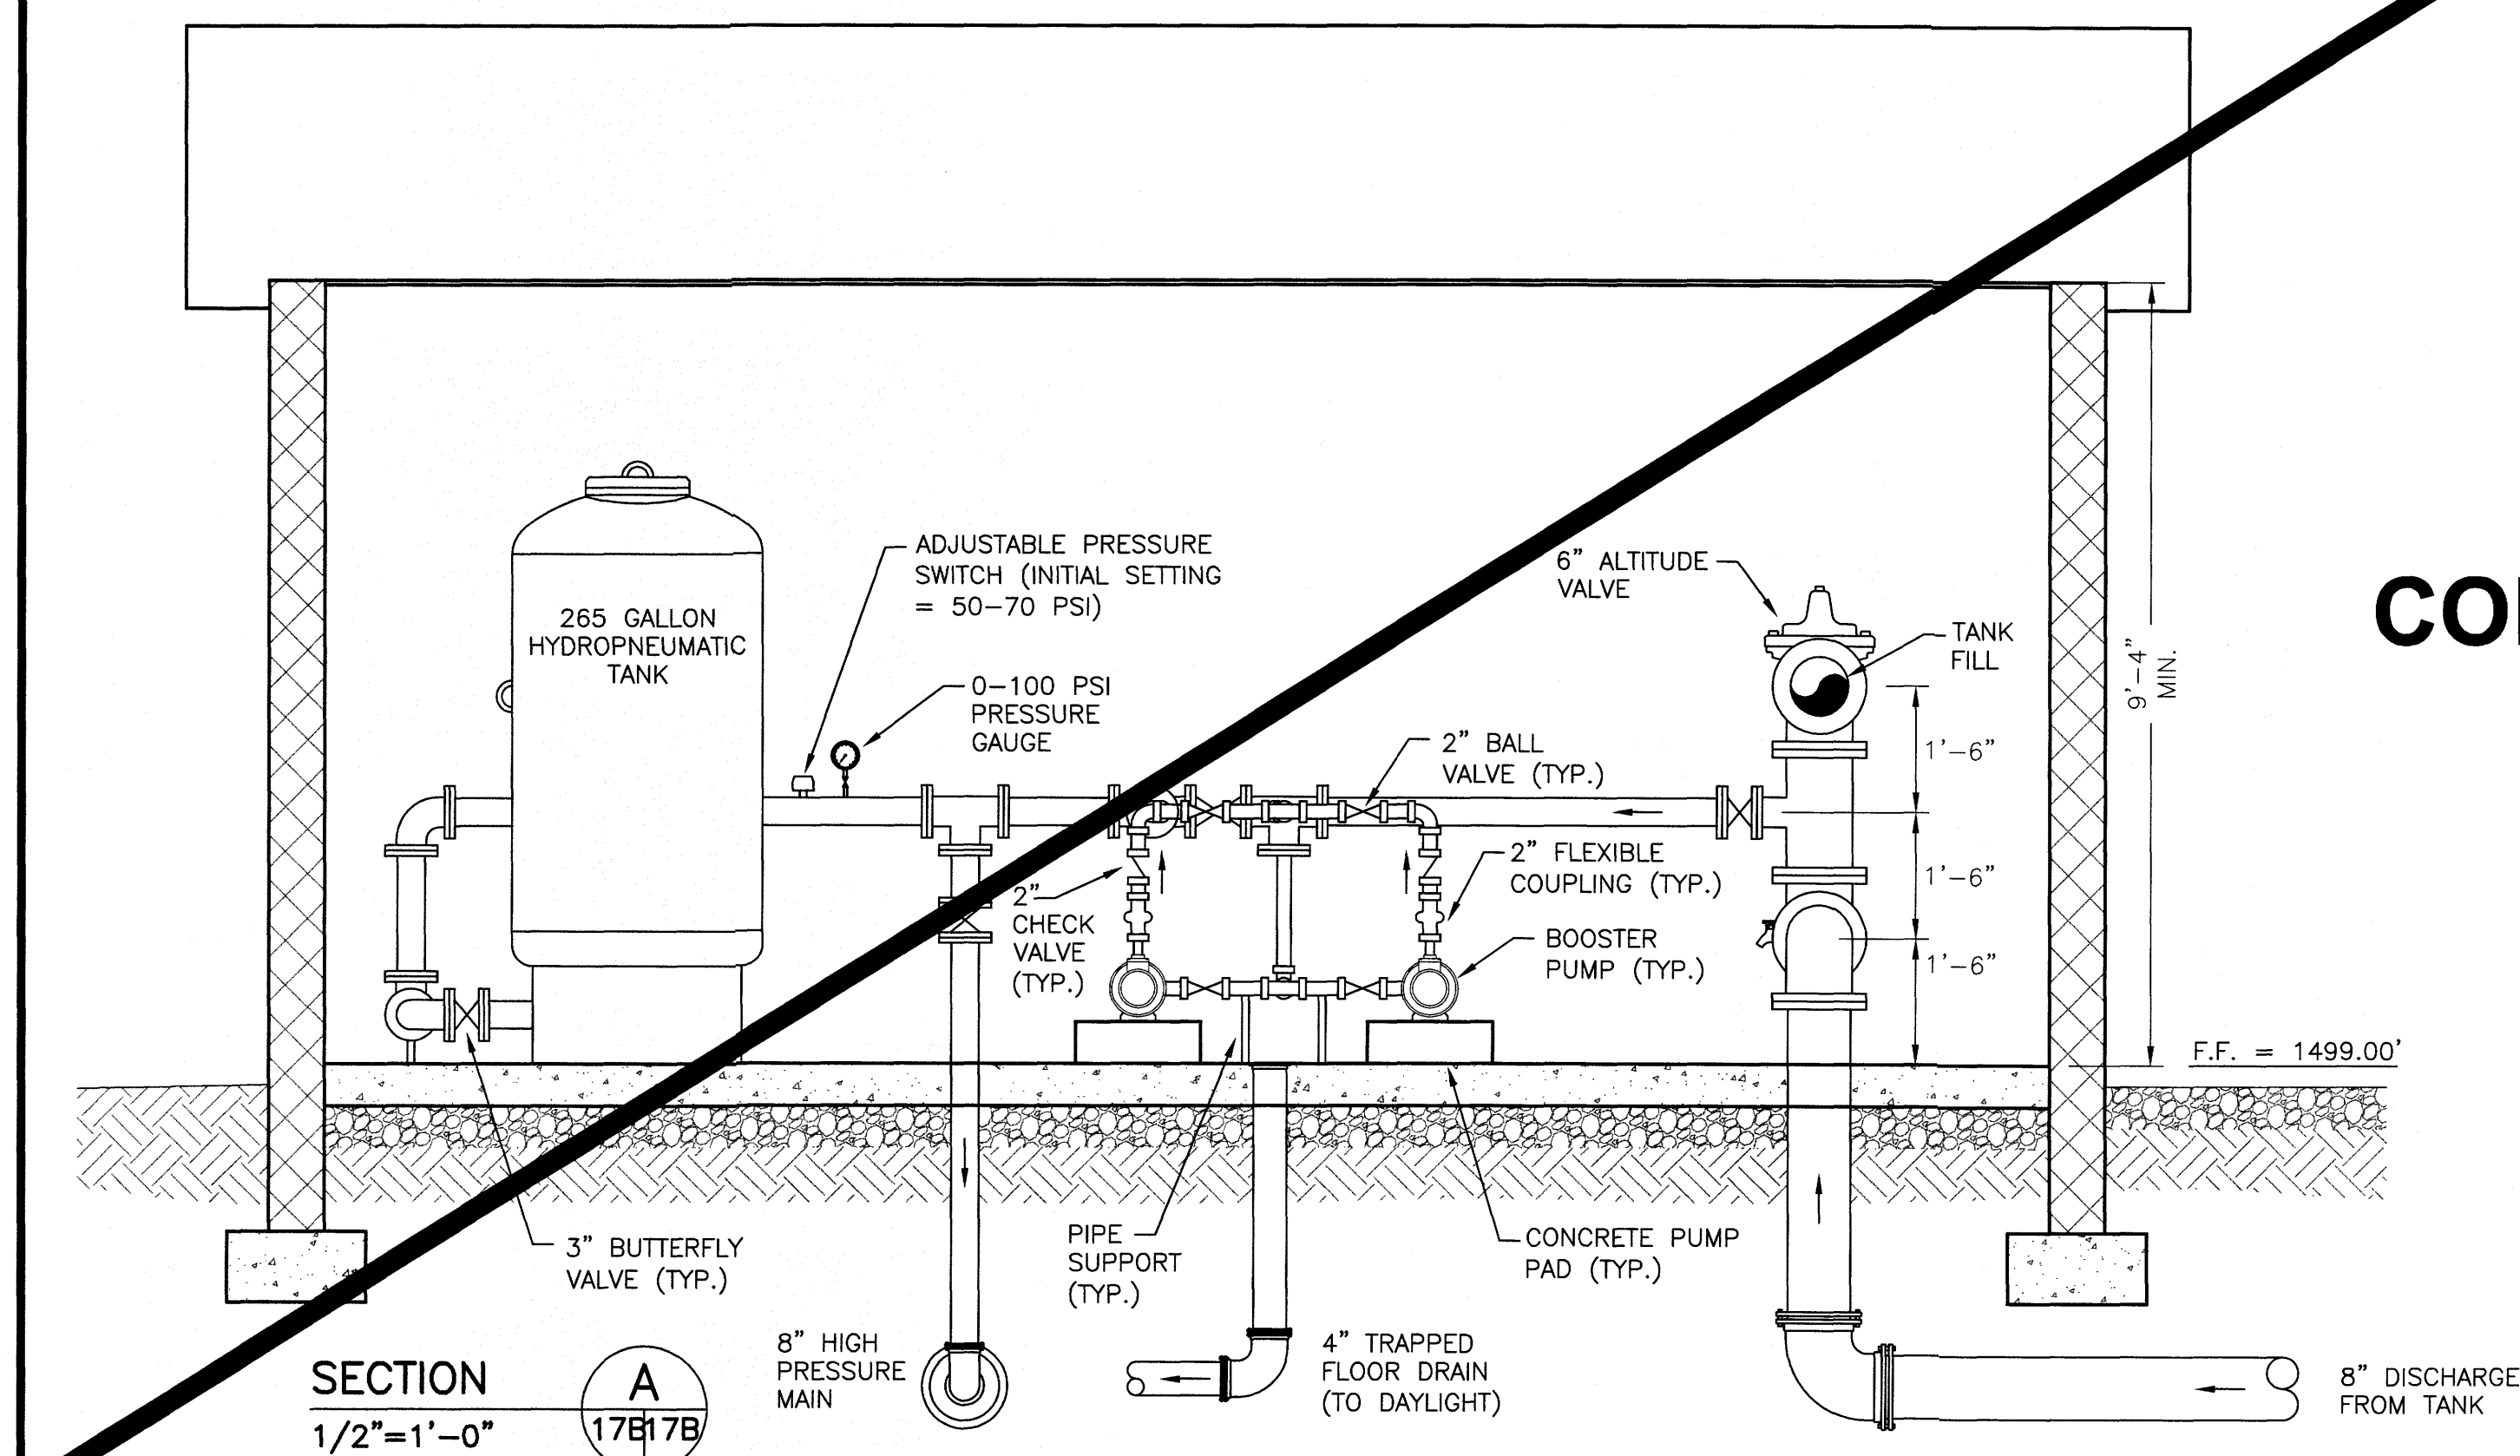