
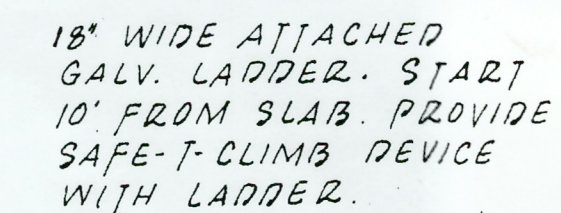
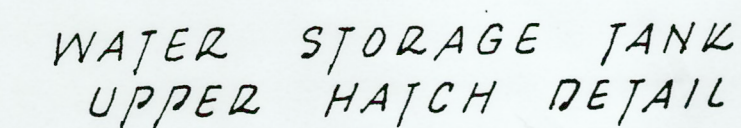


1. ALL PIPING BELOW GRADE AND UNDER CONCRETE SLAB SHALL BE GALVANIZED STEEL OR DUCTILE IRON.
2. ALL EXPOSED PIPING SHALL BE INSULATED TO PREVENT FREEZING TO A DEPTH 3' BELOW GRADE W/ CERTAINTIED* WRAP OR APPROVED EQUAL.
3. CUT OR FILE ALL THREADS FROM DISCHARGE OF SAMPLE TAPS.
4. GALVANIZED STEEL OR DUCTILE IRON PIPE SHALL BE USED FOR ALL ABOVE- GRADE PIPING AT THE WELL AND AT THE SPANDRIPPE STORAGE TANK.






PROVIDE 10' STEP LADDER
FOR ACCESS TO TANK
LADDER. STORE IN A
LOCKED AREA ON SITE

INSULATE PER NOTE 2

6" C.I. DRAIN PIPE TO GRADE W/ SCREEN

WATER STORAGE TANK ELEVATION

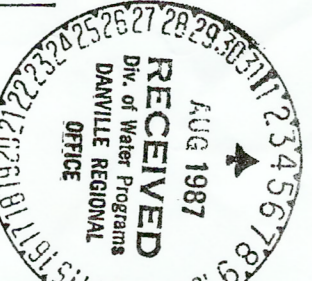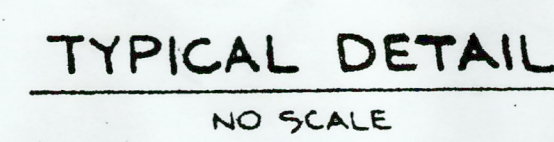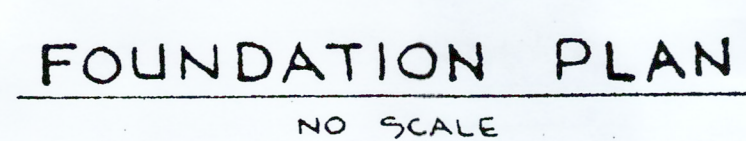

Berkley Howell & Assoc. ENGINEERS • SURVEYORS • PLANNERS			
SCALE:	APPROVED BY:	DRAWN BY	
DATE: 4-15-87		REVISED 7-23-87	
CEDAR RIDGE SUBDIVISION CENTRAL WATER SYSTEM			
MISC. DETAILS		DRAWING NUMBER 6097	