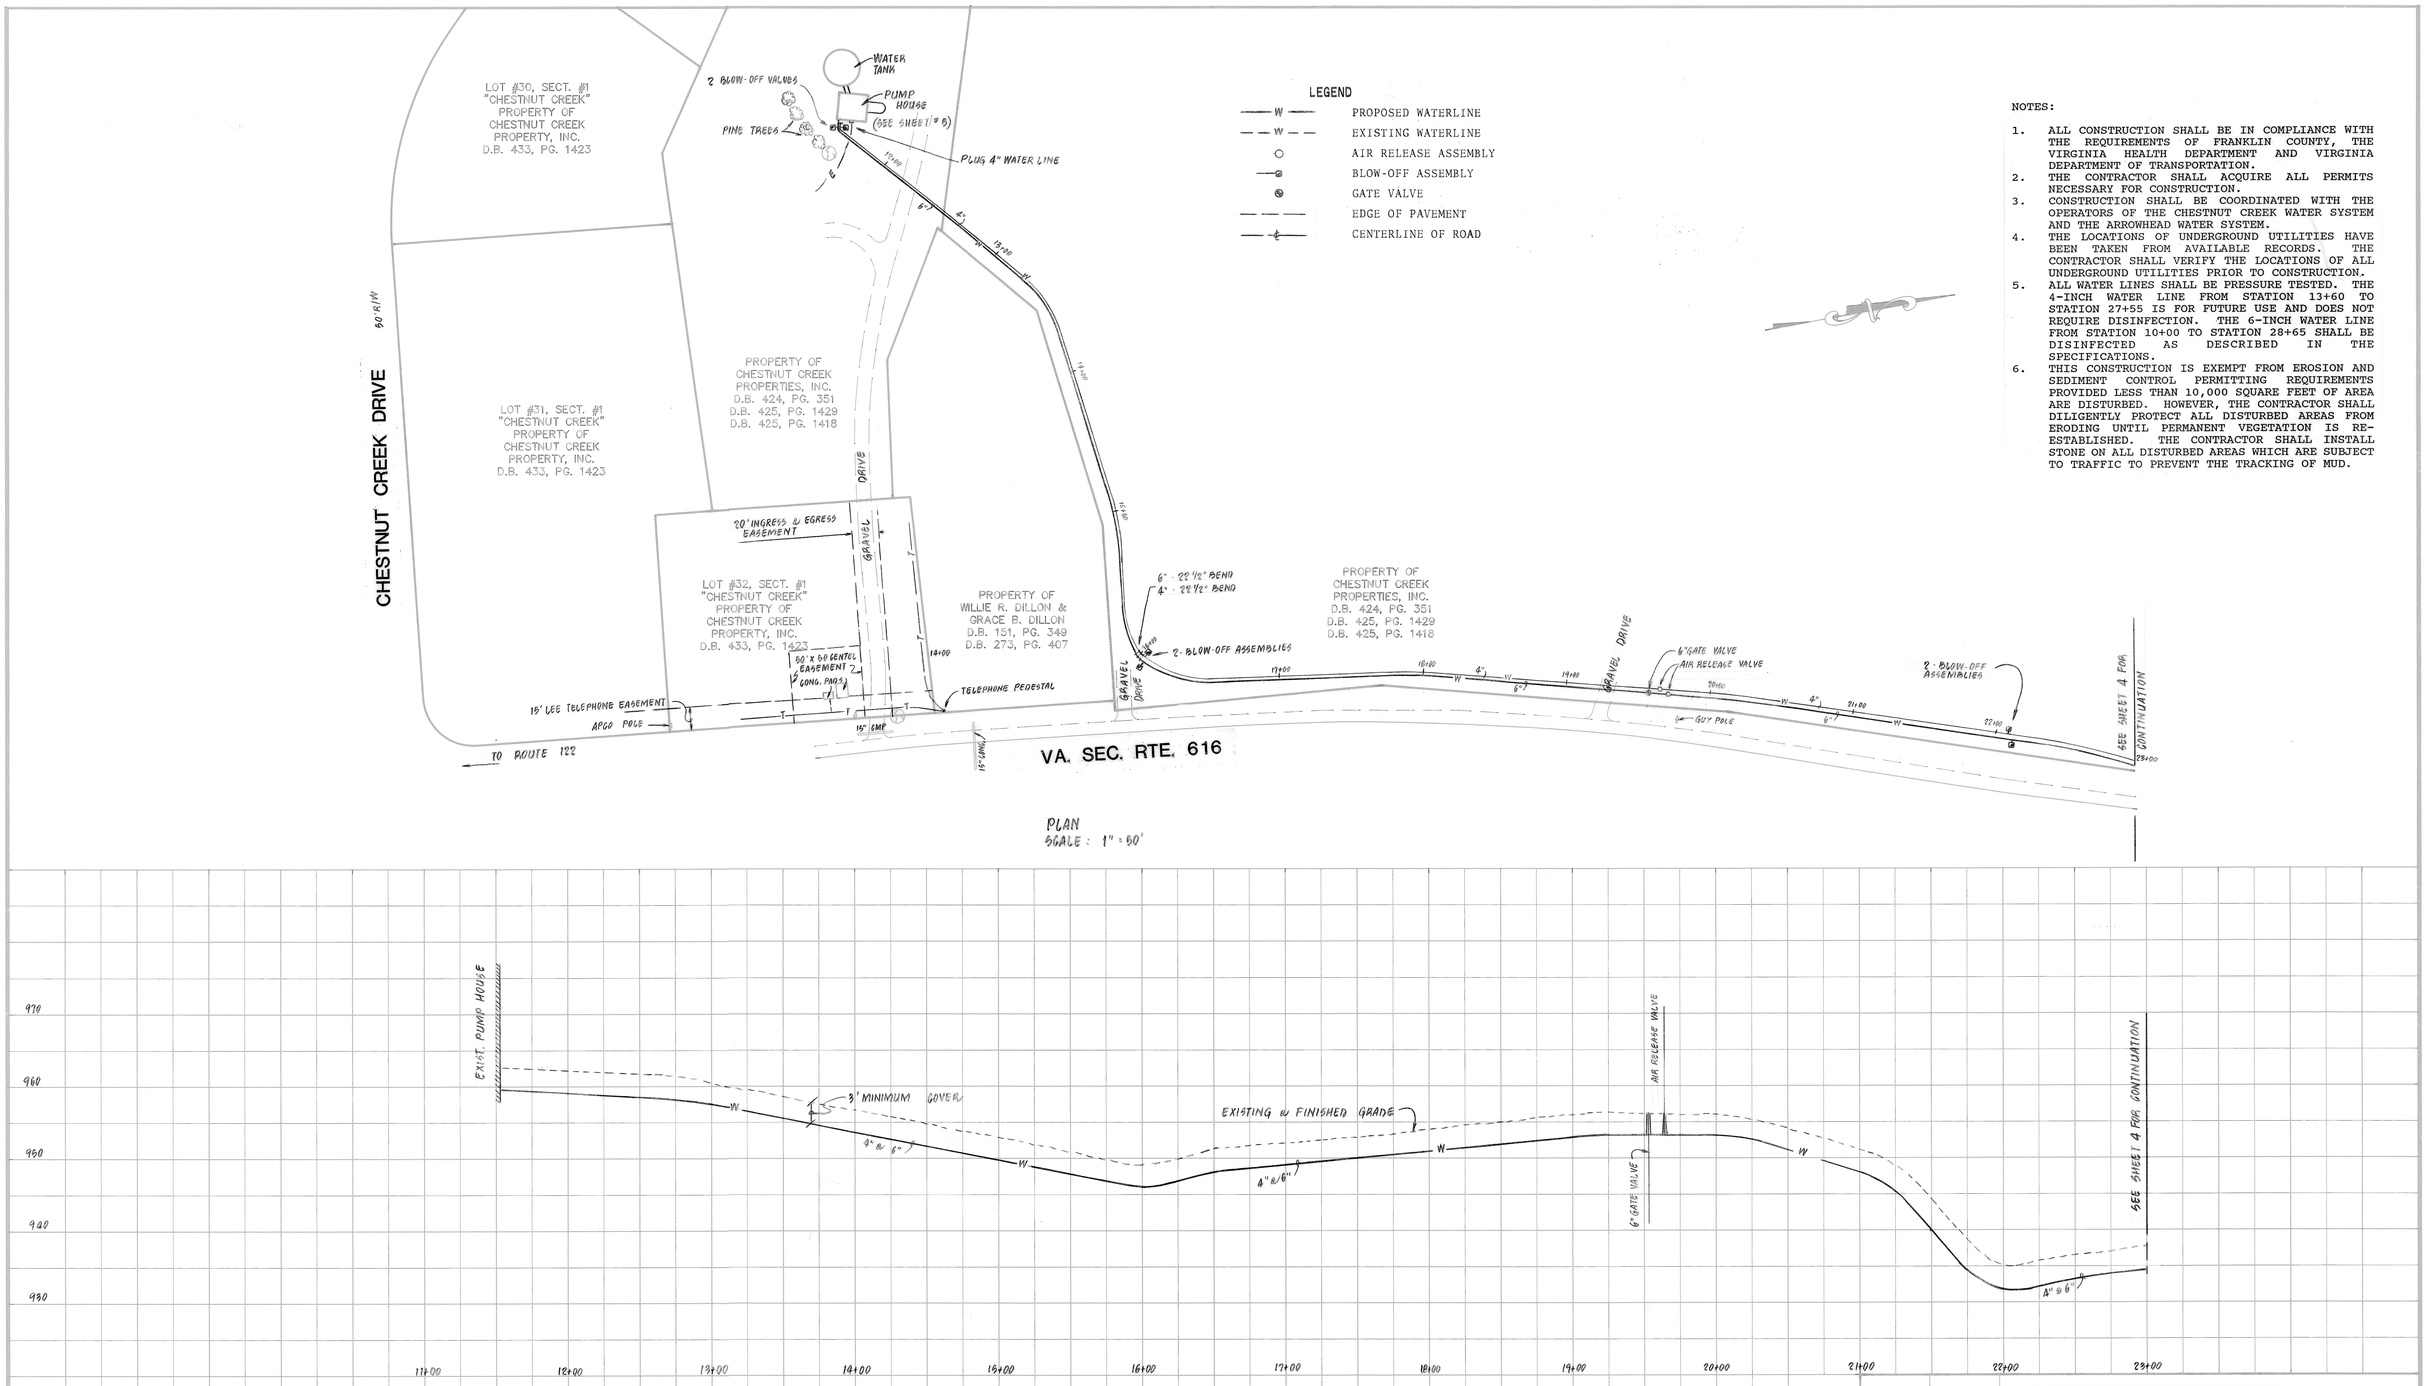

NOTES:

1. ALL CONSTRUCTION SHALL BE IN COMPLIANCE WITH THE REQUIREMENTS OF FRANKLIN COUNTY, THE VIRGINIA HEALTH DEPARTMENT AND VIRGINIA DEPARTMENT OF TRANSPORTATION.
2. THE CONTRACTOR SHALL ACQUIRE ALL PERMITS NECESSARY FOR CONSTRUCTION.
3. CONSTRUCTION SHALL BE COORDINATED WITH THE OPERATORS OF THE CHESTNUT CREEK WATER SYSTEM AND THE ARROWHEAD WATER SYSTEM.
4. THE LOCATIONS OF UNDERGROUND UTILITIES HAVE BEEN TAKEN FROM AVAILABLE RECORDS. THE CONTRACTOR SHALL VERIFY THE LOCATIONS OF ALL UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION.
5. ALL WATER LINES SHALL BE PRESSURE TESTED. THE 4-INCH WATER LINE FROM STATION 13+60 TO STATION 27+55 IS FOR FUTURE USE AND DOES NOT REQUIRE DISINFECTION. THE 6-INCH WATER LINE FROM STATION 10+00 TO STATION 28+65 SHALL BE DISINFECTED AS DESCRIBED IN THE SPECIFICATIONS.
6. THIS CONSTRUCTION IS EXEMPT FROM EROSION AND SEDIMENT CONTROL PERMITTING REQUIREMENTS PROVIDED LESS THAN 10,000 SQUARE FEET OF AREA ARE DISTURBED. HOWEVER, THE CONTRACTOR SHALL DILIGENTLY PROTECT ALL DISTURBED AREAS FROM ERODING UNTIL PERMANENT VEGETATION IS RE-ESTABLISHED. THE CONTRACTOR SHALL INSTALL STONE ON ALL DISTURBED AREAS WHICH ARE SUBJECT TO TRAFFIC TO PREVENT THE TRACKING OF MUD.

PLAN
SCALE : 1" = 50'

SCALE : HORIZ. : 1" = 50'
VERT. : 1" = 10'

REVISION	DATE	DESCRIPTION
2	12-28-94	RELOCATED WATERLINES
1	6-28-94	ADDED BLOW-OFF AT STATION 14+60 ON 6" WATER LINE

DESIGNED BZ
DRAWN BZ, WWB
CHECKED MSW

COMMONWEALTH OF VIRGINIA
Michael S. Webb
MICHAEL S. WEBB
No. 012656
6-1-94
6-28-94
PROFESSIONAL ENGINEER

PLAN & PROFILE
FOR
INTERCONNECTION OF
CHESTNUT CREEK WATER SYSTEM AND
ARROWHEAD WATER SYSTEM
PREPARED FOR
CHESTNUT CREEK PROPERTIES, INC.
GILLS CREEK MAGISTERIAL DISTRICT
FRANKLIN COUNTY, VIRGINIA

LUMSDEN ASSOCIATES, P.C.
ENGINEERS-SURVEYORS-PLANNERS
ROANOKE, VIRGINIA

SCALE: AS SHOWN | COMM: #94-127
DATE: 1 JUNE 1994 | SHEET 3 of 5