



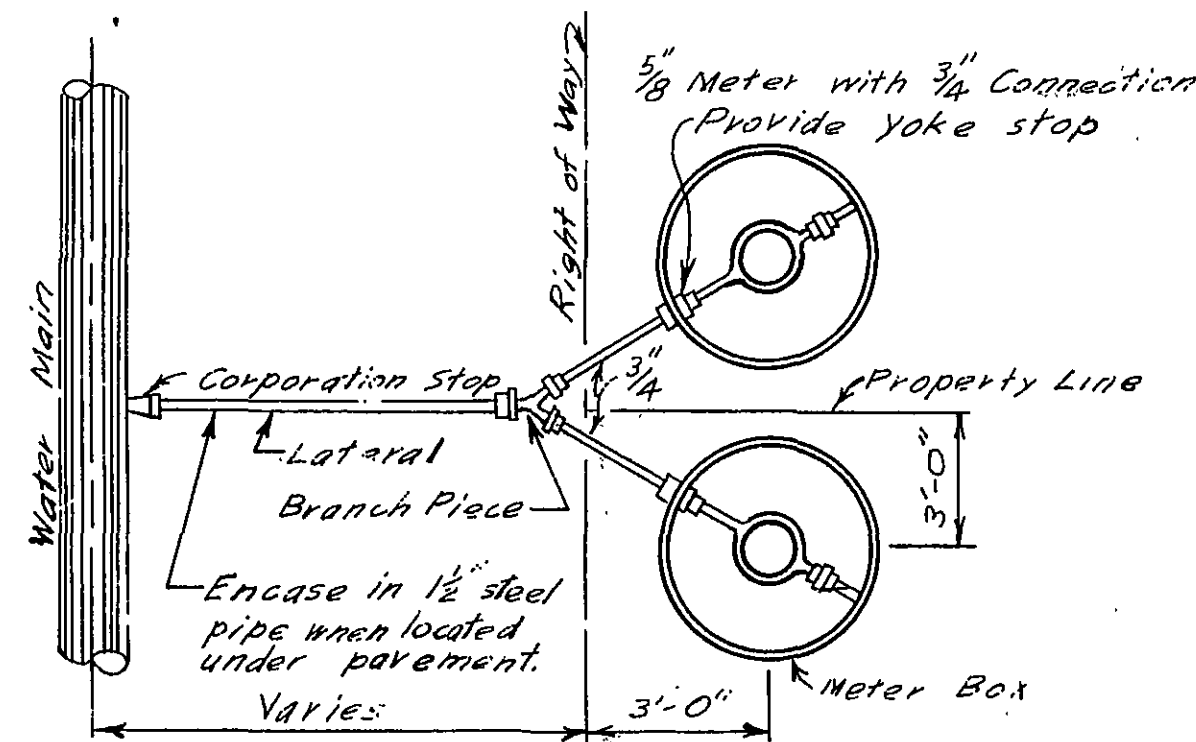

Note: Provide service saddle for all taps greater than 3/4"

WATER SERVICE CONNECTIONS

Not to Scale

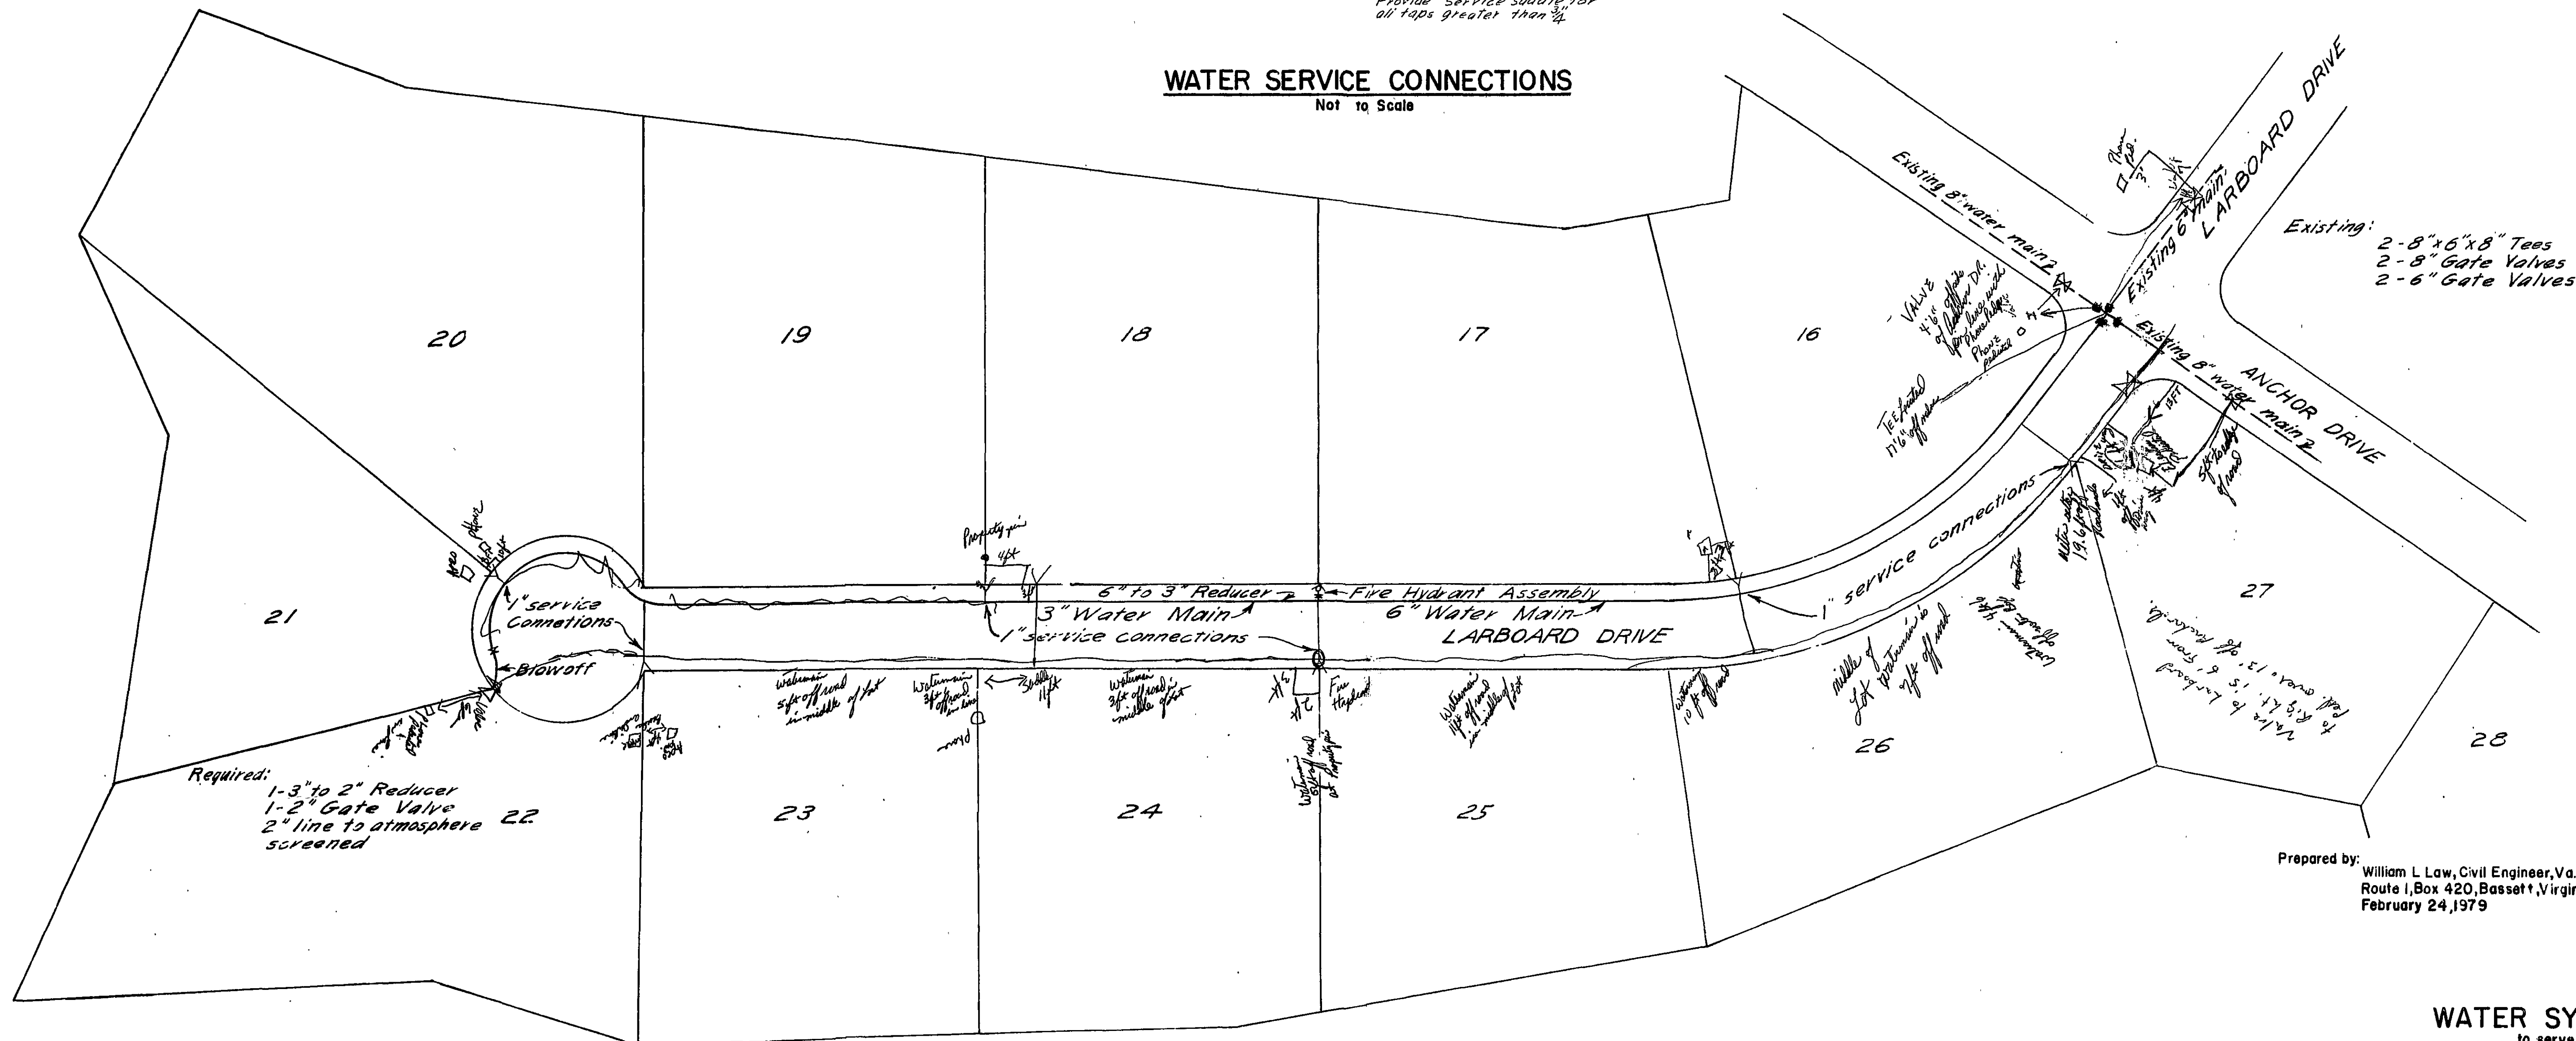

Prepared by: William L. Law, Civil Engineer, Va. Cert. No. 1296
Route 1, Box 420, Bassett, Virginia 24055
February 24, 1979

WATER SYSTEM
to serve
WATER FRONT SECTION 3
owned by
BREMBLE PROPERTIES, INC.
GILLS CREEK MAG DIST.
FRANKLIN COUNTY, VIRGINIA

Scale 1 inch = 50 feet

