


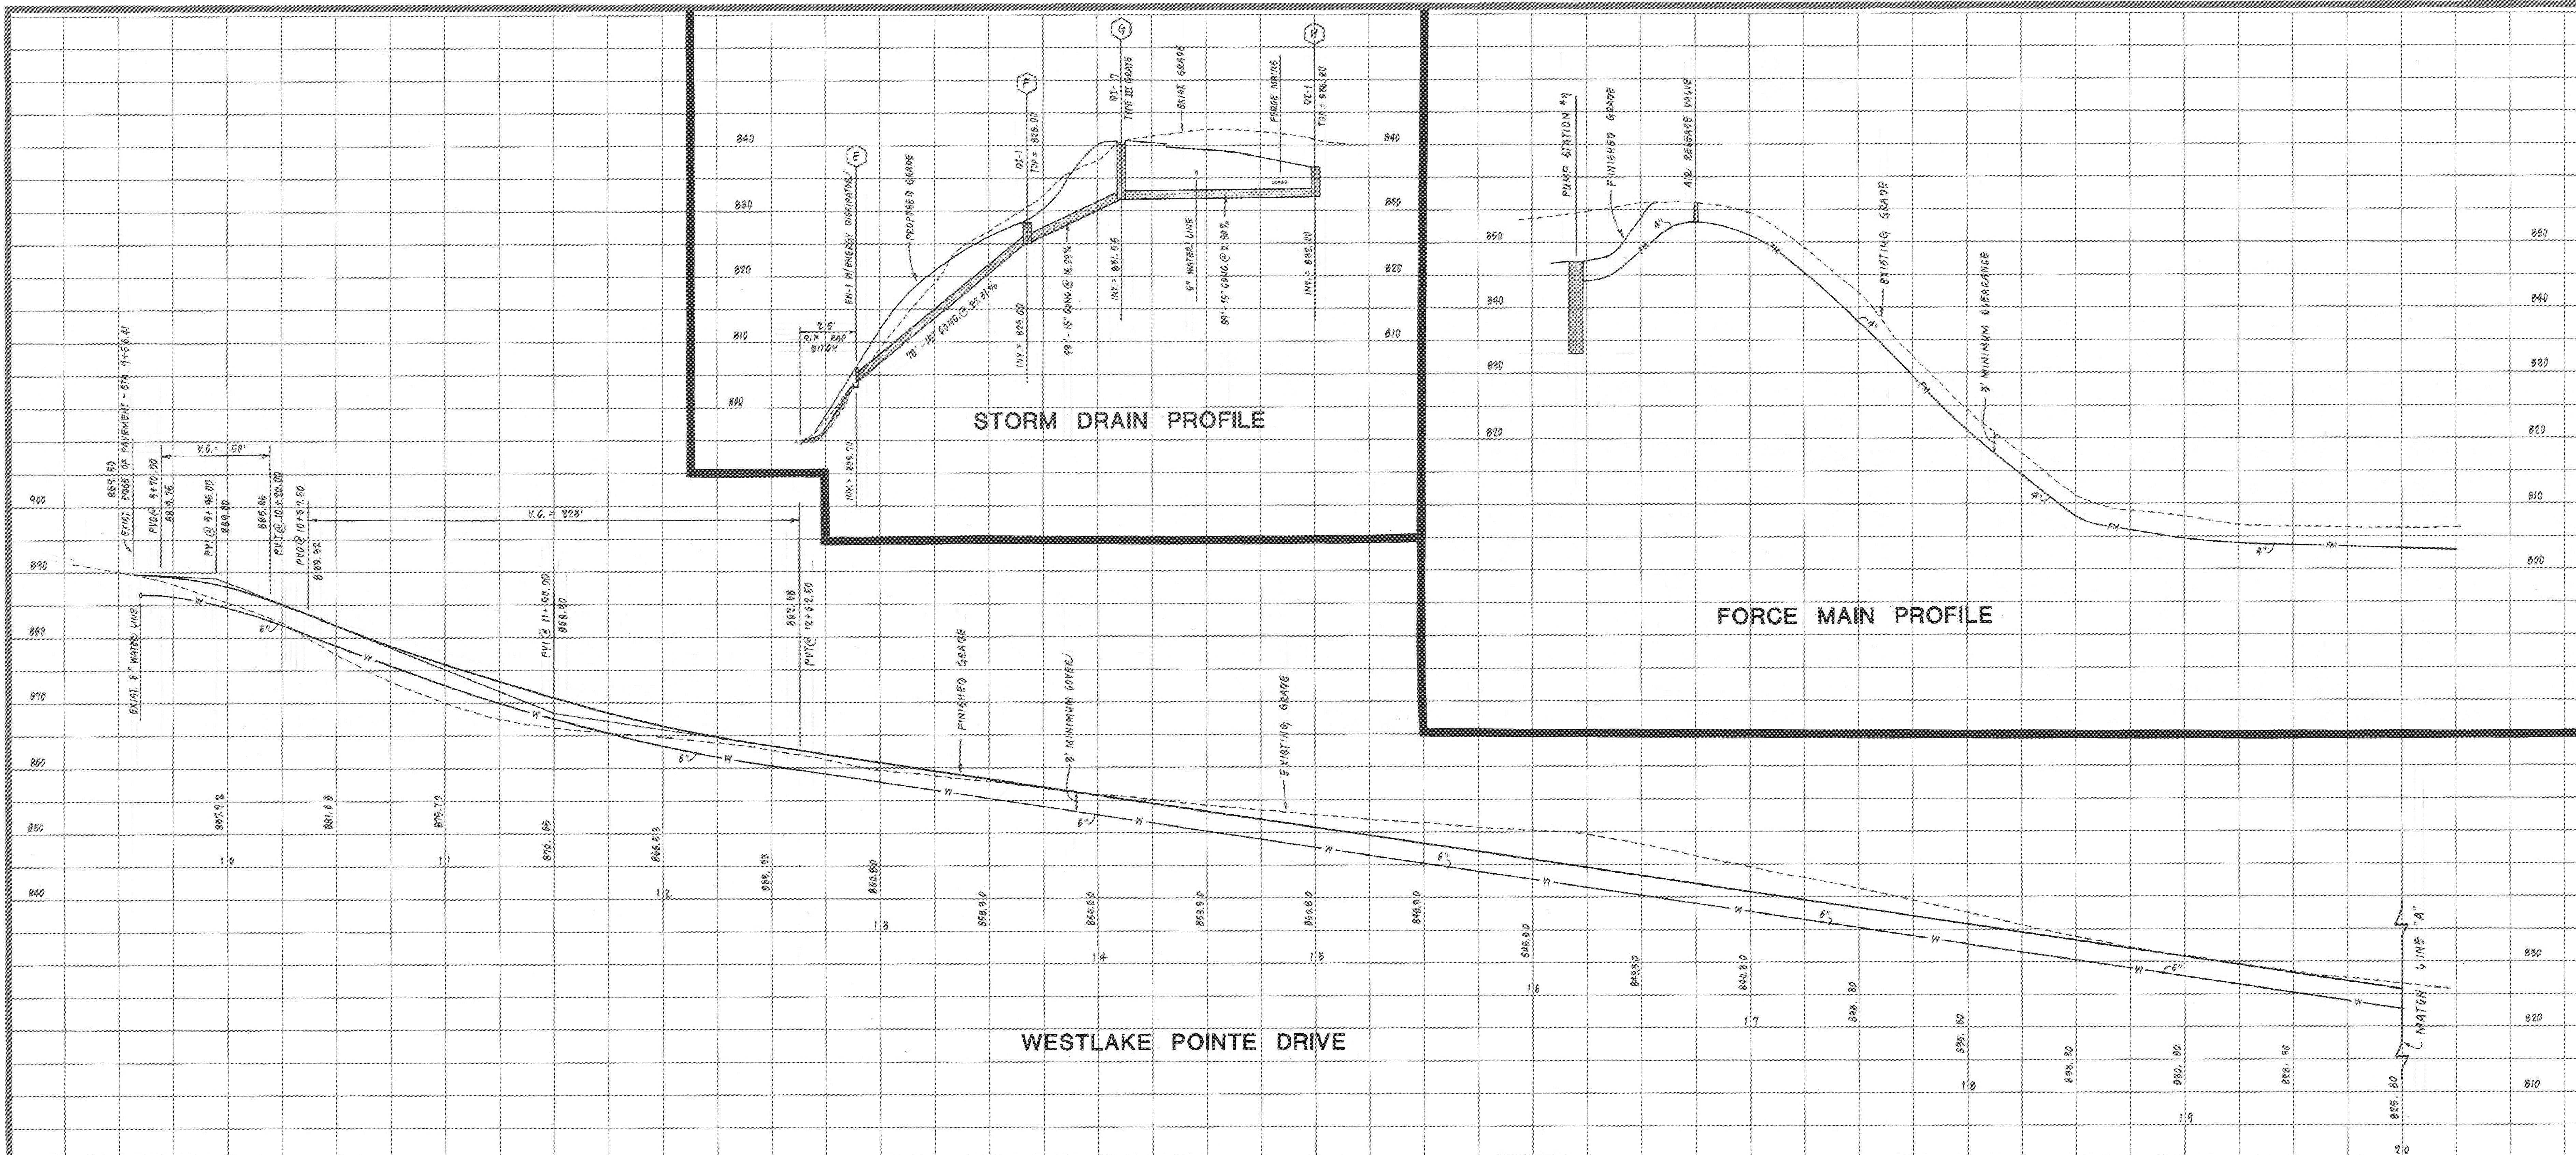

NOTES:

WATER LINES SHALL BE INSTALLED ABOVE SEWER LINES AT CROSSINGS. PROVIDE A MINIMUM OF 18 INCHES OF SEPARATION BETWEEN THE TOP OF SEWER LINES AND THE BOTTOM OF THE WATER LINES.

2	19 SEPT. 2000	ADDED WATER LINE NOTE
1	20 DEC. 1998	ADD STORM DRAIN PROFILE BETWEEN STRUCTURES "E" THRU "G",
REVISION	DATE	DESCRIPTION
DESIGNED	GAM	ROAD, STORM DRAIN & FORCE MAIN PROFILES FOR "WESTLAKE POINTE"
DRAWN	RAG	PREPARED FOR WESTLAKE PROPERTIES, INC.
CHECKED	MSW	GILLS CREEK MAGISTERIAL DISTRICT FRANKLIN COUNTY, VIRGINIA
LUMSDEN ASSOCIATES, P.C. ENGINEERS-SURVEYORS-PLANNERS ROANOKE, VIRGINIA		
SCALE:	1" = 80' HORIZ. 1" = 10' VERT.	COMM: 98-181
DATE:	7 AUG. 1998	SHEET 8 of 13