a. BOCA - BASIC CODES

b. ROANOKE COUNTY

VDOT - VIRGINIA DEPARTMENT OF TRANSPORTATION ROAD AND BRIDGE STANDARDS AND SPECIFICATIONS—LATEST EDITION

VIRGINIA EROSION AND SEDIMENT CONTROL REGULATIONS AND HANDBOOK, LATEST EDITION

e. OSHA — OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION

ASTM — AMERICAN SOCIETY FOR TESTING AND MATERIALS

MAINTAIN A SET OF APPROVED PLANS ON SITE AT ALL TIMES DURING CONSTRUCTION.

OBTAIN EACH REQUIRED PERMIT PRIOR TO COMMENCING THAT PART OF THE WORK.

NOTIFY THE ENGINEER IMMEDIATELY UPON DISCOVERY OF CONDITIONS WHICH DIFFER

FROM THOSE SHOWN ON THE PLANS. COMPLY WITH LOCAL ORDINANCES FOR BURNING OF WASTE. TRANSPORT WASTE MATERIALS AND UNSUITABLE MATERIALS FROM OWNER'S PROPERTY.

6. A PRECONSTRUCTION MEETING MUST TAKE PLACE PRIOR TO COMMENCING WORK. AS A MINIMUM, THE CONTRACTOR, OWNER'S AGENT AND COUNTY'S AGENT MUST ATTEND

VERIFY THE LOCATION AND ELEVATION OF EACH EXISTING UNDERGROUND UTILITY IN AREAS OF CONSTRUCTION PRIOR TO COMMENCEMENT OF WORK. CONTACT ENGINEER IMMEDIATELY IF THERE APPEARS TO BE A CONFLICT, UPON DISCOVERY OF A UTILITY WHICH IS NOT SHOWN, AND UPON DISCOVERY OF A LOCATION OR ELEVATION WHICH DIFFERS FROM THAT SHOWN. TO LOCATE UTILITIES, CALL "MISS UTILITY", 1-800-552-7001. UTILITY LOCATIONS SHOWN ARE THE RESULT OF A COMBINATION OF FIELD LOCATION AND EXISTING INFORMATION. LOCATIONS ARE APPROXIMATE.

8. REPAIR ALL DAMAGE TO ANY UTILITY, PUBLIC OR PRIVATE, CAUSED AS A RESULT OF CONSTRUCTION ACTIVITIES, AT NO ADDITIONAL COST TO OWNER.

9. NOTIFY OWNERS OF UTILITIES IN AREAS OF CONSTRUCTION PRIOR TO COMMENCEMENT OF EXCAVATION.

10. SIGNAGE SHALL COMPLY WITH THE APPLICABLE REGULATIONS OF THE COUNTY. A

SEPARATE PERMIT IS REQUIRED. THIS IS A ZERO LOT LINE SUBDIVISION.

12. THE DEVELOPER WILL NEED TO OBTAIN A TEMPORARY GRADING EASEMENT FOR ALL THE GRADING OUTSIDE OF THE PROPERTY BOUNDARY.

WATER NOTES:

. ALL MATERIALS, CONSTRUCTION, ETC. SHALL MEET ALL THE SPECIFICATIONS AND REQUIREMENTS OF THE COMMONWEALTH OF VIRGINIA/STATE BOARD OF HEALTH "WATERWORKS REGULATIONS", LATEST EDITION, AS WELL AS THOSE OF THE LOCAL GOVERNING AUTHORITY. PROVIDE QUALITY WORKMANSHIP.

2. MINIMIZE ANY DISTURBANCE TO EXISTING UTILITY SERVICES DURING CONSTRUCTION.

3. PROVIDE 3.0 FEET MINIMUM COVER.

4. WATER MAINS SHALL BE ASTM 2241 SDR 21 OR EQUAL.

5. WATER LINES SHALL BE D.I.P. CLASS 52 AS A MINIMUM. INSTALL WATER BOXES BEYOND THE CURB LINE AND STUB THE SERVICE LINE. THE COUNTY SHALL INSTALL THE

6. MAKE ALL PIPE JOINTS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.

PRESSURE TEST THE WATER MAINS AT TWO TIMES THE WORKING PRESSURE FOR AT LEAST TWO HOURS WITH NO LEAKAGE.

8. LOCATE AND UNCOVER VALVE VAULTS AFTER PAVING

9. ALL TAPS TO EXISTING WATER UTILITIES TO BE PERFORMED BY ROANOKE COUNTY UTILITY

10. REFERENCE THE ROANOKE COUNTY UTILITY DEPARTMENT WATER AND SEWER REGULATIONS,

11. THE MAIN LINE CONNECTION TO THE EXISTING 8" WATER LINE SHALL BE A "WET TAP" PERFORMED BY ROANOKE COUNTY UTILITY. THE COORDINATION FOR THIS TAP SHALL BE DONE AT THE PRE-CONSTRUCTION MEETING. A 72 HOUR NOTIFICATION IS REQUIRED. 12. THE EXISTING WELL WILL BE REMOVED AND ABANDONED PER THE VIRGINIA DEPARTMENT OF

3. INDMIDUAL PRESSURE REDUCING VALVES SHALL BE INSTALLED MEETING THE CONFIGURATION OF WDD-03 OF THE WATER AND SEWER REGULATIONS.

SANITARY SEWER NOTES

SEWER PIPE SHALL BE PVC SDR-35.

HEALTH AND ROANOKE COUNTY REGULATONS.

2. ALL SANITARY LATERALS WITHIN RIGHTS-OF-WAY AND EASEMENTS SHALL BE FOUR (4) INCH DIAMETER WITH A MINIMUM GRADE OF 2.08%, (1/4":1'). MATERIAL TO BE PVC SDR-35. THE COUNTY SHALL TAP THE EXISTING SANITARY LINE AND BRING LATERAL TO THE RIGHT-OF-WAY LINE; HOWEVER, THE COUNTY MAY ALLOW THE CONTRACTOR TO DO SEWER CONNECTIONS WITH COUNTY APPROVED MATERIALS AND COUNTY

REFERENCE THE ROANOKE COUNTY UTILITY DEPARTMENT WATER AND SEWER REGULATIONS,

ROANOKE COUNTY WILL MAKE ALL TAPS TO THE EXISTING SEWER MAIN. CONTACT THE ROANOKE COUNTY UTILITY DEPARTMENT AT LEAST 2 WORKING DAYS PRIOR TO THE

REMOVE EXISTING SANITARY SEWER PER ROANOKE COUNTY AND THE VIRGINIA DEPARTMENT OF HEALTH REGULATIONS.

<u>DIMENSIONAL NOTES</u>

IN GENERAL DIMENSIONS ARE TO BOTTOM FACE OF CURB, CENTER OF PAINTED LINE,

DO NOT SCALE DIMENSIONS. IF A QUESTION CONCERNING A DIMENSION ARISES, CONTACT THE ENGINEER FOR INTERPRETATION.

PAVING NOTES

SEE PAVEMENT SECTION AT RIGHT.

SAW CUT EDGE OF EXISTING PAVEMENT WHERE NEW IS TO MEET NEW.

PROVIDE SMOOTH TRANSITION FROM EXISTING TO NEW PAVEMENT AND CURB. THE PAVEMENT DESIGN SHOWN IS BASED ON A SUBGRADE RATING OF CBR 10 OR GREATER. SHOULD THE ACTUAL SUB GRADE CBR VALUES BE LESS THAN 10, AN

DO NOT LAY PAVEMENT BASE STONE UNTIL ALL UTILITIES, INCLUDING STORM SEWER, ARE IN PLACE.

ALTERNATE PAVEMENT DESIGN MUST BE APPROVED BY THE COUNTY OF ROANOKE.

GENERAL UTILITY NOTES

1. SUPPLY AND INSTALL ALL MATERIALS AND METHODS FOR WATERLINES, SANITARY SEWERS AND STORM DRAINAGE IN ACCORDANCE WITH THE SPECIFICATIONS AND REQUIREMENTS OF ROANOKE COUNTY AND THE VIRGINIA DEPARTMENT OF TRANSPORTATION "ROAD AND BRIDGE STANDARDS AND SPECIFICATIONS", LATEST

OBTAIN ALL REQUIRED PERMITS AND NOTIFY APPROPRIATE OFFICIALS 48 HOURS PRIOR TO COMMENCEMENT OF WORK. OBTAIN INFORMATION FROM ROANOKE COUNTY CONCERNING PERMITS AND CONNECTIONS TO EXISTING LINES.

ALL WORK SHALL BE SUBJECT TO INSPECTION BY ROANOKE COUNTY. NOTIFY APPROPRIATE OFFICIALS PRIOR TO COMMENCEMENT OF WORK.

SITE SHALL BE TO SUB GRADE PRIOR TO INSTALLATION OF UTILITIES. ALL UTILITIES SHALL BE IN PLACE PRIOR TO PLACEMENT OF PAVEMENT BASE MATERIAL.

5. USE SELECT MATERIAL FREE FROM FROST, LARGE CLODS, STONES, AND DEBRIS FOR BACK FILL FROM THE BOTTOM OF THE TRENCH TO TWELVE (12) INCHES ABOVE THE

6. MINIMIZE ANY DISTURBANCE TO EXISTING WATER SERVICE, SEWER LINES OR ANY other utility during construction and provide quality workmanship

MAKE ALL PIPE JOINTS IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS AND THE COUNTY'S SPECIFICATIONS. MAKE JOINTS BETWEEN DIFFERENT PIPE MATERIALS WITH STANDARD FITTINGS MANUFACTURED FOR THE PURPOSE.

MAINTAIN ALL WATER LINES AT TEN (10) FEET HORIZONTAL SEPARATION FROM SEWER LINES AND MANHOLES; MEASURE THE DISTANCE EDGE-TO-EDGE. WHEN LOCAL CONDITIONS PREVENT THE DESIRED HORIZONTAL SEPARATION, THE WATERLINE MAY BE LAID CLOSER TO THE SEWER OR MANHOLE PROVIDED THAT THE BOTTOM OF THE Waterline shall be at least eighteen (18) inches above the top of the sewer. WHERE THIS VERTICAL SEPARATION CANNOT BE OBTAINED, CONSTRUCT THE SEWER OF AWWA APPROVED WATER PIPE AND PRESSURE TREAT IN PLACE PRIOR TO BACKFILLING. THE SEWER MANHOLE SHALL BE OF WATERTIGHT CONSTRUCTION TESTED IN PLACE.

SEWER AND WATER TAPS SHALL BE LOCATED BY THE CONTRACTOR AND MADE BY THE COUNTY AT THE DEVELOPER'S EXPENSE.

10. LOCATE AND UNCOVER VALVE VAULTS AND MANHOLES AFTER PAVING AND ADJUST TO FINAL GRADE, IF NECESSARY.

11. VERIFY THE LOCATION AND ELEVATION OF ALL UNDERGROUND UTILITIES SHOWN ON THE PLANS IN AREAS OF CONSTRUCTION PRIOR TO STARTING WORK. CONTACT THE ENGINEER IMMEDIATELY IF:

ANY LOCATION OR ELEVATION IS DIFFERENT FORM THAT SHOWN ON THE

IF THERE APPEARS TO BE ANY CONFLICT.

UPON DISCOVERY OF ANY UTILITY NOT SHOWN ON THE PLANS.

TO MISS UTILITIES, CALL "MISS UTILITY" OF VIRGINIA (TOLL FREE 1-800-552-7001) 48 HOURS BEFORE YOU DIG. THE CONTRACTOR IS RESPONSIBLE FOR ALL DAMAGE CAUSED TO ANY UTILITY, PUBLIC OR PRIVATE, AS A RESULT OF THIS WORK. EXISTING UTILITY LOCATIONS SHOWN ARE A RESULT OF A COMBINATION OF EXISTING INFORMATION AND FIELD LOCATION OF SURFACE FEATURES. LOCATIONS ARE APPROXIMATE.

12. REPAIR ALL DAMAGE CAUSED TO ANY UTILITY, PUBLIC OR PRIVATE, AS A RESULT OF THIS WORK AT NO ADDITIONAL COST TO OWNER.

13. PROVIDE A CONTINUOUS AND UNIFORM BEDDING IN THE TRENCH FOR ALL PIPE. REMOVE STONES AND ROCKS FOUND IN THE TRENCH FOR A DEPTH OF AT LEAST SIX (6) INCHES BELOW THE BOTTOM OF THE PIPE AND TAMP SELECT FILL BEDDING PROVIDED. AFTER THE PIPE HAS BEEN PLACED IN THE TRENCH, BACK FILL THE TRENCH WITH SELECT MATERIAL, THOROUGHLY COMPACT TO 90% (95% UNDER PAVEMENT OR CONCRETE SLAB) OF THE STANDARD PROCTOR (ASTM D-698) USING CARE NOT TO DAMAGE THE PIPE. USE VDOT STANDARD PB-1 TRENCH FOR STORM SEWER AND UB-1 FOR SANITARY SEWER AND WATER.

14. PLACE BACK FILL FOR ALL UTILITIES IN ACCORDANCE WITH THE COUNTY'S SPECIFICATIONS, AND THE FOLLOWING CRITERIA:

(1) BACK FILL NO TRENCH UNTIL AUTHORIZED BY THE COUNTY. MATERIALS USED FOR BACK FILL FROM THE BOTTOM OF THE TRENCH TO TOP OF THE PIPE SHALL BE CRUSHER RUN, OR APPROVED EQUAL MATERIAL. THOROUGHLY AND CAREFULLY COMPACT THE BACK FILL MATERIAL.

(2) COMPACT BACK FILL BY MECHANICAL TAMPING THROUGHOUT THE DEPTH OF THE TRENCH TO INSURE A SUITABLE SUBBASE ACCEPTABLE TO THE ROAD ENGINEER. IF THE MATERIAL TAKEN FROM THE DITCH IS NOT SUITABLE FOR BACK FILLING, REMOVE IT AND USE AN ACCEPTABLE MATERIAL. FOR BACK FILLING

15. IN AREAS OF WATER LINE CONSTRUCTION, GRADES SHALL BE WITHIN SIX (6) INCHES OF FINISHED SUB GRADE PRIOR TO THE COMMENCEMENT OF THIS WORK

16. MINIMUM COVER OVER WATER AND SANITARY SEWER LINES SHALL BE THREE (3) FEET.

17. THE COUNTY OF ROANOKE SHALL MAKE ALL CONNECTIONS TO EXISTING WATER MAINS.
NOTIFY ROANOKE COUNTY UTILITY DEPARTMENT TWO WORKING DAYS PRIOR TO WHEN THE TAP is needed.

18. THE CONTRACTOR SHALL INSTALL ALL WATER SERVICE CONNECTIONS AND METER BOXES.

19. PIPES AND FITTINGS SHALL BE POLYVINYL

20. CONNECT PIPE TO MANHOLES THROUGH PRE CAST OPENINGS AND JOIN WITH EITHER A FLEXIBLE BOOT ADAPTER OR A PIPE SEAL GASKET.

21. MAKE RESIDENTIAL SERVICE CONNECTIONS WITH A FOUR (4) INCH PIPE THROUGH A WYE OR TEE-WYE BRANCH FITTING AND SHALL BE INSTALLED ON A MINIMUM GRADE OF ONE-QUARTER (1/4) INCH PER ONE (1) FOOT FROM THE SEWER PIPE OR MANHOLE TO THE PROPERTY OR EASEMENT LINE WHERE A CLEANOUT SHALL BE PLACED AND THE SERVICE LATERAL PLUGGED / CAPPED UNTIL EXTENSION.

22. FIELD MARK FUTURE SERVICE CONNECTIONS BY A TREATED, SOLID WOODED (2"X4") warker three (3) feet long set vertically plumb with the end of the capped EXTENSION. PAINT THE TOPS OF THE MARKERS YELLOW AND SET FLUSH WITH THE FINISHED GRADE. SHOW THE LOCATION AND INVERT DEPTH OF THE SERVICE CONNECTION

23. A MINIMUM VERTICAL SEPERATION AT ALL UTILITY CROSSINGS WILL BE 1.5 FEET.


VDOT GENERAL NOTES

VDOT APPROVAL OF SUBDIVISION ROAD PLANS DOES NOT PRECLUDE THE RIGHT TO ADD ADDITIONAL FACILITIES SUCH AS SEEDING, PAVING, SEDIMENT CONTROL ITEMS, ETC., AS MAY BE DEEMED NECESSARY BY THE DEPARTMENT PRIOR TO THE ACCEPTANCE OF SUCH ROADS N ORDER TO LIMIT SILTATION AND POLLUTION OF NEARBY LAKES, PONDS, STREAMS, AND

THE DEPARTMENT'S APPROVAL OF THESE PLANS EXPIRES THREE YEARS FROM DATA


IT WILL BE THE DEVELOPERS RESPONSIBILITY TO REPLACE OR REPAIR ANY EXISTING STRUCTURES THAT MAY BE DAMAGED WHEN THE NEW STRUCTURES ARE CONNECTED TO


THE CHANNEL AT THE OUTFALL OF THE EXISTING 36" CONCRETE PIPE WILL BE FIELD REVIEWED DURING AND AFTER CONSTRUCTION. IF EROSION OR SCOUR IS OCCURRING IT MILL BE THE DEVELOPER'S RESPONSIBILITY TO TAKE APPROPRIATE REMEDIAL ACTION.



GRADING NOTES

PAVEMENT SECTION

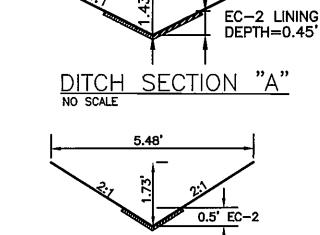

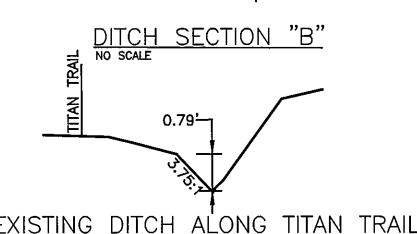

1. REMOVE TREES, SHRUBS, GRASS, AND OTHER VEGETATION, IMPROVEMENTS OR OBSTRUCTIONS AS REQUIRED TO PERMIT INSTALLATION OF NEW CONSTRUCTION. REMOVE TREES AND OTHER VEGETATION, INCLUDING STUMPS AND ROOTS, COMPLETELY IN AREAS REQUIRED FOR SUBSEQUENT SEEDING. CUT OFF TREES AND STUMPS IN AREAS TO RECEIVE FILL MORE THAN THREE FEET IN DEPTH TO WITHIN

BARRICADE OPEN EXCAVATIONS OCCURRING AS PART OF THIS WORK AND OPERATE WARNING LIGHTS AS RECOMMENDED BY AUTHORITIES HAVING JURISDICTION.

EIGHT INCHES OF THE ORIGINAL GROUND SURFACE.

CUT SURFACE UNDER PAVEMENTS TO COMPLY WITH CROSS SECTIONS, ELEVATIONS, AND GRADES AS INDICATED.

EXCAVATE TRENCHES TO UNIFORM WIDTH CONFORMING TO VDOT STANDARD PB-1 FOR STORM DRAINAGE PIPING. BACKFILL TRENCHES WITH CONTROLLED FILL.

PREVENT SURFACE WATER AND SUBSURFACE OR GROUND WATER FROM FLOWING INTO EXCAVATIONS AND FROM FLOODING PROJECT SITE AND SURROUNDING AREA. DO NOT ALLOW WATER TO ACCUMULATE IN EXCAVATIONS. REMOVE WATER TO PREVENT SOFTENING OF FOUNDATION BOTTOMS, UNDERCUTTING FOOTINGS, AND SOIL CHANGES DETRIMENTAL TO STABILITY OF SUBGRADES AND FOUNDATIONS. CONVEY WATER REMOVED FROM EXCAVATIONS AND RAIN WATER TO COLLECTING OR RUNOFF AREAS ESTABLISH AND MAINTAIN TEMPORARY DRAINAGE DITCHES AND OTHER DIVERSIONS OUTSIDE EXCAVATION LIMITS FOR EACH STRUCTURE. DO NOT USE TRENCH EXCAVATIONS AS TEMPORARY DITCHES.

PROTECT EXCAVATED BOTTOMS OF ALL FOOTINGS AND TRENCHES AGAINST FREEZING WHEN ATMOSPHERIC TEMPERATURE IS LESS THEN 35°F (1°C).

UNIFORMLY GRADE AREAS WITHIN LIMITS OF GRADING INCLUDING ADJACENT TRANSITION AREAS. SMOOTH FINISHED SURFACES WITHIN SPECIFIED TOLERANCES, COMPACT WITH UNIFORM LEVELS OR SLOPES BETWEEN POINTS WHERE ELEVATIONS ARE SHOWN, OR BETWEEN SUCH POINTS AND EXISTING GRADES. GRADE AREAS ADJACENT TO BUILDING LINES TO DRAIN AWAY FROM STRUCTURES AND TO PREVENT

FINISH LAWN AREAS TO WITHIN ONE INCH ABOVE OR BELOW REQUIRED SUBGRADE ELEVATIONS. SHAPE SURFACE UNDER WALKS AND PAVEMENTS TO LINE, GRADE, AND CROSS SECTION, WITH NOT MORE THAN 1/2" ABOVE OR BELOW REQUIRED SUBGRADE

PROTECT GRADED AREAS FROM TRAFFIC AND EROSION. REPAIR AREAS WHICH HAVE SETTLED, ERODED, OR BECOME DAMAGED DUE TO CONSTRUCTION ACTIVITIES AT NO ADDITIONAL COST TO OWNER.

10. PLACE ALL FILL AND BACKFILL AS CONTROLLED FILL AS FOLLOWS: ESTABLISH SUITABLE SUBGRADE CONDITIONS PRIOR TO PLACING FILL BY

PROOFROLLING, UNDERCUTTING AND COMPACTING AS NECESSARY. PLACE FILL MATERIALS IN LAYERS NOT MORE THAN 8" IN LOOSE DEPTH FOR

HEAVY COMPACTION EQUIPMENT, AND NOT MORE THAN 4" FOR HAND TAMPERS. PRIOR TO COMPACTION, PROVIDE MOISTURE CONTENT TO WITHIN 3% OF OPTIMUM BY MOISTENING OR AERATING EACH LAYER. DO NOT PLACE FILL MATERIAL ON SURFACES WHICH ARE MUDDY, FROZEN OR CONTAIN FROST OR

COMPACT SOIL TO NOT LESS THAN THE FOLLOWING PERCENTAGES OF MAXIMUM DRY DENSITY IN ACCORDANCE WITH ASTM D 698 (STANDARD

i. 95% UNDER PAVEMENT ii. 85% under lawn or unpaved areas

11. SPREAD TOPSOIL TO A DEPTH OF 4" OVER ALL DISTURBED AREAS NOT RECEIVING WALKS OR PAVEMENT, INCLUDING TRENCHES. IMMEDIATELY FOLLOWING PLACEMENT OF TOPSOIL, DISK THE ENTIRE TOPSOILED AREA AND RAKE FREE OF STONES AND DEBRIS OVER 1/2" IN ANY DIMENSION. PROVIDE A FINISHED SURFACE FREE OF DEPRESSIONS OR HIGH SPOTS. SEED IMMEDIATELY.

12. OWNER (CONTRACTOR) SHALL EMPLOY QUALIFIED SOILS TESTING LABORATORY TO INSPECT EARTHWORK OPERATIONS. NOTIFY LABORATORY PRIOR TO PERFORMING

13. NO WORK WILL BE ALLOWED IN THE EXISTING DRAINAGE SWALE IF WATER IS FLOWING. DRAINAGE STRUCTURES 1,2,5,6,&7 MUST BE INSTALLED PRIOR TO ALL OTHER CONSTRUCTION.

SITE SUMMARY

BARBARA W. BOVA 4919 PLEASANT HILL DRIVE ROANOKE, VA

DEVELOPER: AL COOPER 4430 OLD CAVE SPRING ROAD ROANOKE. VA 24073 540-537-2339

TAX MAP NUMBER: 86.08-4-29

ZONING: R2 ZERO LOT LINE OPTION

MINIMUM LOT SIZE REQUIRED: 5,760 SF


MINIMUM LOT FRONTAGE REQUIRED: 48.0'

LOT FRONTAGE PROVIDED: 55.0' SETBACKS: FRONT 24' SIDE 10'

MAXIMUM BUILDING COVERAGE: 30% MAXIMUM LOT COVERAGE: MAXIMUM BUILDING HEIGHT: SIGNAGE ALLOWED: 30 SF

A SEPERATE PERMIT WILL BE REQUIRED

REAR 25'

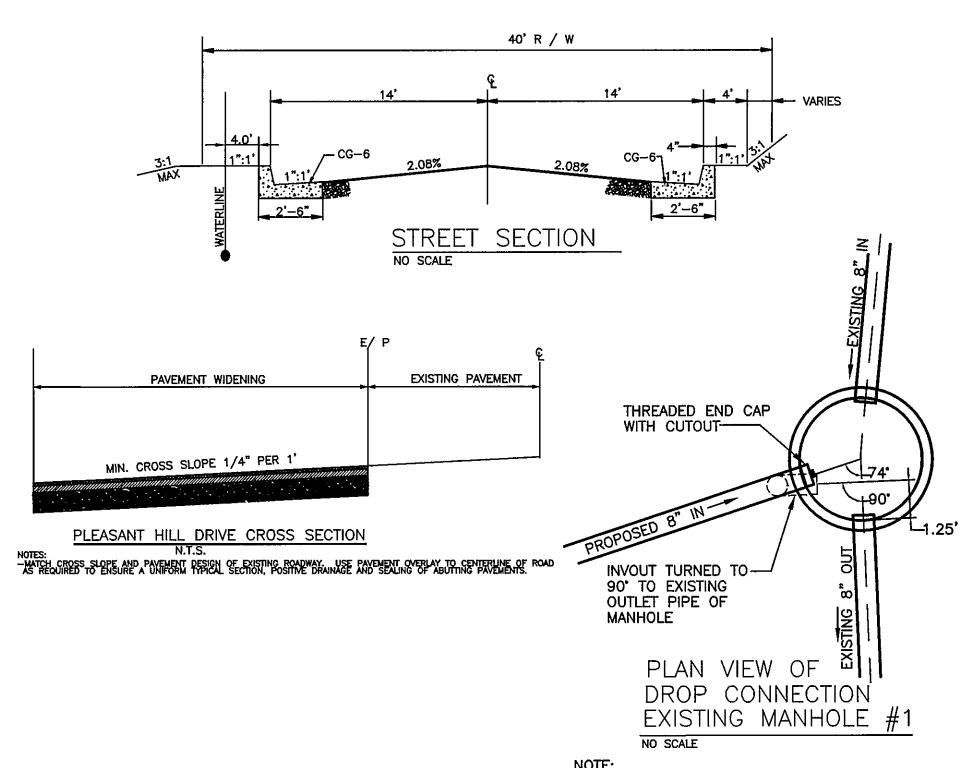

REFER TO ROANOKE COUNTIES WATER AND SEWER STANDARDS FOR MATERIAL SPECIFICATIONS.

EROSION & SEDIMENT CONTROL NOTES

PROVIDE CONSTRUCTION MATERIALS AND METHODS IN ACORDANCE WITH ALL STATE AND LOCAL REGULATIONS, INCLUDING THE STANDARDS AND SPECIFICATIONS OF THE "VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK", LATEST EDITION. REFER TO THIS HANDBOOK FOR DETAILS AND SPECIFICATIONS OF EROSION CONTROL DEVICES.

2. SCHEDULE A PRECONSTRUCTION MEETING INVOLVING THE ENGINEER, DEVELOPER'S REPRESENTATIVE AND SELECTED CONTRACTOR ON SITE PRIOR TO BEGINNING

3. ADHERE TO THE EROSION AND SEDIMENT CONTROL NARRATIVE AS PART OF THIS CONTRACT. INSTALL EROSION CONTROL DEVICES AS PER THE NARRATIVE/PLAN. 4. NOTIFY THE PROJECT ENGINEER WHEN THE LOCAL GOVERNING OFFICIAL HAS INSPECTED AND APPROVED ALL IN-PLACE EROSION AND SEDIMENT CONTROL DEVICES,

REQUIRED BY LOCAL ORDINANCES TO BE IN PLACE PRIOR TO LAND DISTURBANCE. 5. NOTIFY THE PROJECT ENGINEER 24 HOURS IN ADVANCE OF BEGINNING CLEARING AND GRADING OPERATIONS.

6. DISPOSE OF EXCESS EXCAVATION, AS WELL AS ALL ORGANIC MATTER AND DEBRIS, OFF SEED AND MULCH OR TEMPORARILY STABILIZE ALL DENUDED AREAS WITHIN SEVEN DAYS OF DISTURBANCE. SEED TRENCHES IMMEDIATELY FOLLOWING BACKFILL.

8. REMOVE ALL DEMOLISHED MATERIAL FROM THE PROJECT SITE AND DISPOSE OF IN AN ACCEPTABLE LOCATION.

REINSTALL ANY STRUCTURE(S) RELOCATED AND/OR REMOVED DURING THE INSTALLATION OF THE PROPOSED IMPROVEMENTS AT NO ADDITIONAL COST TO OWNER.

10. INSPECT ESC MEASURES WEEKLY AND AFTER EACH RAINFALL TO INSURE PROPER

11. AVOID CONSTRUCTION TRAFFIC IN NATURAL STREAMS AND DRAINAGE WAYS WHENEVER POSSIBLE. 12. REMOVE ALL SILT FROM STREAMS AND DRAINAGE WAYS PRIOR TO BOND RELEASE.

<u>EROSION AND SEDIMENT CONTROL NARRATIVE</u>

EXISTING SITE CONDITIONS

THE PROJECT CONSISTS OF 20 SINGLE FAMILY LOTS. PUBLIC UTILITIES ARE PLANNED. TOTAL PROJECT AREA IS 4.91 ACRES. TOTAL DISTURBED AREA IS APPROXIMATELY 4.7 ACRES.

THE EXISTING SITE CONTAINS A SINGLE FAMILY DWELLING WITH A BARN AND PASTURE.

ADJACENT PROPERTIES

ADJACENT PROPERTIES ARE ZONED FOR RESIDENTIAL USE.

THE EXISTING DITCH ALONG TITAN TRAIL WILL CONTINUE TO RECEIVE RUNOFF FROM THIS SITE.

ON SITE SOILS WERE IDENTIFIED ON THE "GENERALIZED SOIL PARENT MATERIAL MAP" OF ROANOKE VIRGINIA. SOILS IN THIS AREA ARE GENERALLY IDENTIFIED AS 5C, CHISWELL-LITZ COMPLEX.

CRITICAL EROSION AREAS THE CREEK BANKS WILL NEED TO BE STABILIZED AS SOON GRADING IS COMPLETE.

MANAGEMENT STRATEGIES

CONSTRUCTION WILL BE SEQUENCED SO THAT GRADING OPERATIONS CAN BEGIN AND END AS QUICKLY AS POSSIBLE. THE GRAVEL CONSTRUCTION ENTRANCE WILL BE INSTALLED AS A FIRST STEP IN CONSTRUCTION.

OTHER MEASURES WILL BE INSTALLED AS WORK PROGRESSES INTO THOSE AREAS.

TEMPORARY SEEDING OR OTHER STABILIZATION WILL FOLLOW IMMEDIATELY AFTER GRADING.
THE JOB SUPERINTENDENT SHALL BE RESPONSIBLE FOR THE INSTALLATION AND MAINTENANCE OF ALL EROSION AND SEDIMENT AFTER ACHIEVING ADEQUATE STABILIZATION, THE TEMPORARY EROSION AND SEDIMENT CONTROL MEASURES WILL BE CLEANED AND REMOVED.

PERMANENT STABILIZATION

ALL AREAS DISTURBED BY CONSTRUCTION WHICH DO NOT RECEIVE PAVING SHALL BE STABILIZED WITH PERMANENT SEEDING AS SPECIFIED. ALL SEEDING SHALL BE TACKED AND MULCHED AND PLACED IMMEDIATELY AFTER REACHING FINISHED GRADE. THE ROADWAY AREA SHALL RECEIVE PAVING.

STORMWATER MANAGEMENT

A STORMWATER MANAGEMENT FACILITY IS PLANNED FOR THIS DEVELOPMENT

IN GENERAL, ALL EROSION AND SEDIMENT CONTROL MEASURES WILL BE CHECKED DAILY AND AFTER EACH SIGNIFICANT RAINFALL. IN

SILT FENCE WILL BE CHECKED REGULARLY FOR UNDERMINING OR DETERIORATION OF THE FABRIC. SEDIMENT SHALL BE REMOVED WHEN THE LEVEL OF SEDIMENT DEPOSITION REACHES HALFWAY TO THE TOP OF THE BARRIER.
 THE SEEDED AREAS WILL BE CHECKED REGULARLY TO ENSURE THAT A GOOD STAND IS MAINTAINED. AREAS SHOULD BE FERTILIZED AND RESEEDED AS NEEDED.

'roger I. Sturgill' No. 033058

ENGINEERS • SURVEYORS 1208 Corporate Circle Roanoke, Virginia 24018 Phone: 540/772-9580

REFLECTING TOMORROV

PLANNERS • ARCHITECTS

501 Branchway Road Richmond, Virginia 23233 Phone 604/794-0571 FAX 804/794-2635

880 Technology Park Drive

Glen Allen, Virginia 23059

Phone 804/553-0132

FAX 804/553-0133

Suite 200

FAX: 540/772-8050

102 Hubbard Street Blacksburg, Virginia 24060 Phone 540/961-0961 FAX 540/961-0962

9

DRAWN BY: DRB DESIGNED BY: DRB CHECKED BY: SMH

DATE: FEB. 7, 2003 **REVISIONS:** 03-24-03 04-18-03 05-12-03 05-27-03

08-12-03

SCALE: AS NOTED

SHEET NO.

JOB NO. R0200205.00