

115AIR2	05-04-90	16:26	CWK
---------	----------	-------	-----

Power Poles Property of APCO, Roanoke, Va.
Telephone Poles & Underground Cable Property of C&P Telephone Co., Roanoke, Va.
Water Lines Property of City of Roanoke, Roanoke, Va.
Sewer Lines Property of Roanoke County, Salem, Va.
Gas Lines Property of Roanoke Gas Co., Roanoke, Va.

MATCH LINE STA 156+00 SHEET 3

MATCH LINE

1. The first step in the process is to identify the problem or issue that needs to be addressed. This involves gathering information and understanding the context of the problem.


165

FOR UTILITY ADJUSTMENTS ONLY 170


170

DESIGN FEATURES RELATING TO CONSTRUCTION
OR TO REGULATION AND CONTROL OF TRAFFIC
MAY BE SUBJECT TO CHANGE AS DEEMED
NECESSARY BY THE DEPARTMENT

REVISED	FHWA REGION	STATE	FEDERAL AID		STATE		SHEET NO.
			PROJECT	ROUTE	PROJECT		
	3	VA.		115	0115-020-103, PE-102 RW-202 C-501		6(5)

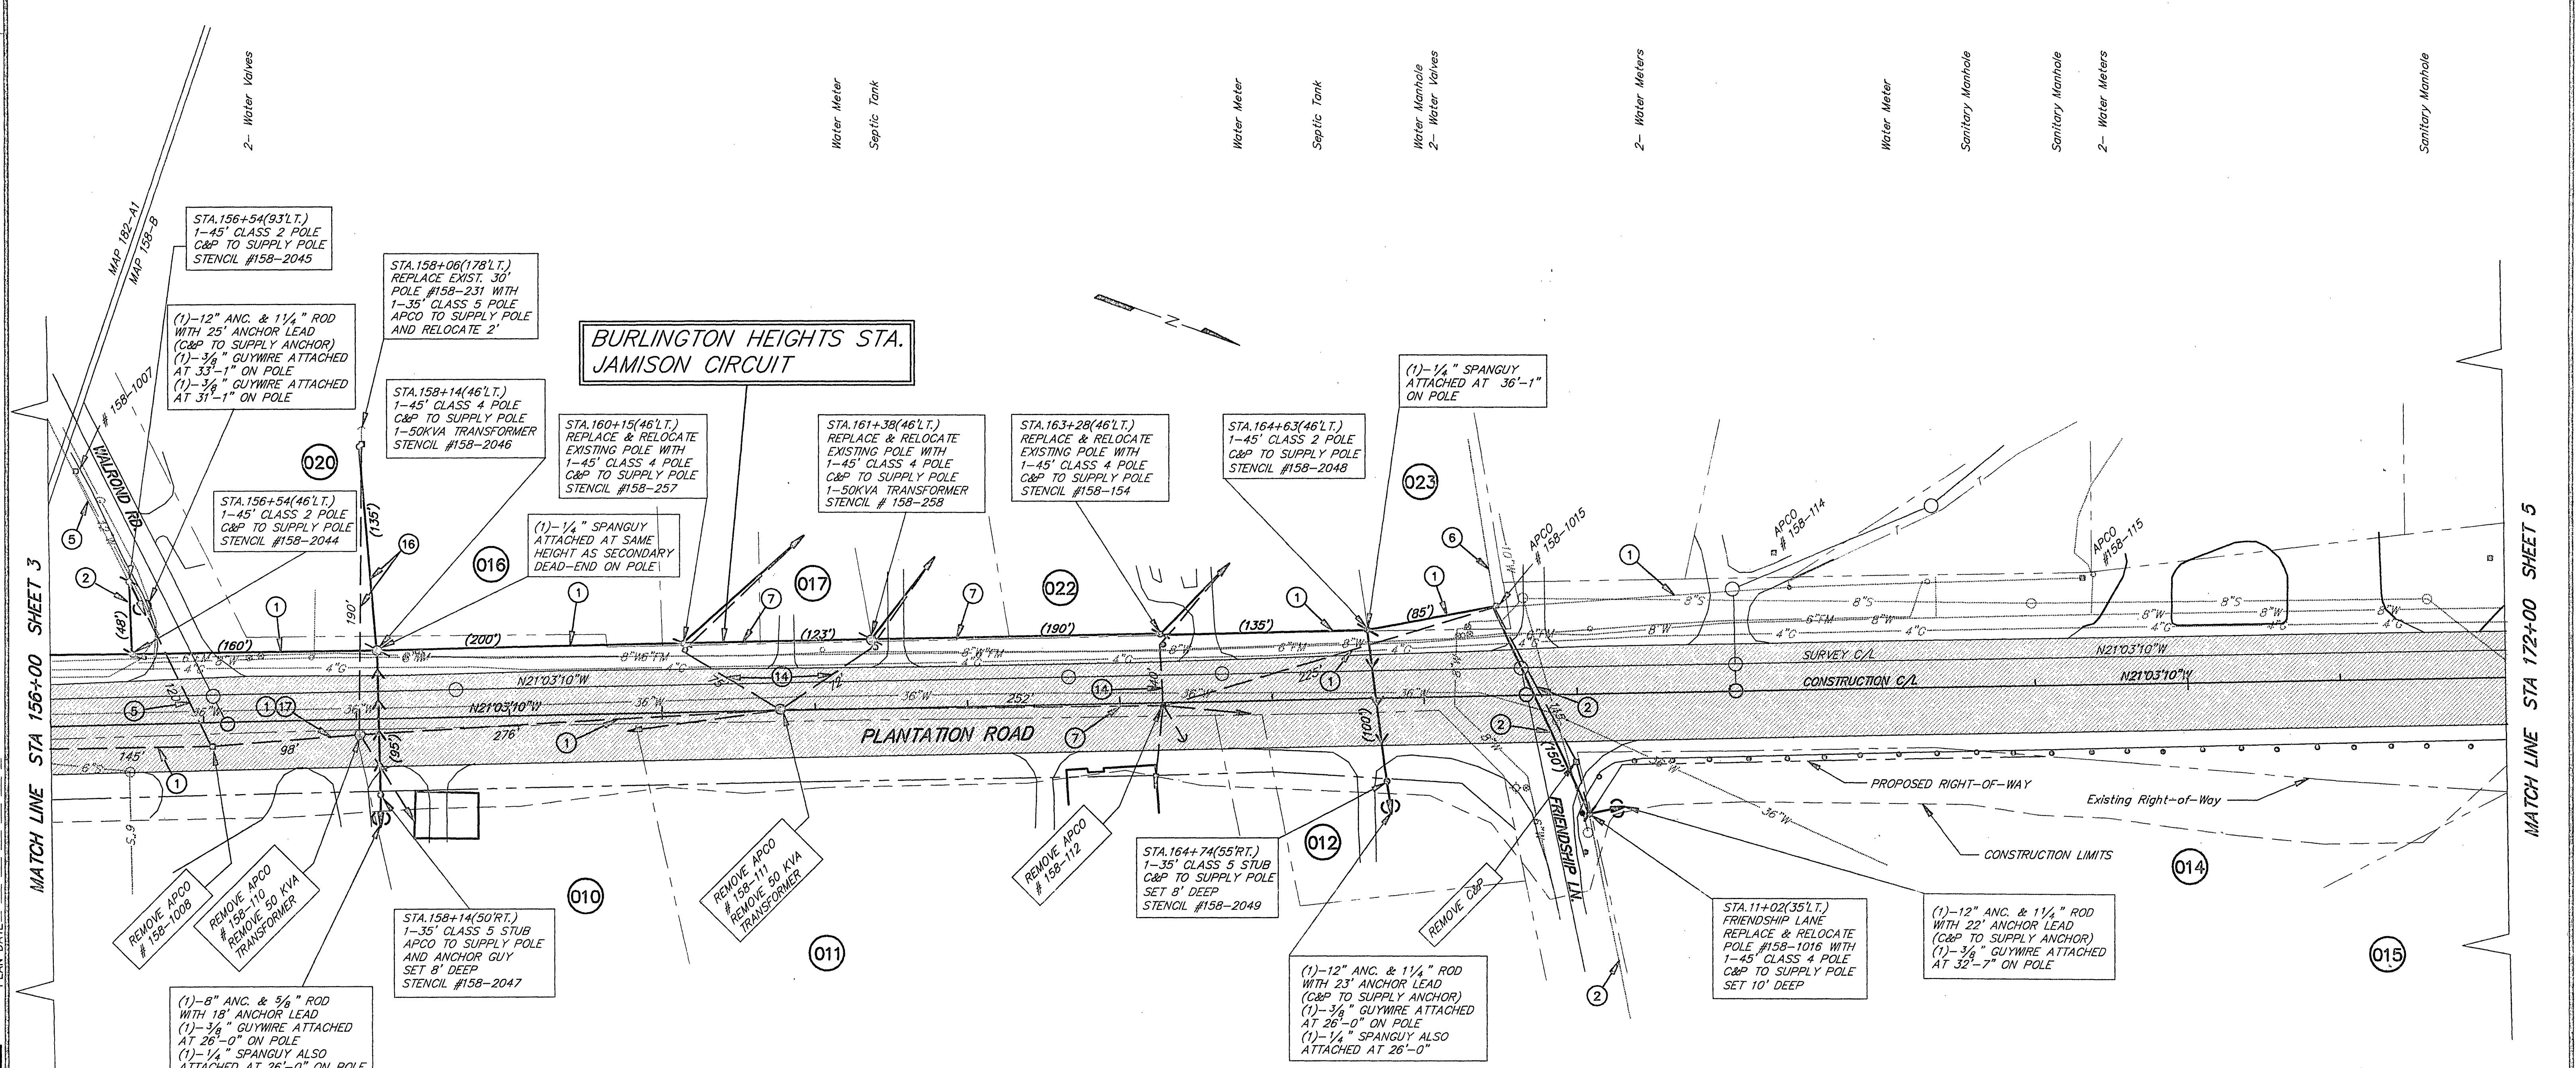

CONDUCTOR DATA			
SYM	PRIMARY	KV	SECONDARY
1	3- #556.5 KCM. B. AL.		
2	1- #4/O B. AA.	34.5	
3	4- #2 B. AA.	34.5	
4	3- #1/O B. ASCR	34.5	#4/0-3 COND. AL. LASHED
5	4- #1/O B. ASCR	34.5	
6	4- #2 B. ASCR	34.5	
7	2- #6 B. CU	34.5	
8	1- #2 B. AA.	34.5	
9	3- #556 5 KCM B. AL.	34.5	#4/0-3 COND. AL. LASHED
10			
11	2- #2 B. ASCR	19.9	
12	1- #2 B. ASCR	19.9	#1/0-3 COND. AL. LASHED
13			
14			#4/2 COND. AL. TWST
15			#2/3 COND. AL. TWST
16			1-#2 B. AA.
17			#4/0-3 COND. AL. LASHED
18			1- #4B. ACSR

<i>APCO FACILITIES LEGEND</i>	
	EXISTING LINE TO REMAIN EXISTING LINE TO BE REMOVED PROPOSED LINE TO BE INSTALLED EXISTING SPAN GUY SPAN GUY TO BE REMOVED SPAN GUY TO BE INSTALLED EXISTING POLE TO REMAIN POLE TO BE REMOVED POLE TO BE INSTALLED OR REPLACED EXISTING TRANSFORMER(S) TO REMAIN EXISTING TRANSFORMER(S) TO BE REMOVED PROPOSED TRANSFORMER(S) TO BE INSTALLED EXISTING ANCHOR TO REMAIN EXISTING ANCHOR TO BE REMOVED PROPOSED ANCHOR TO BE INSTALLED EXISTING SERVICE TO REMAIN EXISTING SERVICE TO BE REMOVED PROPOSED SERVICE TO BE INSTALLED

