

ROUTE 115
AERIAL UTILITY RELOCATIONS
UN 7-21.7


115AIR2 05-04-90 15:30 CWK

ANDERSON
AND
ASSOCIATES, Inc.
Buckhams
Virginia

Power Poles Property of APCO, Roanoke, Va.
Telephone Poles & Underground Cable Property of C&P Telephone Co., Roanoke, Va.
Water Lines Property of City of Roanoke, Roanoke, Va.
Sewer Lines Property of Roanoke County, Salem, Va.
Gas Lines Property of Roanoke Gas Co., Roanoke, Va.

DESIGN FEATURES RELATING TO CONSTRUCTION
OR TO REGULATION AND CONTROL OF TRAFFIC
MAY BE SUBJECT TO CHANGE AS DEEMED
NECESSARY BY THE DEPARTMENT

REVISED	FHWA REGION	STATE	FEDERAL AID PROJECT	ROUTE	STATE PROJECT	SHEET NO.
	3	VA.		115	0115-080-103, RE-102 RW-202 C-501	6(10)

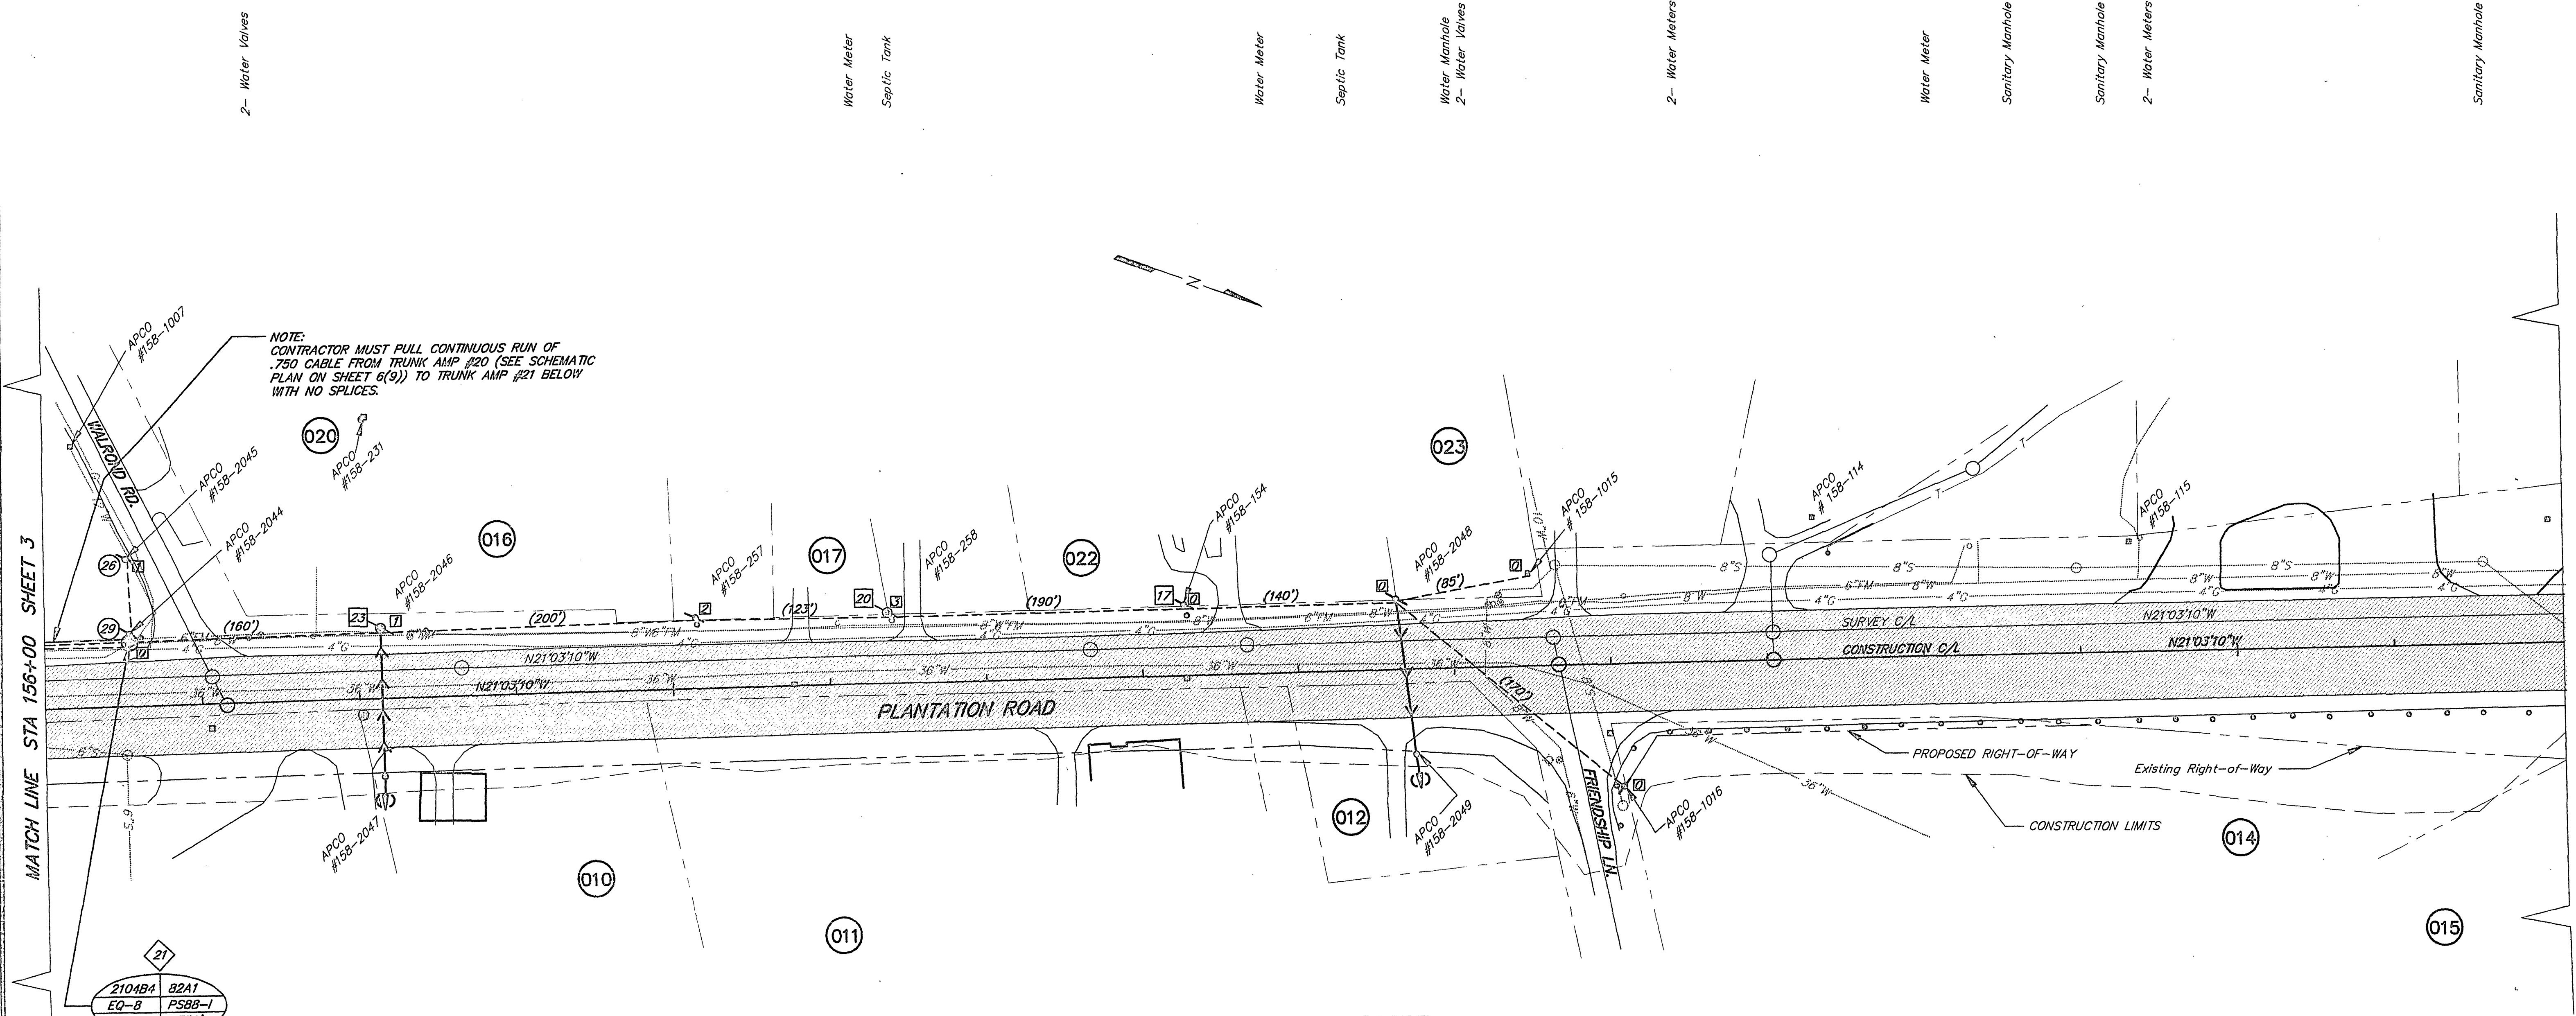

NOTE:
CONTRACTOR MUST PULL CONTINUOUS RUN OF
.750 CABLE FROM TRUNK AMP #20 (SEE SCHEMATIC
PLAN ON SHEET 6(9)) TO TRUNK AMP #21 BELOW
WITH NO SPLICES.

SUPERVISED BY: P.C. SCHWIER
DESIGNED BY: T.G. FULLEN
CADD OPERATOR: C.W. KING
REVISED BY: 04 MAY 90
PLAN DATE:

2104BA	82A1
EQ-8	PSBB-1
10.7	2330'

CABLE T.V. LEGEND

	EXISTING POLE TO REMAIN POLE TO BE REMOVED POLE TO BE INSTALLED OR REPLACED EXISTING TRANSFORMER(S) TO REMAIN EXISTING TRANSFORMER(S) TO BE REMOVED PROPOSED TRANSFORMER(S) TO BE INSTALLED SPAN GUY TO BE INSTALLED PROPOSED ANCHOR TO BE INSTALLED
	.750 CABLE .500 CABLE .412 CABLE 2-WAY SPLITTER 4-WAY TAP 2-WAY TAP
	TRUNK AMP/BRIDGER TRUNK CABLE FEEDER CABLE
	AMP INFORMATION MODEL NO. AMP NO. EQUALIZER POWERING INPUT LEVEL SPACING

PLAN		BY	DATE
NOTE BOOK			
ADJUSTMENT CHECKED			
RIGHT OF WAY CHECKED			
NO.			