


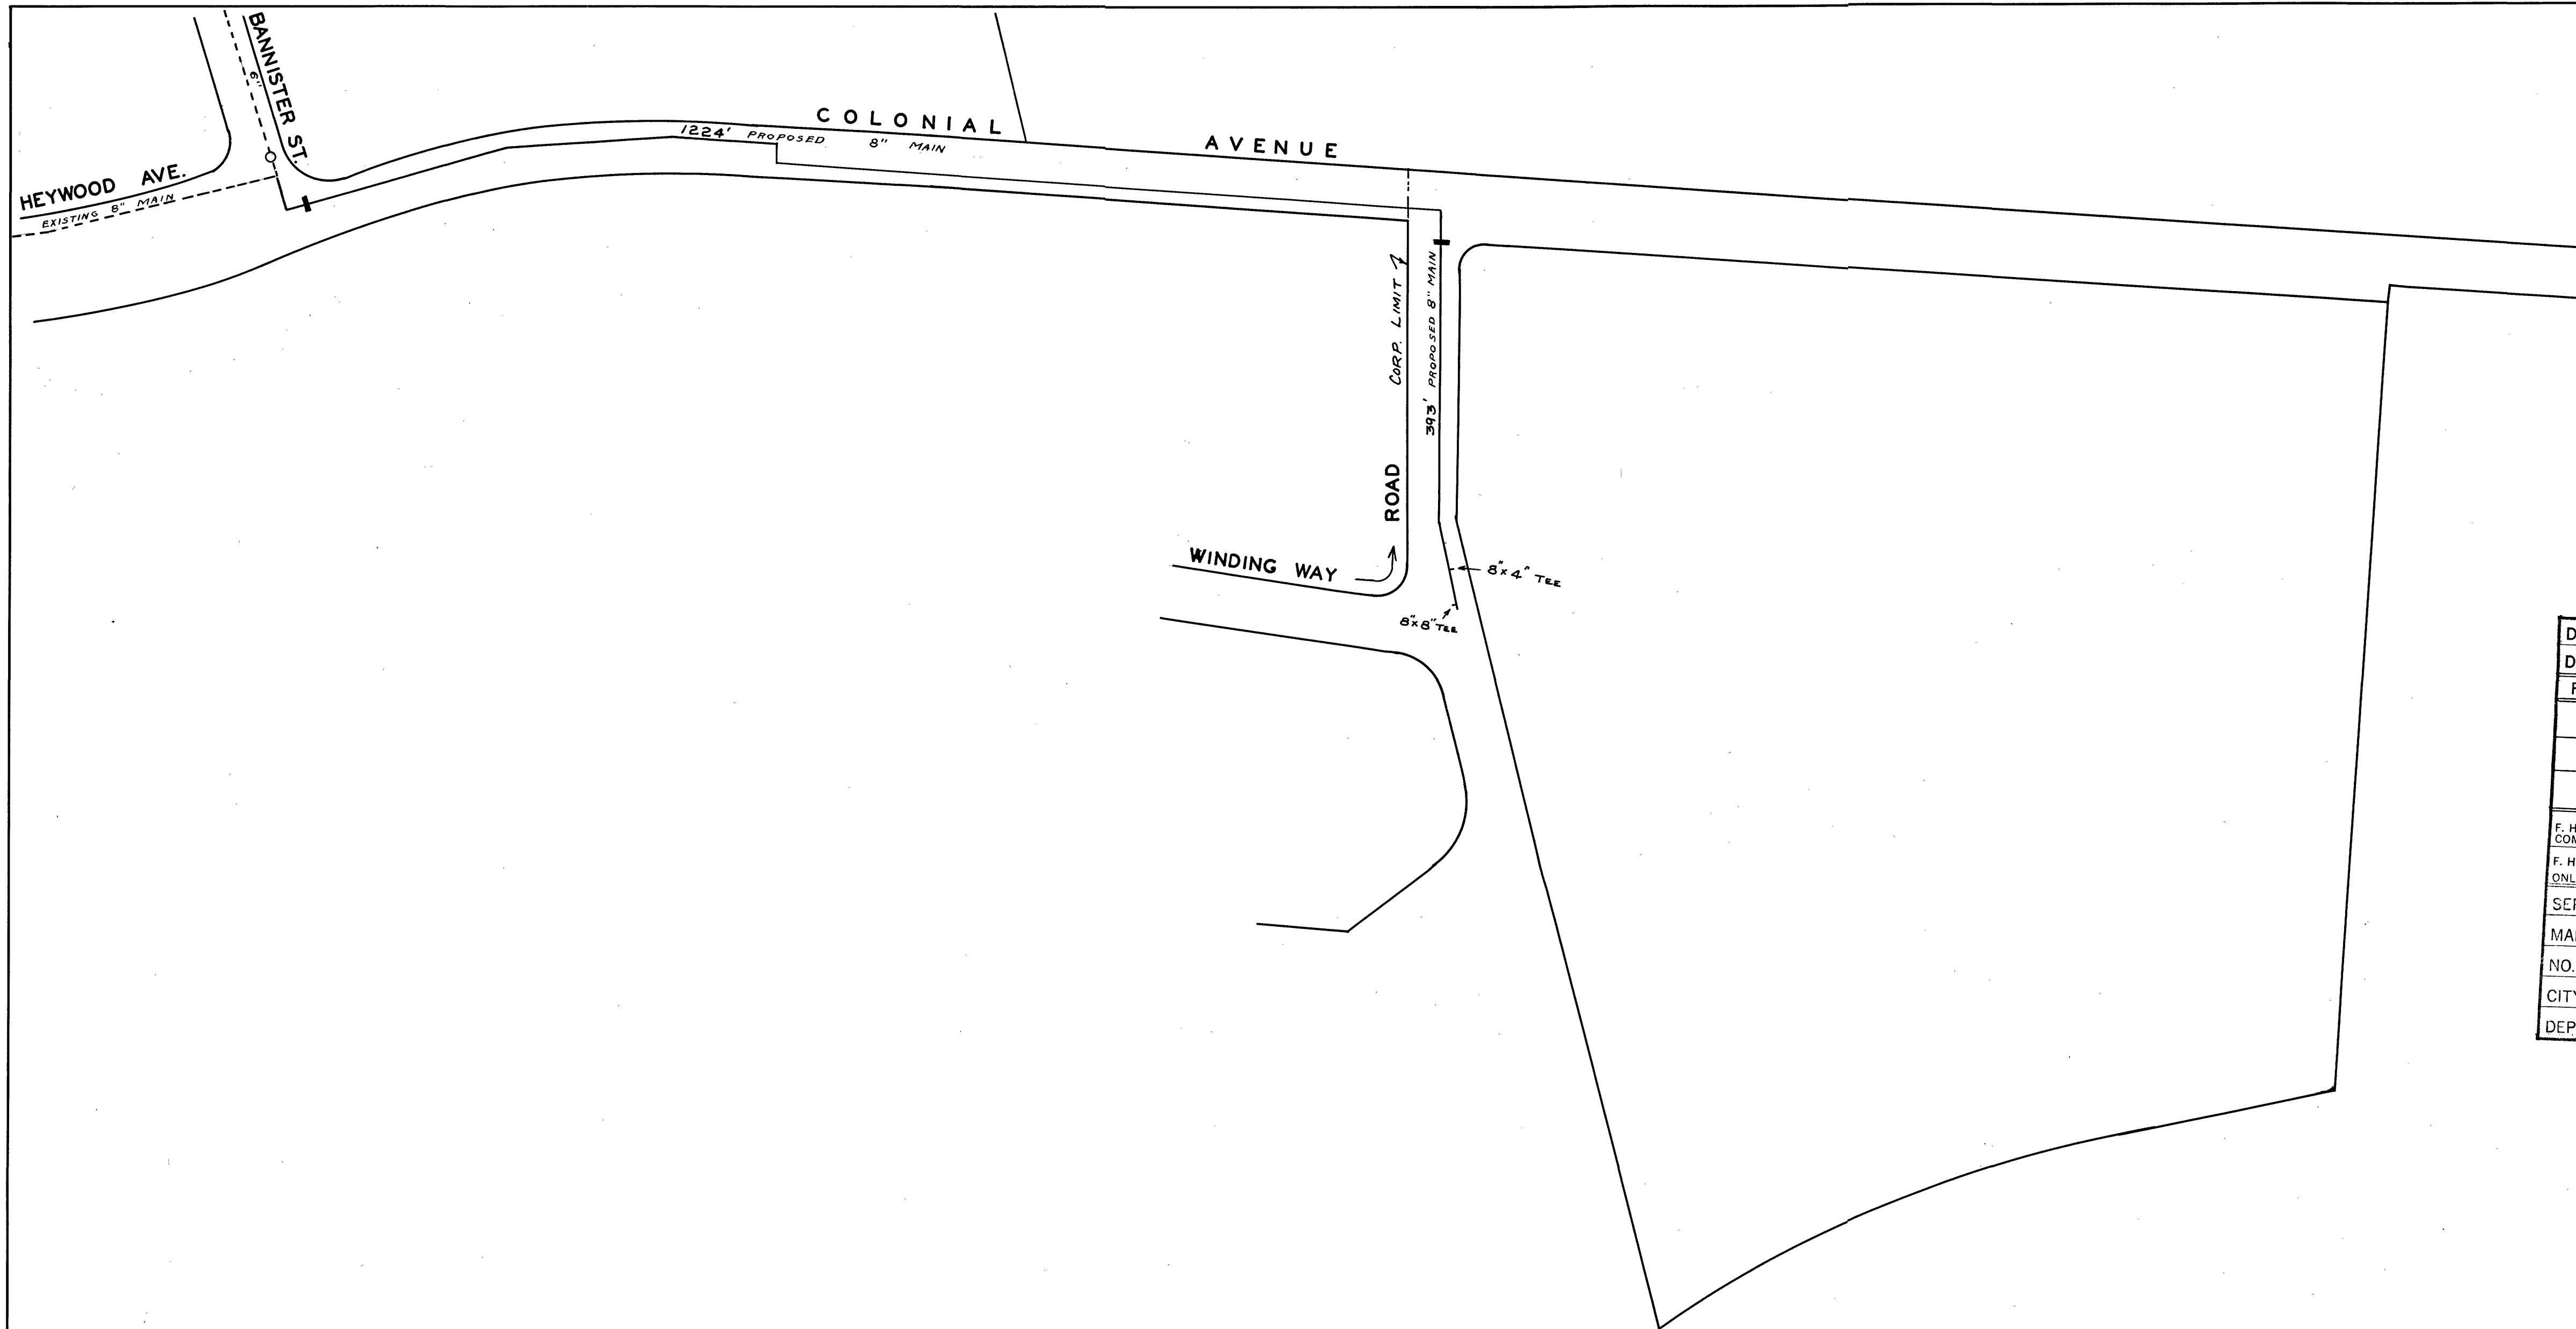

DATE STARTED 1-25-61				
DATE COMP. 3-17-61				
FEET MAIN	SIZE	VALVE	VAULT	BOX
1617	8"	2	2	
F. H. COMP.				
F. H. STUB ONLY				
SERV. INS. BY:				
MAINS INS. BY: BRH				
NO. 3/4" SERV. INS.				
CITY OR CO. City & County				
DEPT. INSP.				

WATER DEPARTMENT
 CITY OF ROANOKE, VA.
 COLONIAL AVENUE
 TECHNICAL SCHOOL
 SCALE-1"=100'
 DRAWN BY E.L.A. JUNE, 2, 1960