
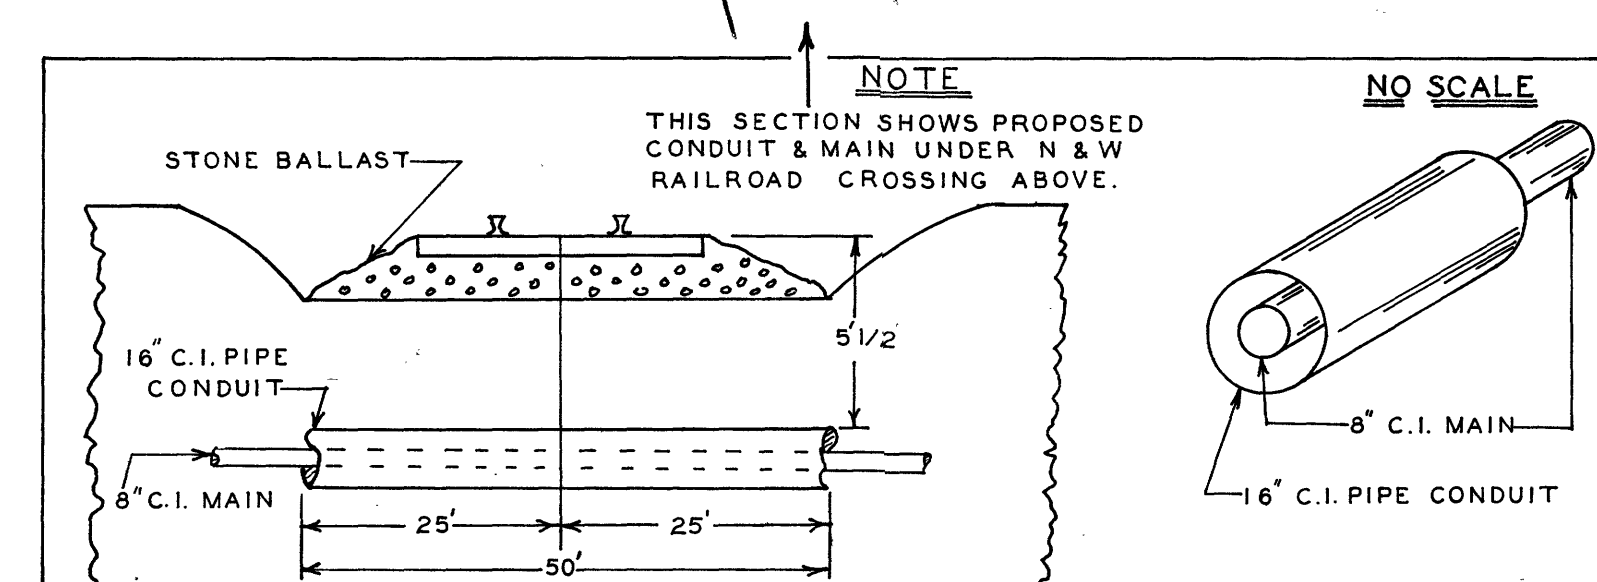
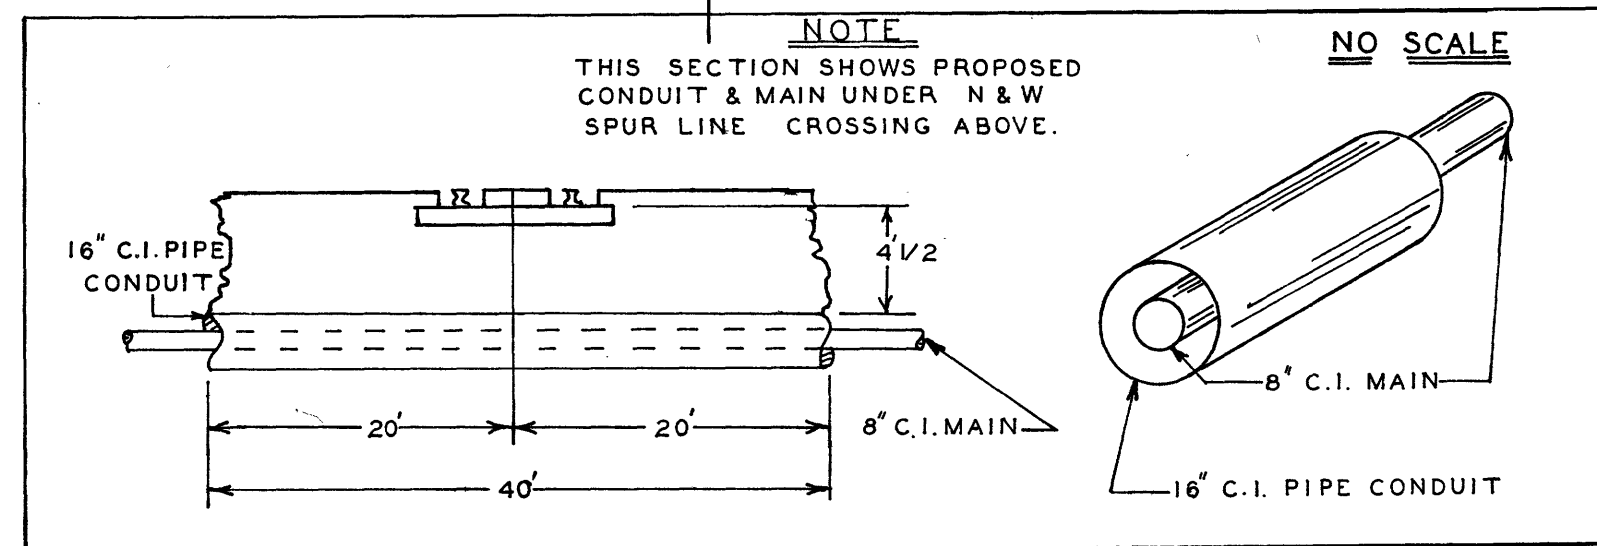


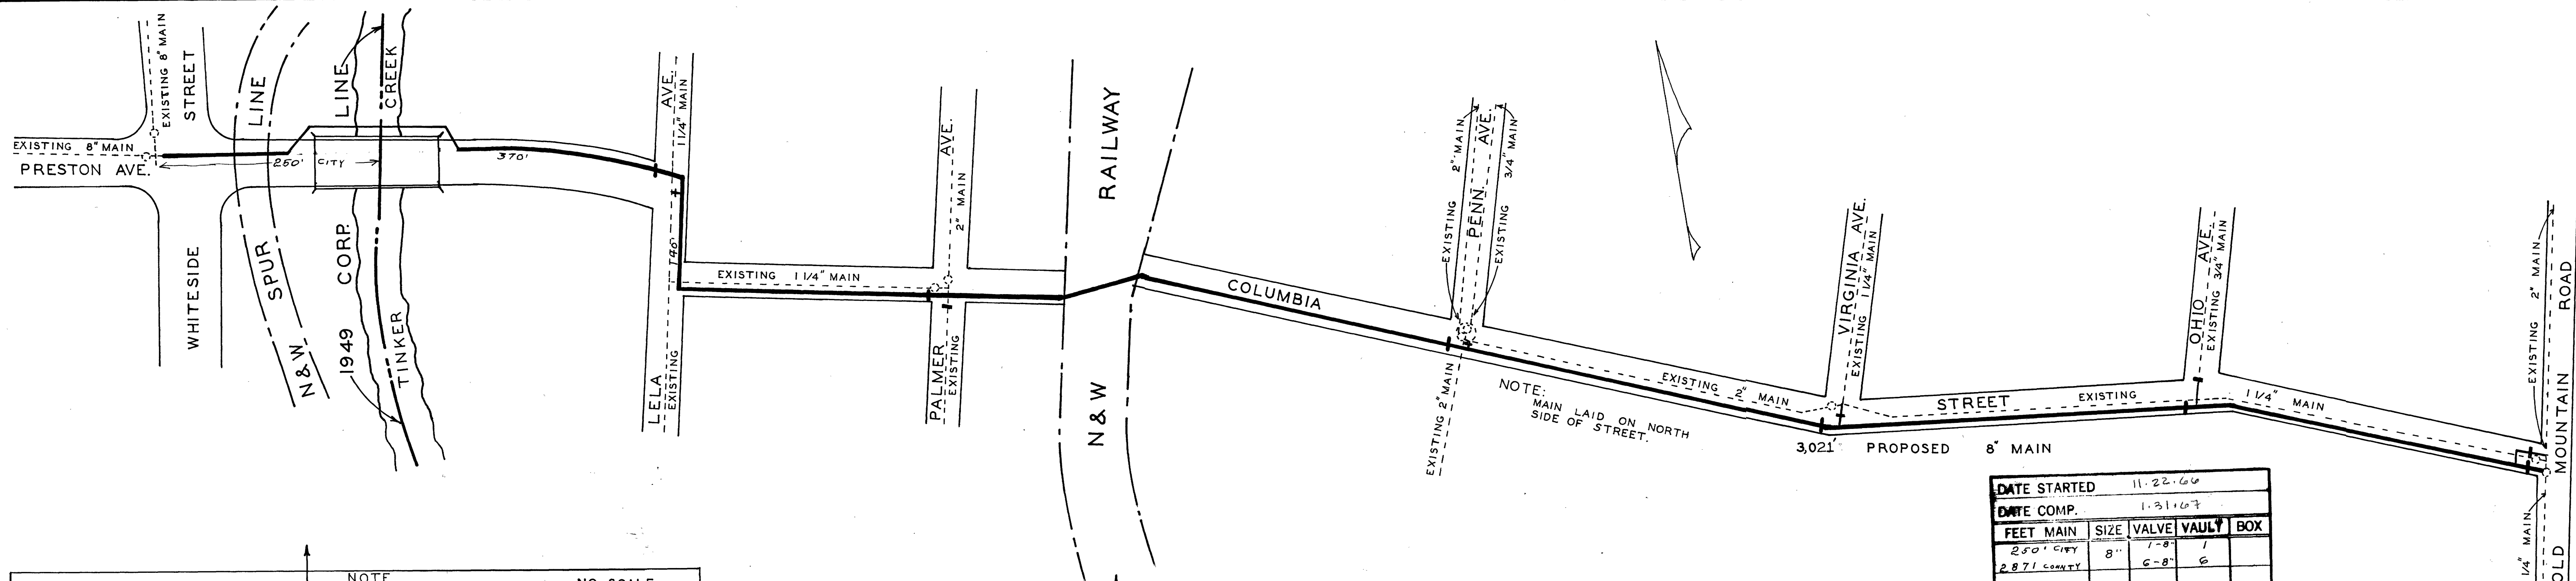

DATE STARTED	11.22.66			
DATE COMP.	1.31.67			
FEET MAIN	SIZE	VALVE	VAULT	BOX
250' CITY	8"	1-8"	1	
2871 COUNTY		6-8"	6	
F. H. COMP.				
F. H. STUB ONLY				
SERV. INS. BY:				
MAINS INS. BY:		R.W.D.		
NO. 3/4" SERV. INS.				
CITY OR CO.		CITY & COUNTY		
DEPT. INSP.		B. R. H.		

WATER DEPARTMENT
CITY OF ROANOKE, VA.
COLUMBIA STREET N.E.
SCALE 1"=100'
DRAWN BY C.G.C AUGUST 9, 1966