


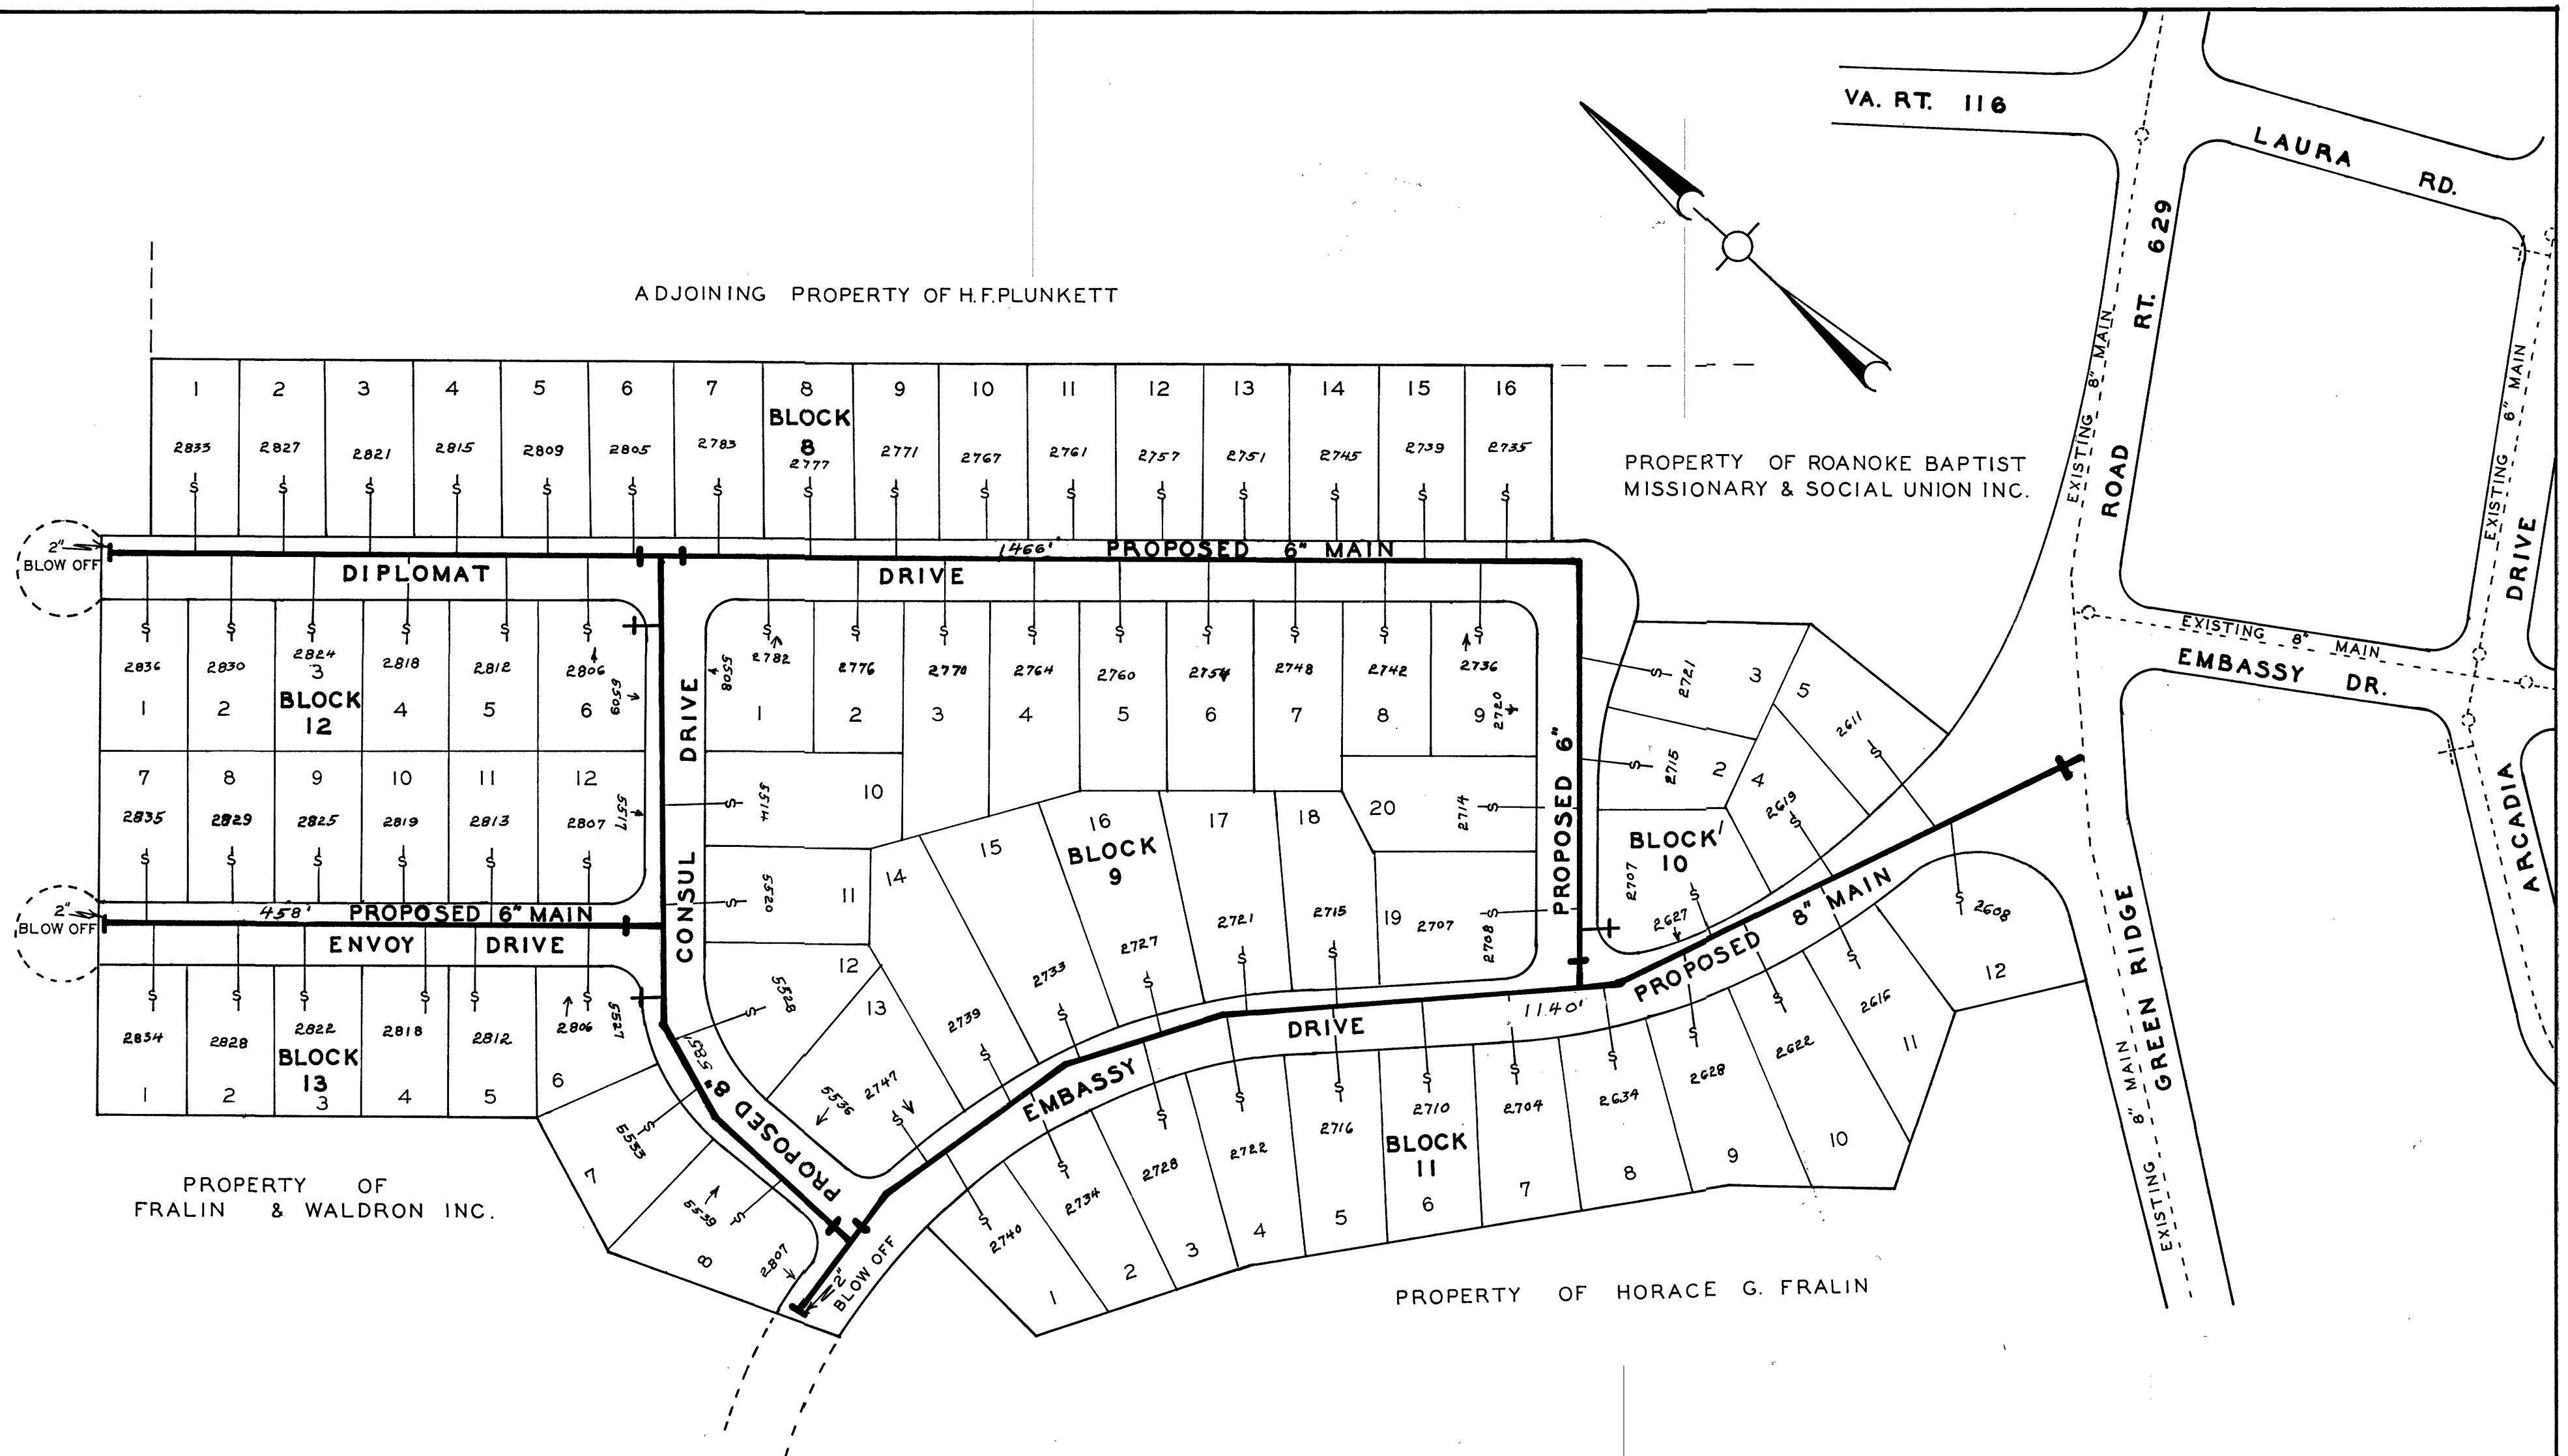

|                          |               |       |       |     |
|--------------------------|---------------|-------|-------|-----|
| DATE STARTED JUL 31 1967 |               |       |       |     |
| DATE COMP. OCT 17 1967   |               |       |       |     |
| FEET MAIN                | SIZE          | VALVE | VAULT | BOX |
| 1722'                    | 8"            | 2     | 3     |     |
| 1924'                    | 6"            | 4     | 4     |     |
| 2" BLOW OFFS             | 2"            | 3     |       | 3   |
| F. H. COMP.              |               |       |       |     |
| F. H. STUB ONLY          | 3             | 6"    | 3     | 3   |
| SERV. INS. BY:           | J. F. STCLAIR |       |       |     |
| MAINS INS. BY:           | J. F. STCLAIR |       |       |     |
| NO. 3/4" SERV. INS.      | 73            |       |       |     |
| CITY OR CO.              | COUNTY        |       |       |     |
| DEPT. INSP.              | H. M. CORRELL |       |       |     |

ACTING MGR. ROANOKE WATER DEPARTMENT  
*William F. Clark*  
 AGENT FOR ROANOKE PLANNING COMMS.  
 CITY ENGINEER OF ROANOKE, VA.  
*H. Cletus Broyles*  
 DIRECTOR OF PUBLIC WORKS.

6-22-67  
 DATE  
 6-22-67  
 DATE  
 6-22-67  
 DATE  
 6-22-67  
 DATE

WATER DEPARTMENT  
 CITY OF ROANOKE, VA.  
 MONTCLAIR ESTATES  
 SECTION #3  
 SCALE 1" = 100'  
 DRAWN BY C.G.C. MAY 16, 1967