


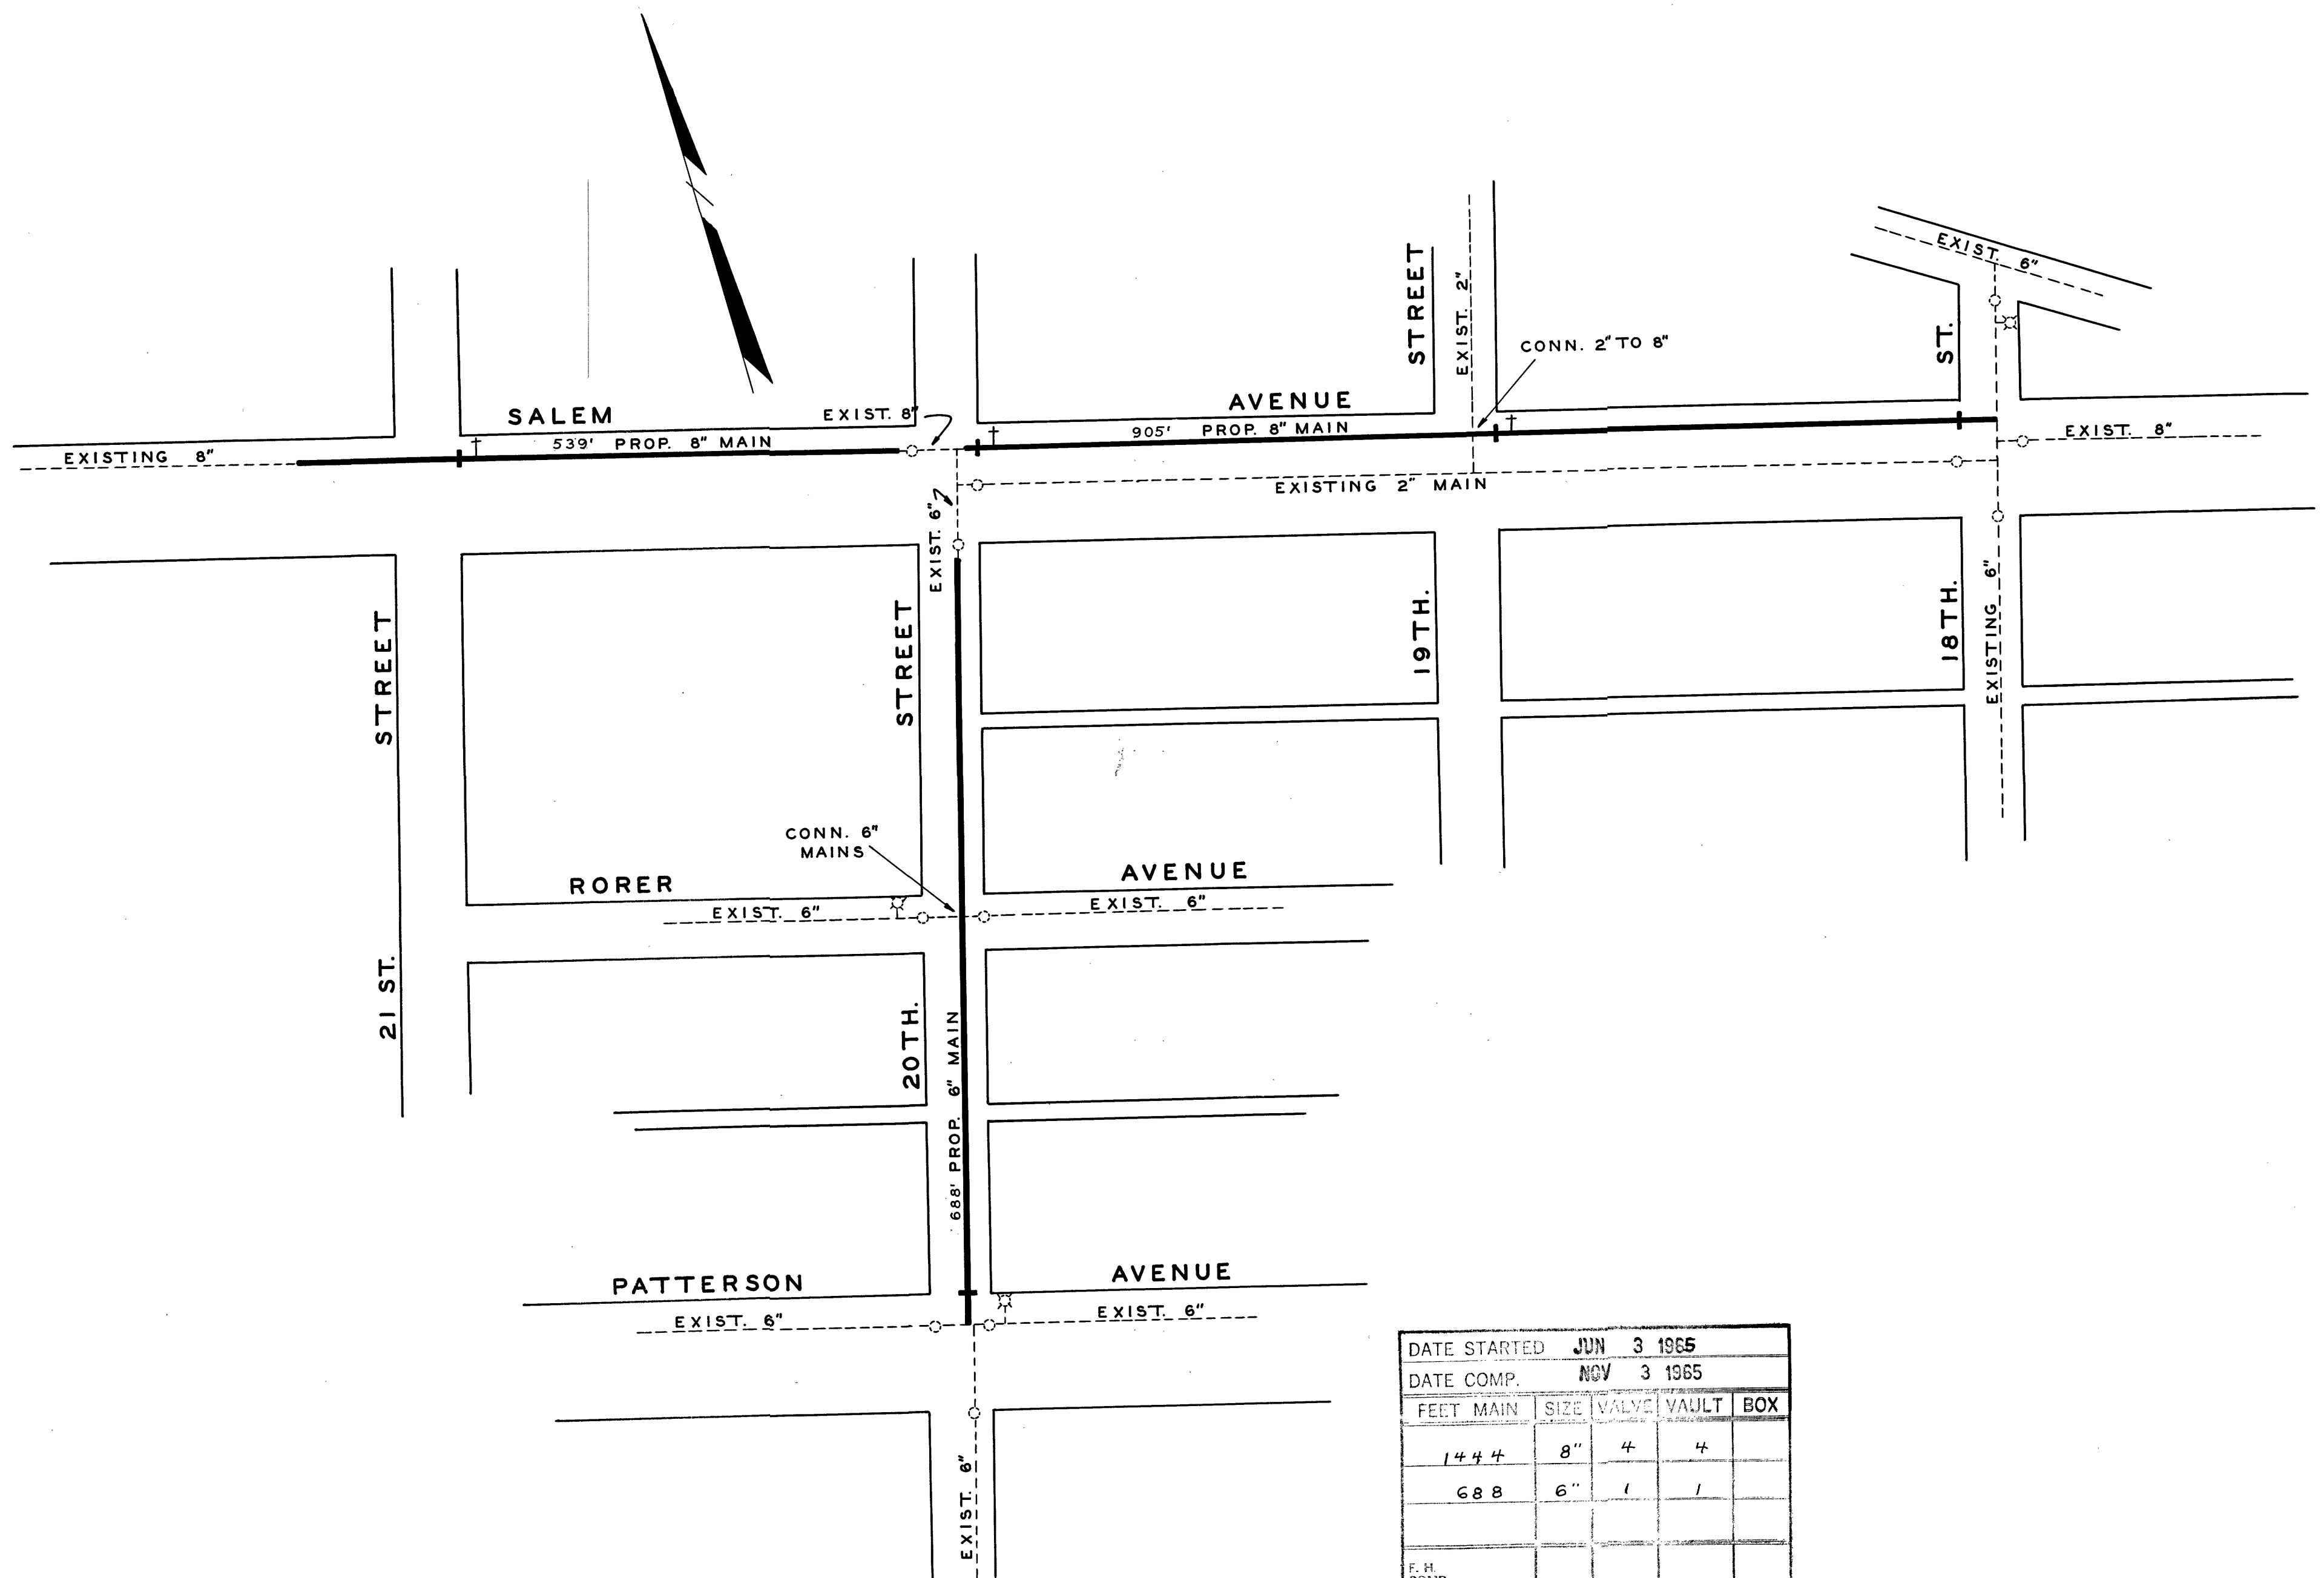

DATE STARTED JUN 3 1965				
DATE COMP. NOV 3 1965				
FEET MAIN	SIZE	VALVE	VAULT	BOX
1444	8"	4	4	
688	6"	1	1	
F. H. COMP.				
F. H. STUB ONLY	3	6"	3	3
SERV. INS. BY:				
MAINS INS. BY: R.W.D.				
NO. 3/4" SERV. INS.				
CITY OR CO. CITY				
DEPT. INSP. B.R.H.				

WATER DEPARTMENT
 CITY OF ROANOKE, VA.
 SALEM AVE. & 20TH. ST. S.W.
 SCALE - 1" = 100'
 DRAWN BY N.H.C. FEB. 24, 1965