


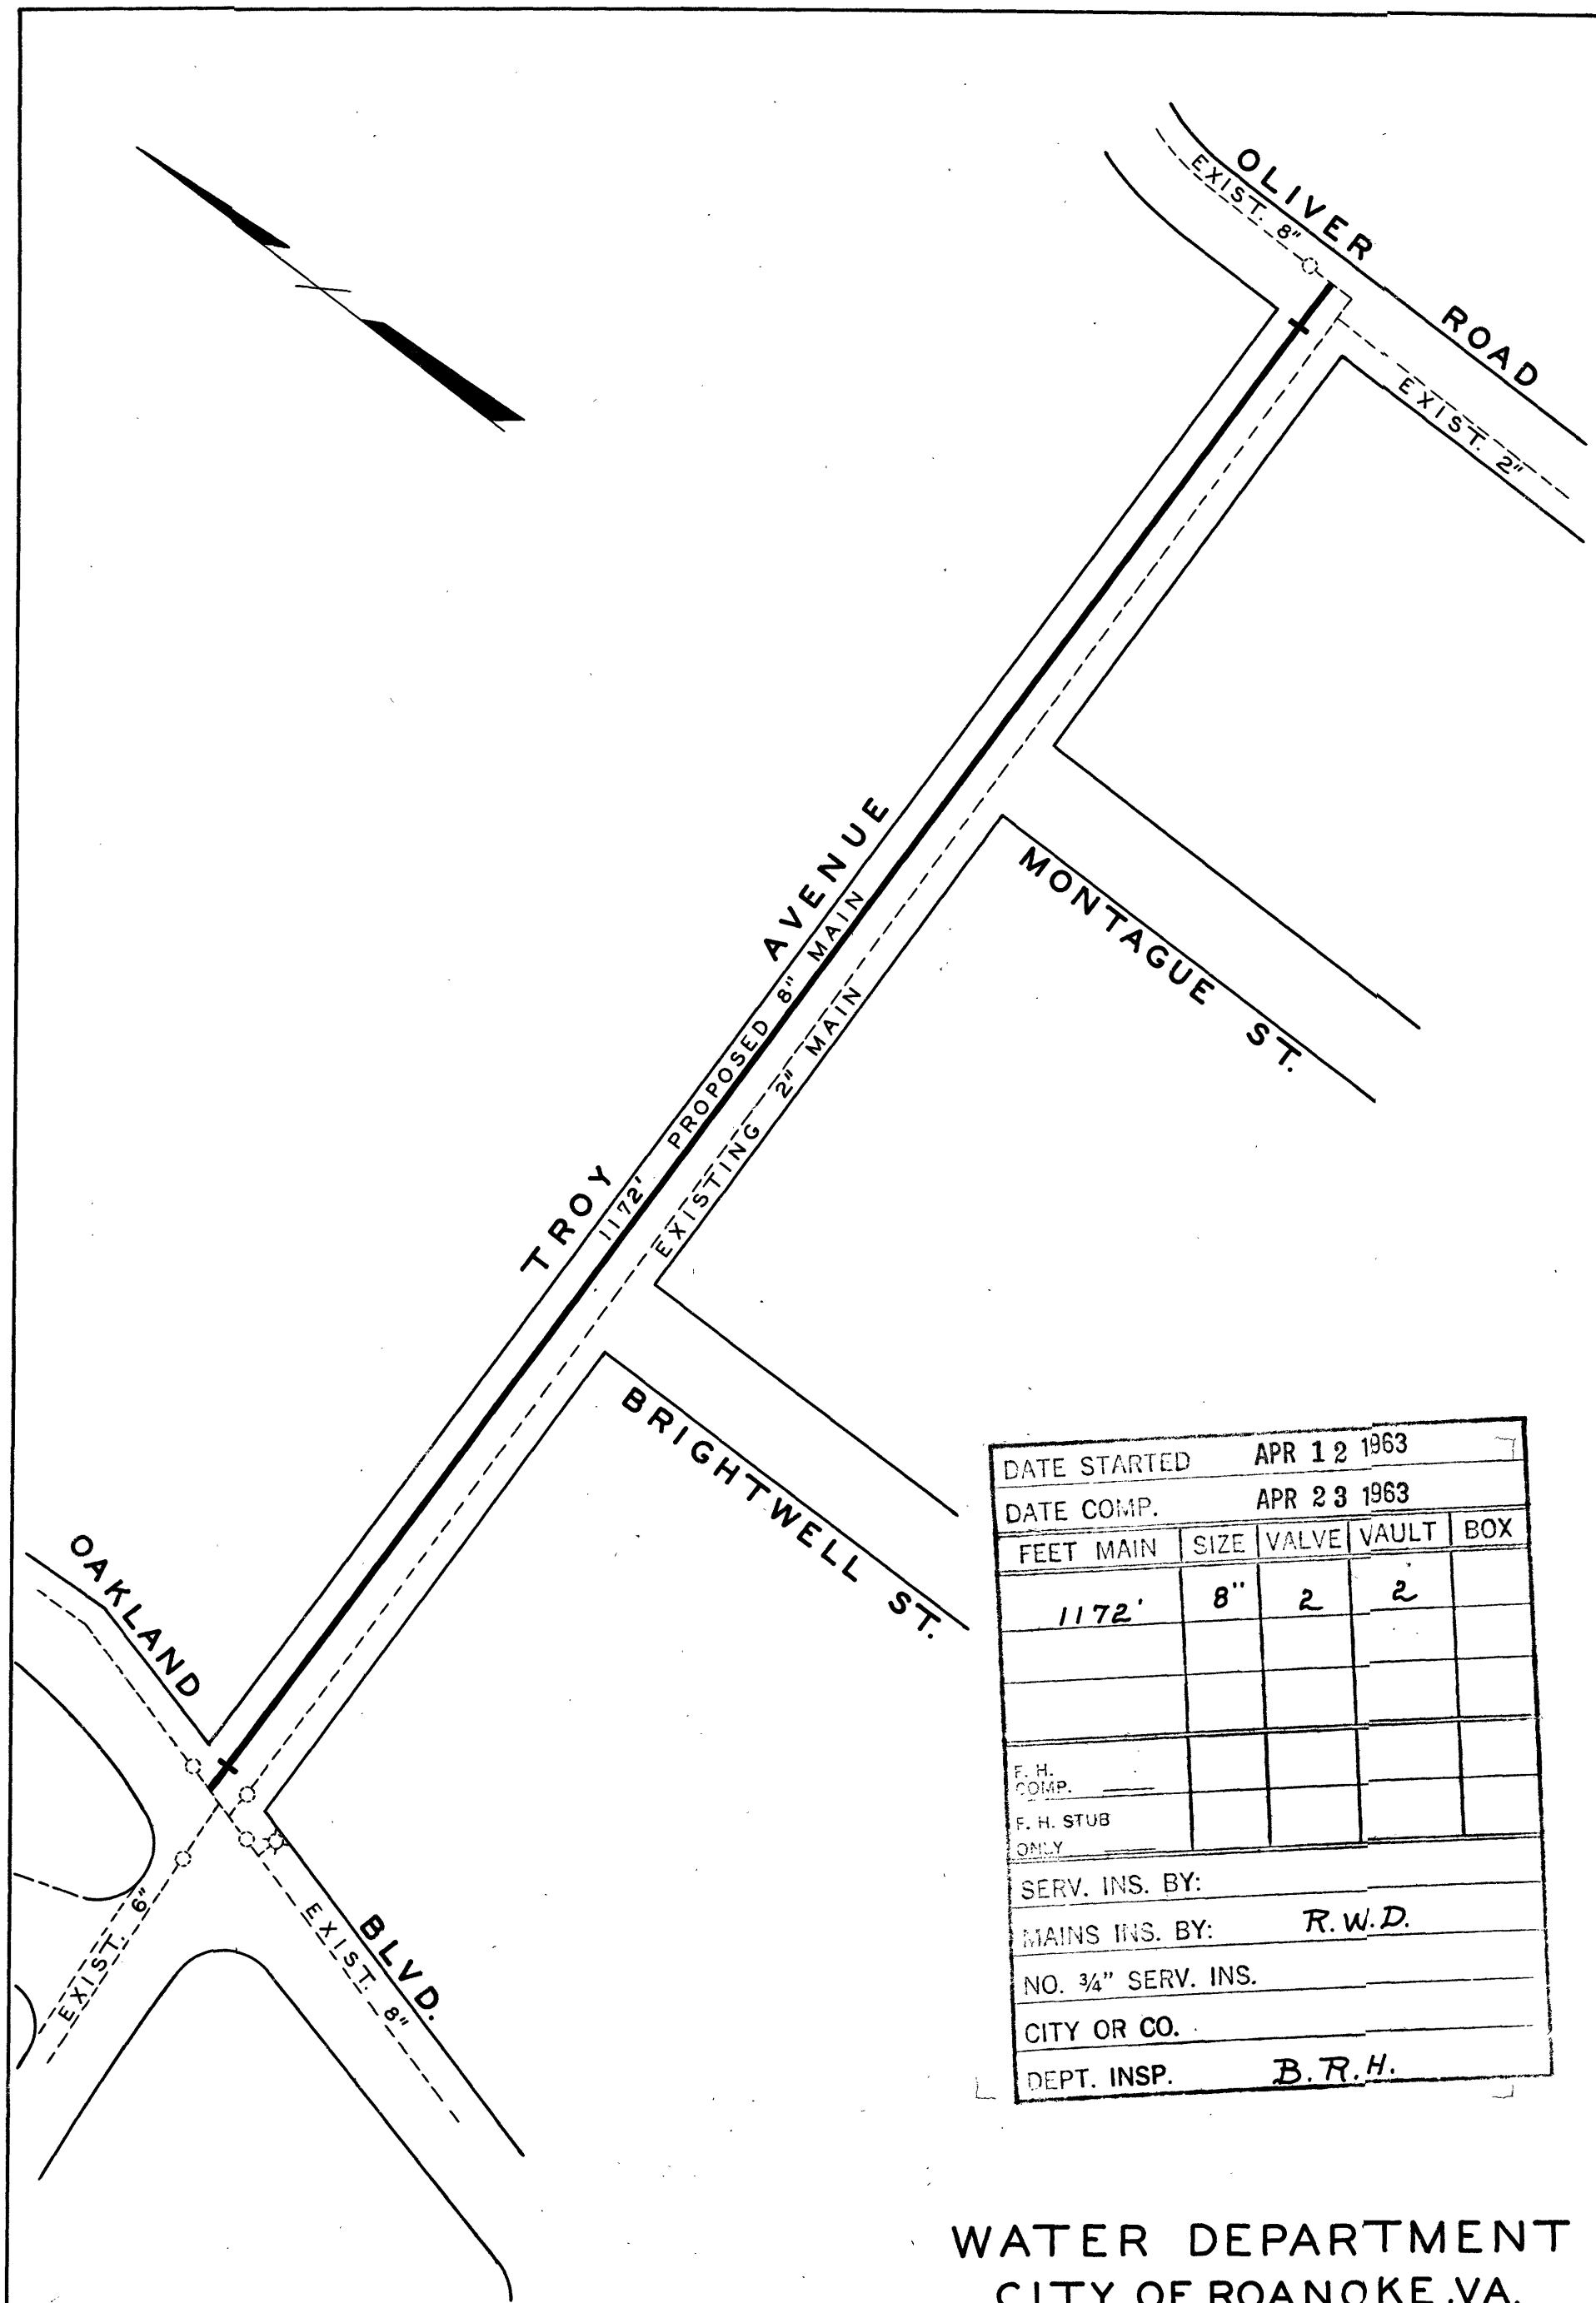

DATE STARTED		APR 12 1963			
DATE COMP.		APR 23 1963			
FEET MAIN	SIZE	VALVE	VAULT	BOX	
1172'	8"	2	2		
F. H. COMP.					
F. H. STUB ONLY					
SERV. INS. BY:					
MAINS INS. BY:		R.W.D.			
NO. 3/4" SERV. INS.					
CITY OR CO.					
DEPT. INSP.		B.R.H.			

WATER DEPARTMENT
 CITY OF ROANOKE, VA.
 TROY AVENUE N.E.
 SCALE - 1" = 100'
 DRAWN BY N.H.C. APRIL 10, 1963