
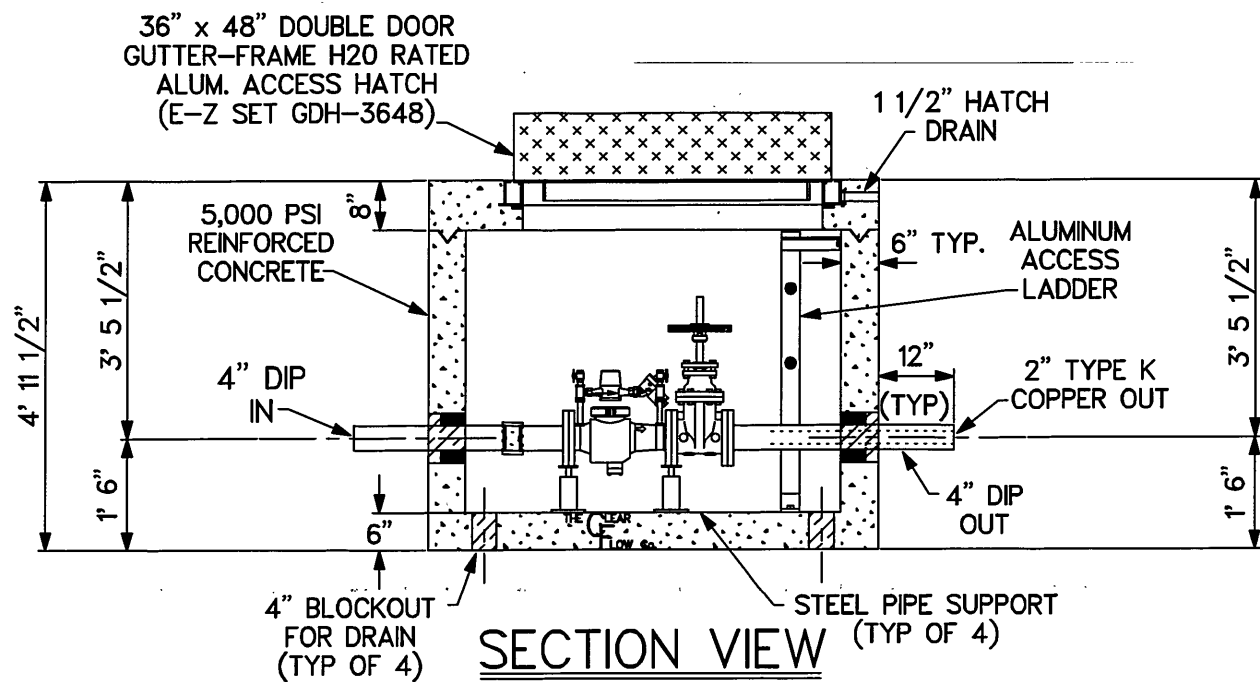


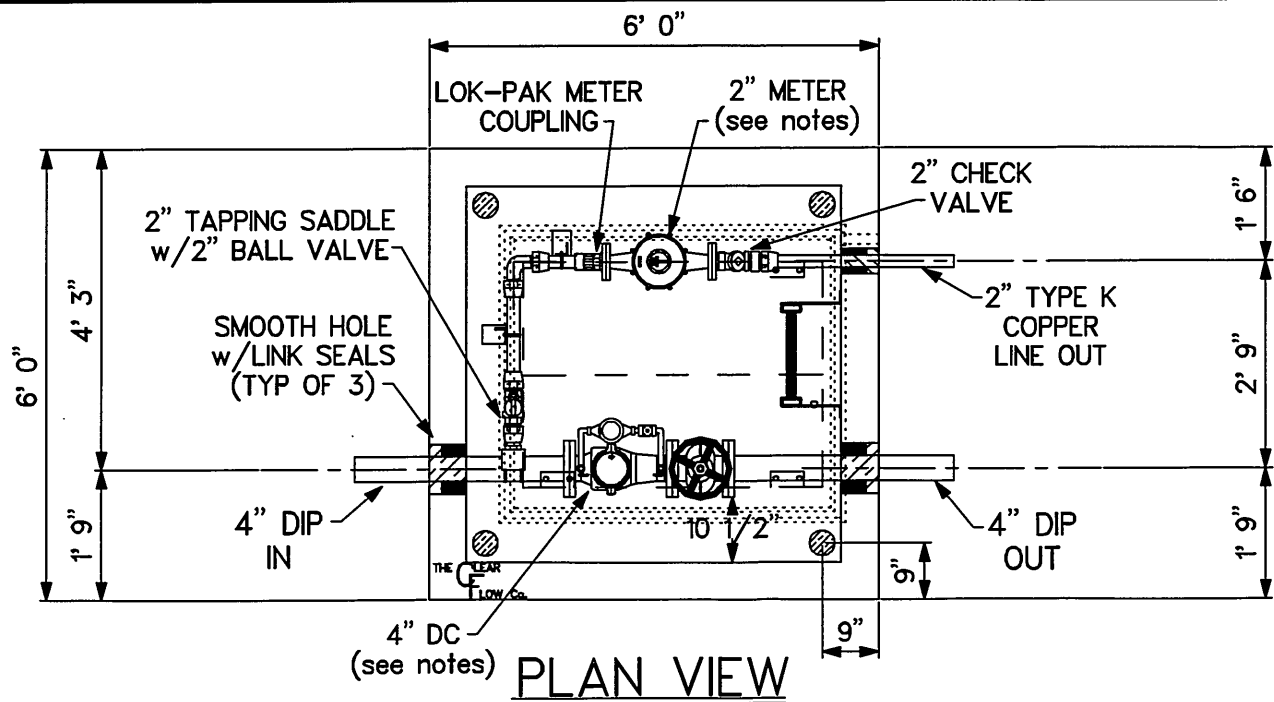

NOTES:

1. CLEAR FLOW VAULT SHIPPED ASSEMBLED WEIGHING APPROXIMATELY 16,000 LBS.
2. 4" WILKINS 310DAL SINGLE CHECK DETECTOR ASSEMBLY w/ONE OS&Y GATE VALVE
3. 2" DOMESTIC LINE IS TYPE K COPPER WITH GRIP JOINT FITTINGS, BALL VALVE AT TAPPING SADDLE (w/LOCKING TABS) & CHECK VALVE ON OUTLET
4. METERS SUPPLIED BY WVWA TO CLEAR FLOW & INSTALLED ON OUR YARD.

DESIGN		12/08/08
DRAWN	STEVEN L. GORDON	
REVISIONS		DATE
DBL. DOOR HATCH 12" SHORTER		11/15/07
BYPASS SIDE		12/08/08
SINGLE CHECK: 2 DOMESTIC LINES		1/05/11
TAP DOMESTIC OFF FIRE LINE		1/25/11
4" DC		10/24/11

CLEAR FLOW
BY AMERICAST

210 STONE SPRING ROAD
HARRISONBURG, VA 22801
(540) 434 - 2130

REF. NO. P-42615-S

ROANOKE COUNTY, VIRGINIA

**BILLY RITZ
RESTAURANT**
4" DC VAULT w/
2" DOMESTIC METER

VSC FIRE & SECURITY

* PRINTOUT NOT TO ANY SCALE *