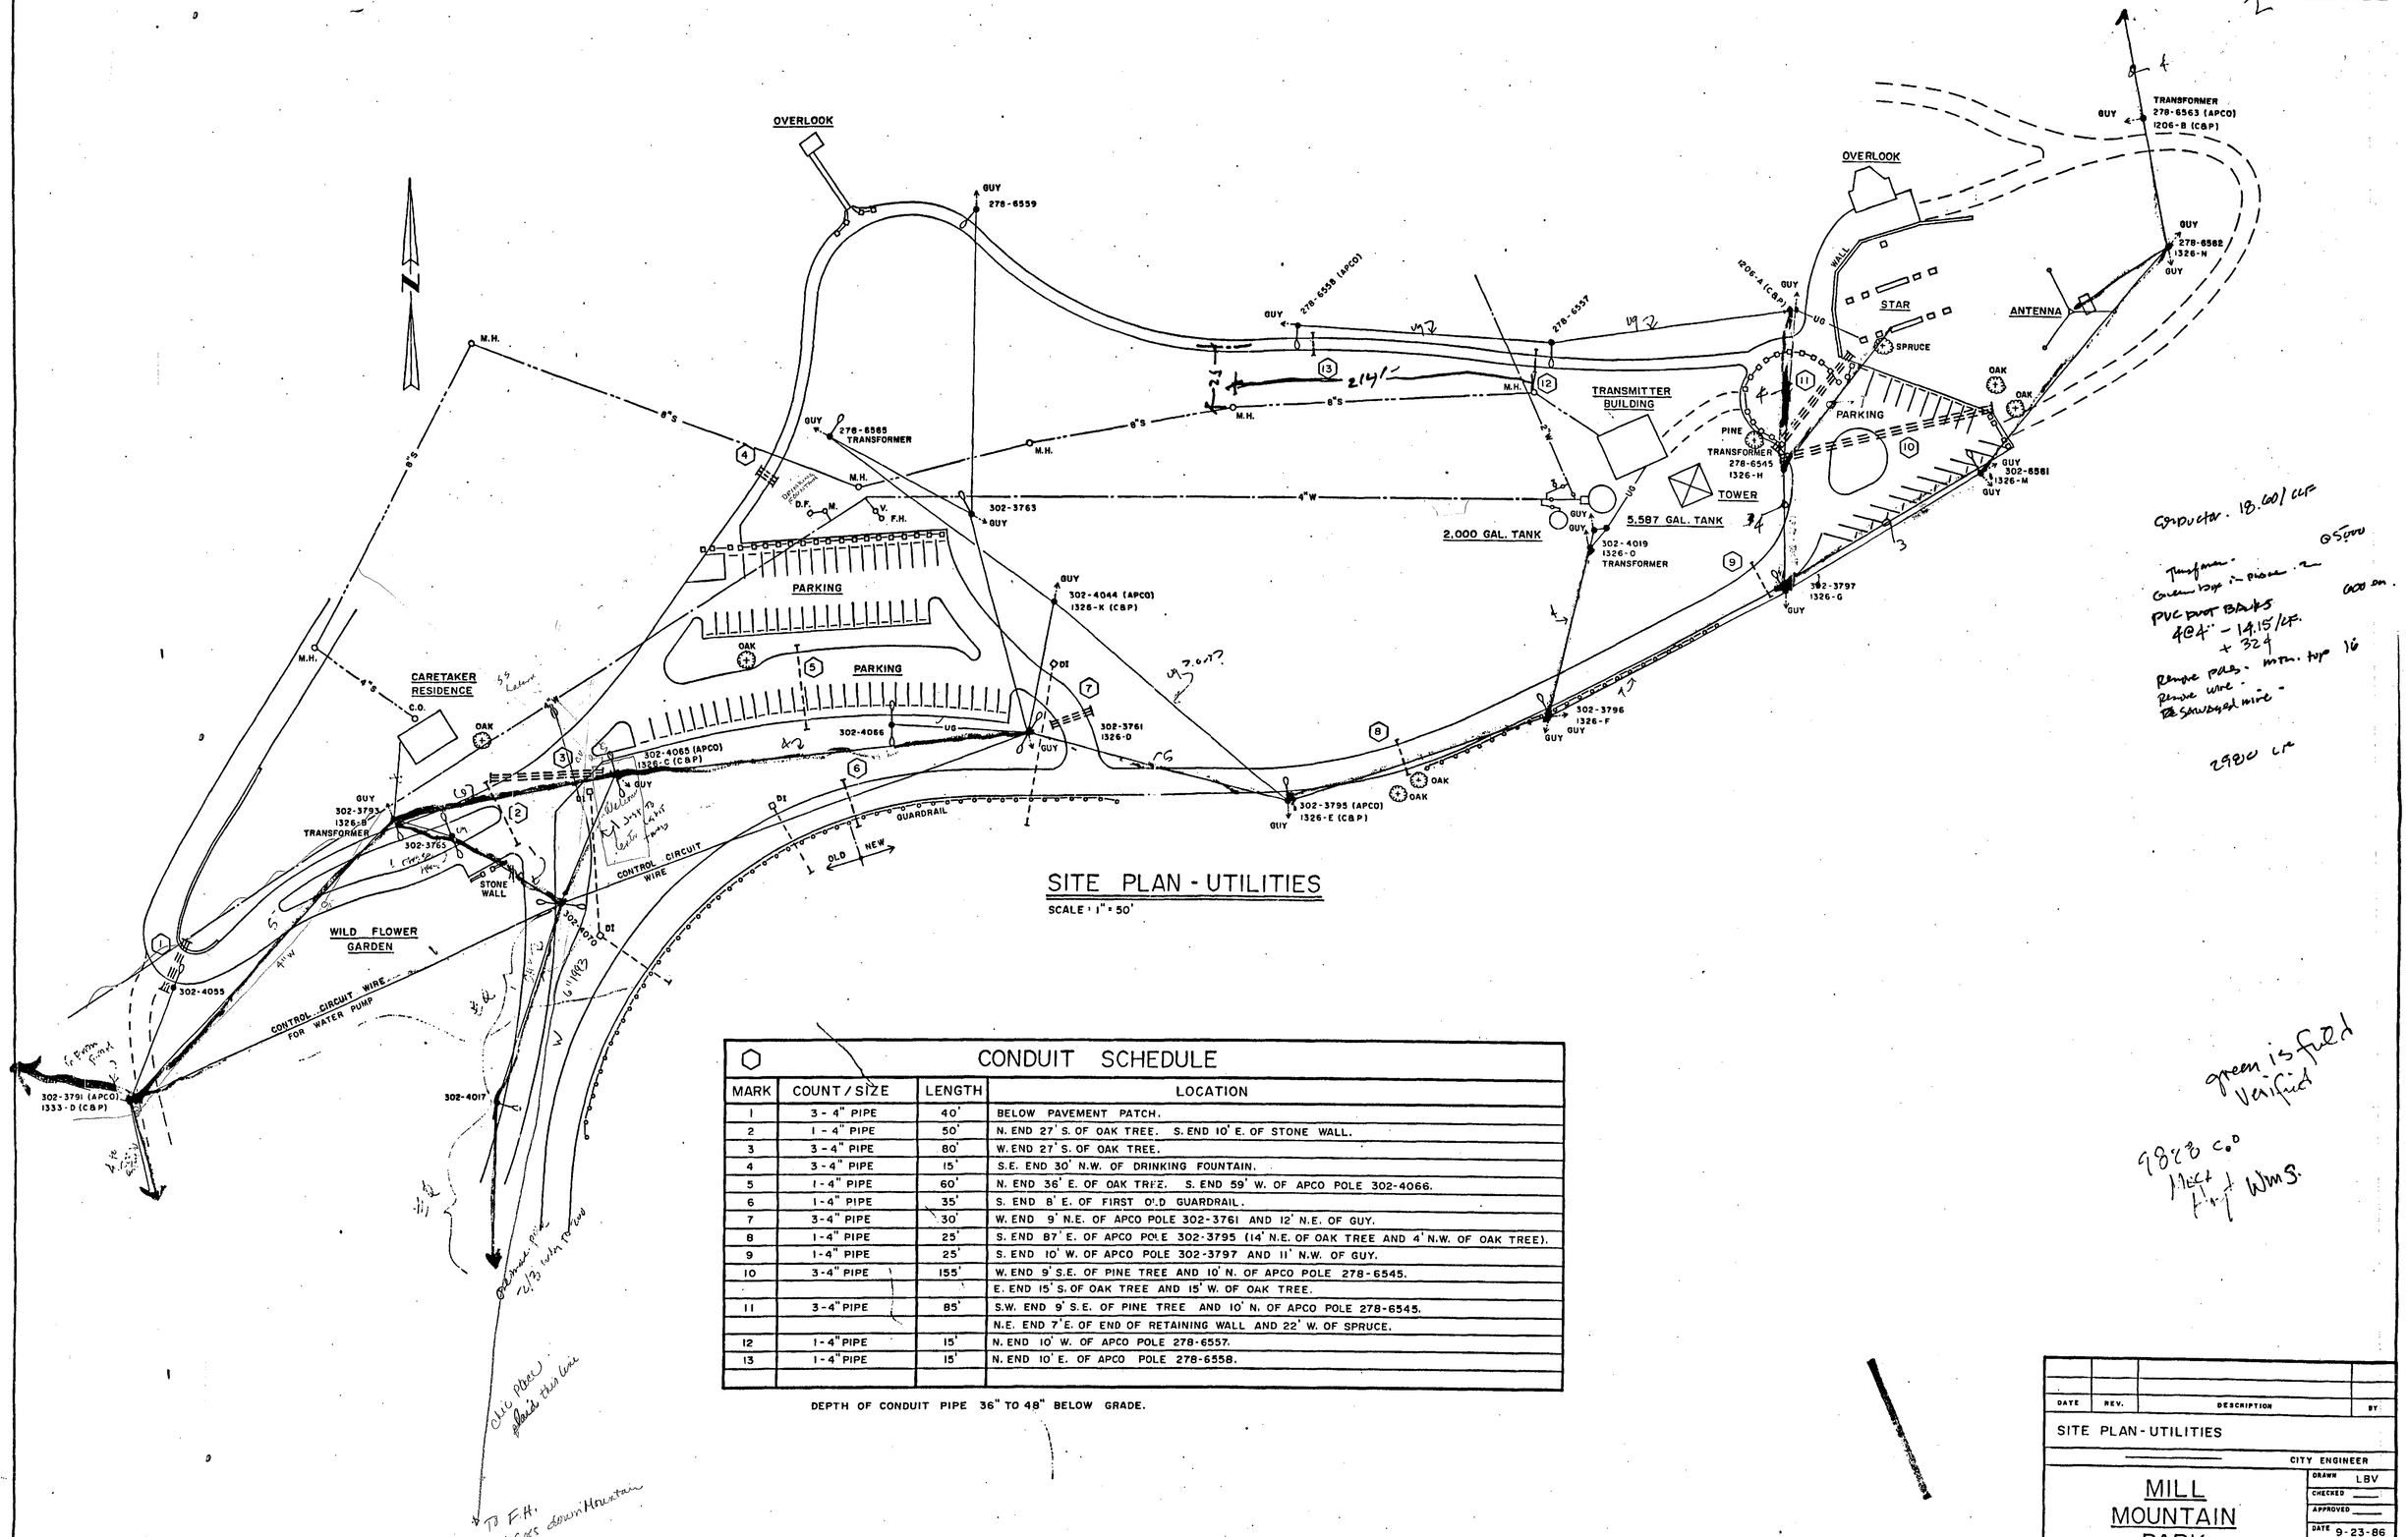

SITE PLAN - UTILITIES

SCALE: 1" = 50'

CONDUIT SCHEDULE

MARK	COUNT / SIZE	LENGTH	LOCATION
1	3 - 4" PIPE	40'	BELOW PAVEMENT PATCH.
2	1 - 4" PIPE	50'	N. END 27' S. OF OAK TREE. S. END 10' E. OF STONE WALL.
3	3 - 4" PIPE	80'	W. END 27' S. OF OAK TREE.
4	3 - 4" PIPE	15'	S.E. END 30' N.W. OF DRINKING FOUNTAIN.
5	1 - 4" PIPE	60'	N. END 36' E. OF OAK TREE. S. END 59' W. OF APCO POLE 302-4066.
6	1 - 4" PIPE	35'	S. END 8' E. OF FIRST OLD GUARDRAIL.
7	3 - 4" PIPE	30'	W. END 9' N.E. OF APCO POLE 302-3761 AND 12' N.E. OF GUY.
8	1 - 4" PIPE	25'	S. END 87' E. OF APCO POLE 302-3795 (14' N.E. OF OAK TREE AND 4' N.W. OF OAK TREE).
9	1 - 4" PIPE	25'	S. END 10' W. OF APCO POLE 302-3797 AND 11' N.W. OF GUY.
10	3 - 4" PIPE	155'	W. END 9' S.E. OF PINE TREE AND 10' N. OF APCO POLE 278-6545.
			E. END 15' S. OF OAK TREE AND 15' W. OF OAK TREE.
11	3 - 4" PIPE	85'	S.W. END 9' S.E. OF PINE TREE AND 10' N. OF APCO POLE 278-6545.
			N.E. END 7' E. OF END OF RETAINING WALL AND 22' W. OF SPRUCE.
12	1 - 4" PIPE	15'	N. END 10' W. OF APCO POLE 278-6557.
13	1 - 4" PIPE	15'	N. END 10' E. OF APCO POLE 278-6558.

DEPTH OF CONDUIT PIPE 36" TO 48" BELOW GRADE.

Conductor. 18.60/LF
Transformer. 05500
Green top in phase. 2
PVC DUCT BANKS 600 cm.
4CA - 14.15/LF.
+ 324
Remove poles. Move top 16
Remove wire.
Re Salvaged wire.
2980 LF

green is field verified
9828 C.O
Mark
Wms.

DATE	REV.	DESCRIPTION	BY

SITE PLAN - UTILITIES

CITY ENGINEER

MILL MOUNTAIN PARK

DRAWN LBV
CHECKED
APPROVED
DATE 9-23-86
PLAN NO. P-8602
SHEET 1 OF 1

OFFICE OF CITY ENGINEER
MUNICIPAL BUILDING, ROOM 350
215 CHURCH AVENUE, S.W.
ROANOKE, VIRGINIA 24011