


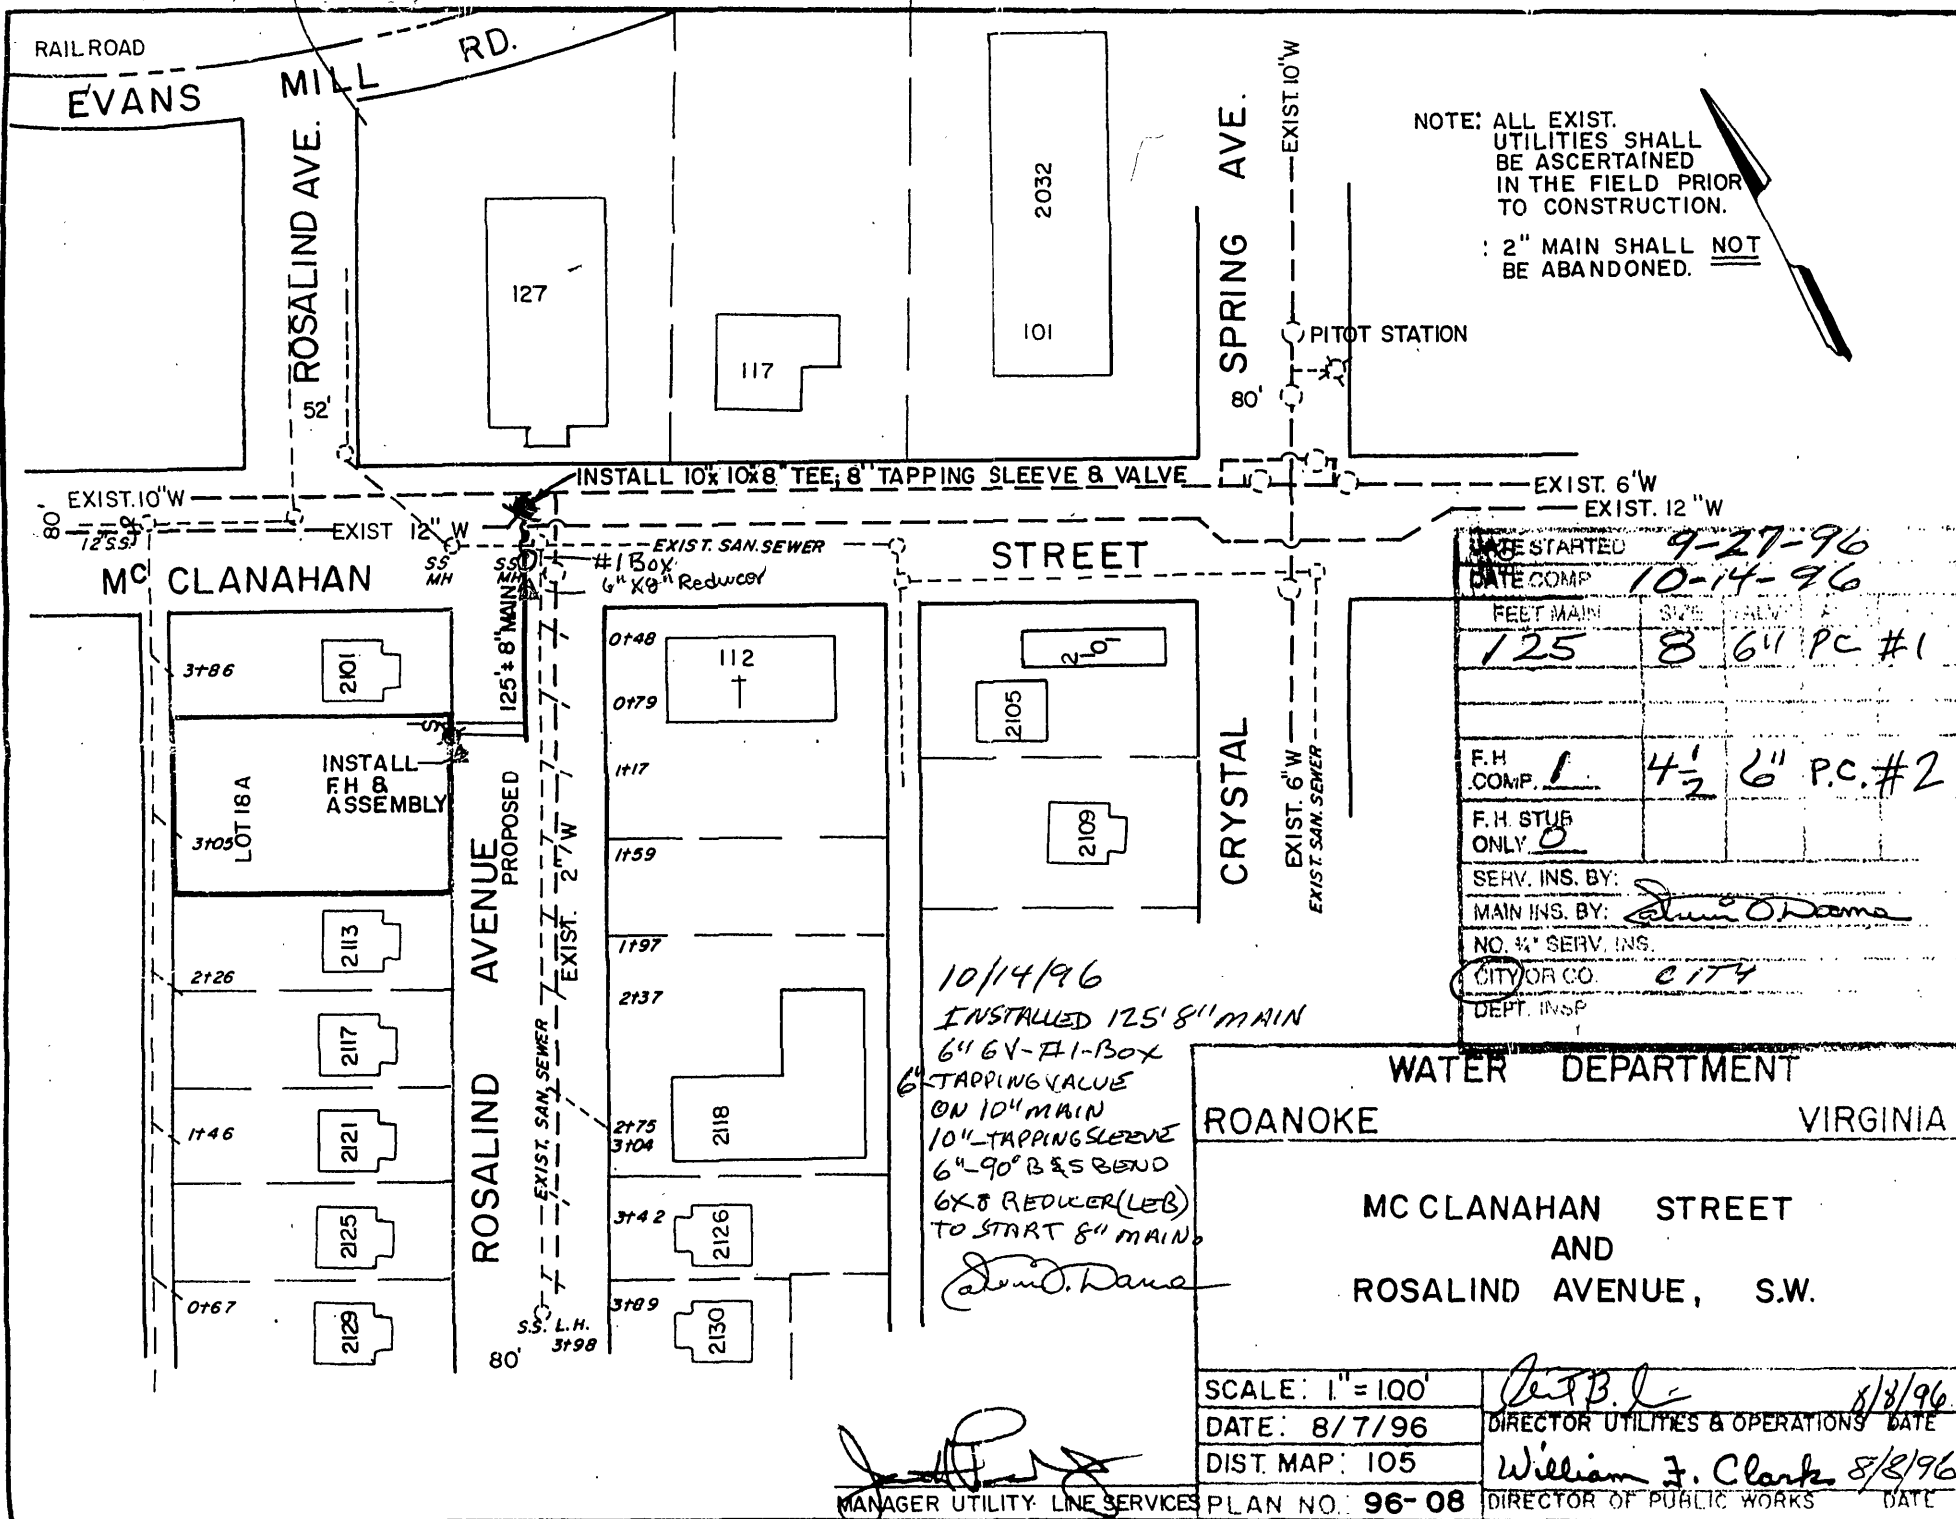

NOTE: ALL EXIST. UTILITIES SHALL BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION.
 : 2" MAIN SHALL NOT BE ABANDONED.

DATE STARTED	9-27-96		
DATE COMP	10-14-96		
FEET MAIN	SIZE	VALVE	
125	8	6" PC #1	
F.H. COMP.	1	4 1/2	6" P.C. #2
F.H. STUB ONLY	0		
SERV. INS. BY:	Steve O'Dama		
MAIN INS. BY:	Steve O'Dama		
NO. 1" SERV. INS.			
CITY OR CO.	CITY		
DEPT. INSP	1		

10/14/96
 INSTALLED 125' 8" MAIN
 6" 6V-HI-BOX
 6" TAPPING VALVE
 ON 10" MAIN
 10" TAPPING SLEEVE
 6" 90° B & S BEND
 6X8 REDUCER (LEB)
 TO START 8" MAIN
Steve O'Dama

WATER DEPARTMENT	
ROANOKE	VIRGINIA
MC CLANAHAH STREET AND ROSALIND AVENUE, S.W.	
SCALE: 1"=100'	<i>W.B.L.</i> 8/8/96
DATE: 8/7/96	DIRECTOR UTILITIES & OPERATIONS DATE
DIST. MAP: 105	<i>William F. Clarke</i> 8/8/96
MANAGER UTILITY LINE SERVICES	DIRECTOR OF PUBLIC WORKS DATE
PLAN NO. 96-08	