


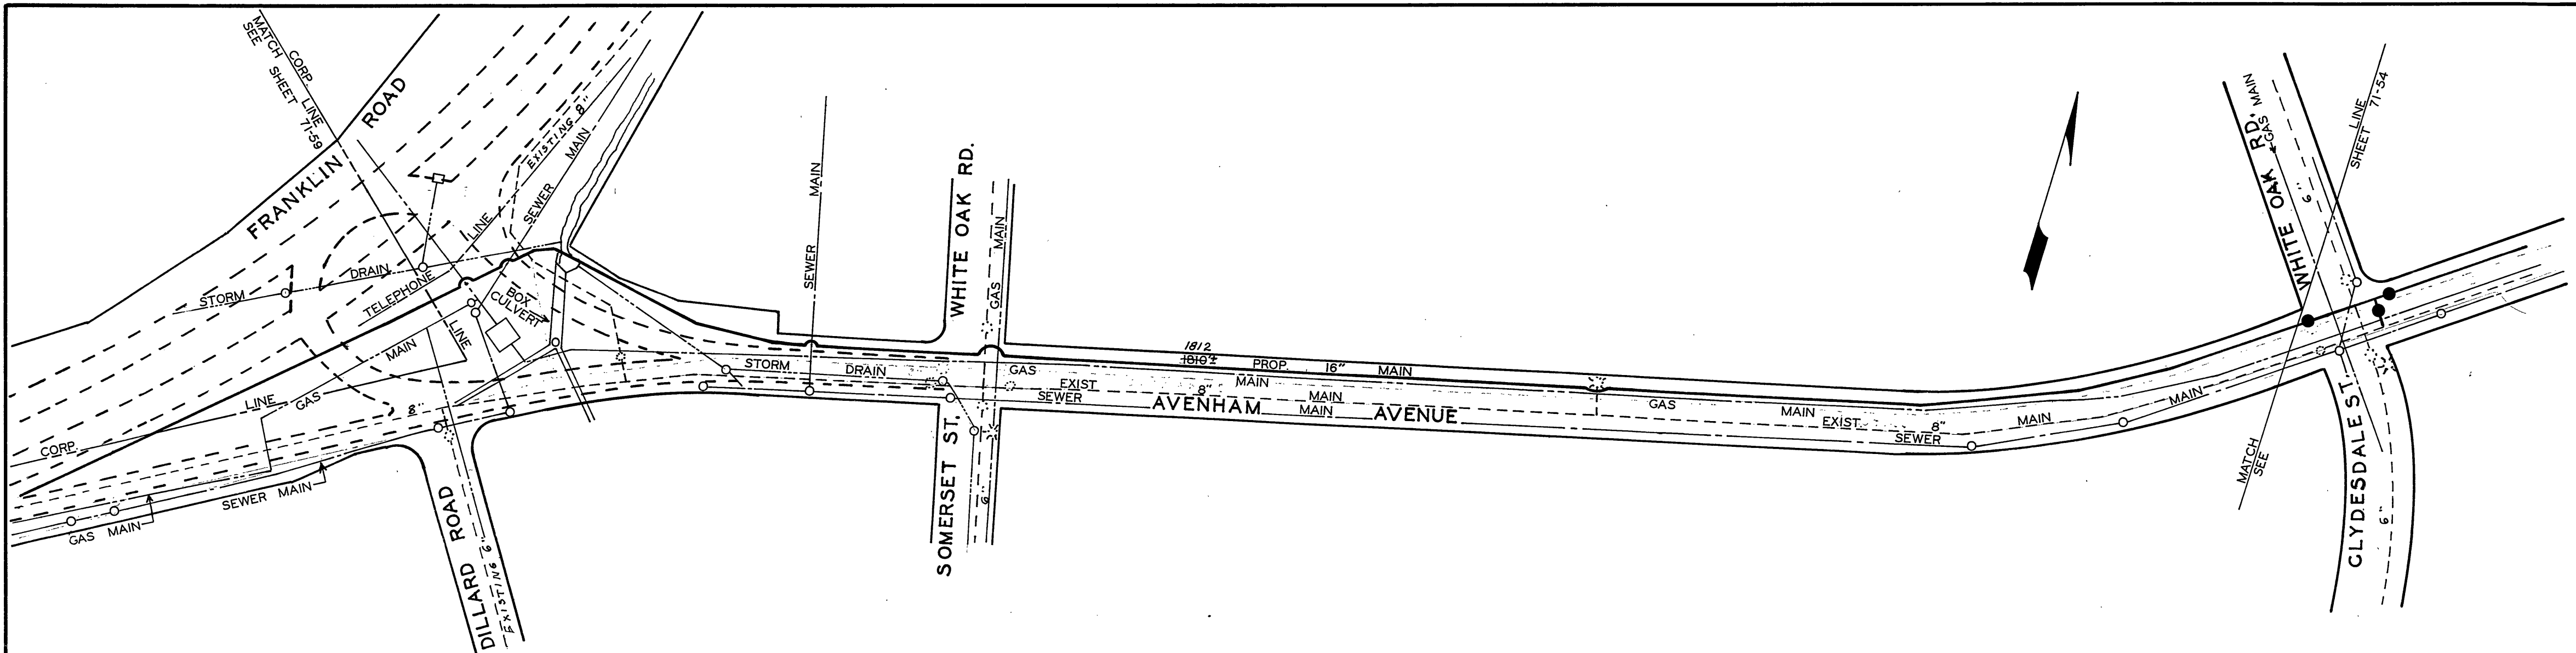

DATE STARTED					3-16-73	
DATE COMP.					12-4-73	
FEET MAIN		SIZE	VALVE	VAULT	BOX	
1812		16"				
F. H. COMP.						
F. H. STUB ONLY						
SERV. INS. BY:						
MAIN INS. BY: R. W. D.						
NO. ¾" SERV. INS.						
CITY OR CO.						
DEPT. INSP.						
J. W. MAXEY						

E. B. [Signature]
 MGR. ROANOKE WATER DEPT.
L. [Signature]
 AGENT FOR ROANOKE PLANNING COMM.
Charles [Signature]
 CITY ENGINEER OF ROANOKE, VA.
[Signature]
 DIRECTOR OF PUBLIC WORKS

9/26/72
 DATE
 9/26/72
 DATE
 9/26/72
 DATE
 9/26/72
 DATE

16" MAIN - SOUTHWEST TRUNK LINE

WATER DEPARTMENT
 CITY OF ROANOKE, VA.
 AVENHAM AVENUE, S.W.

SCALE - 1" = 100'

DRAWN BY E.L.A. DEC. 14, 1971