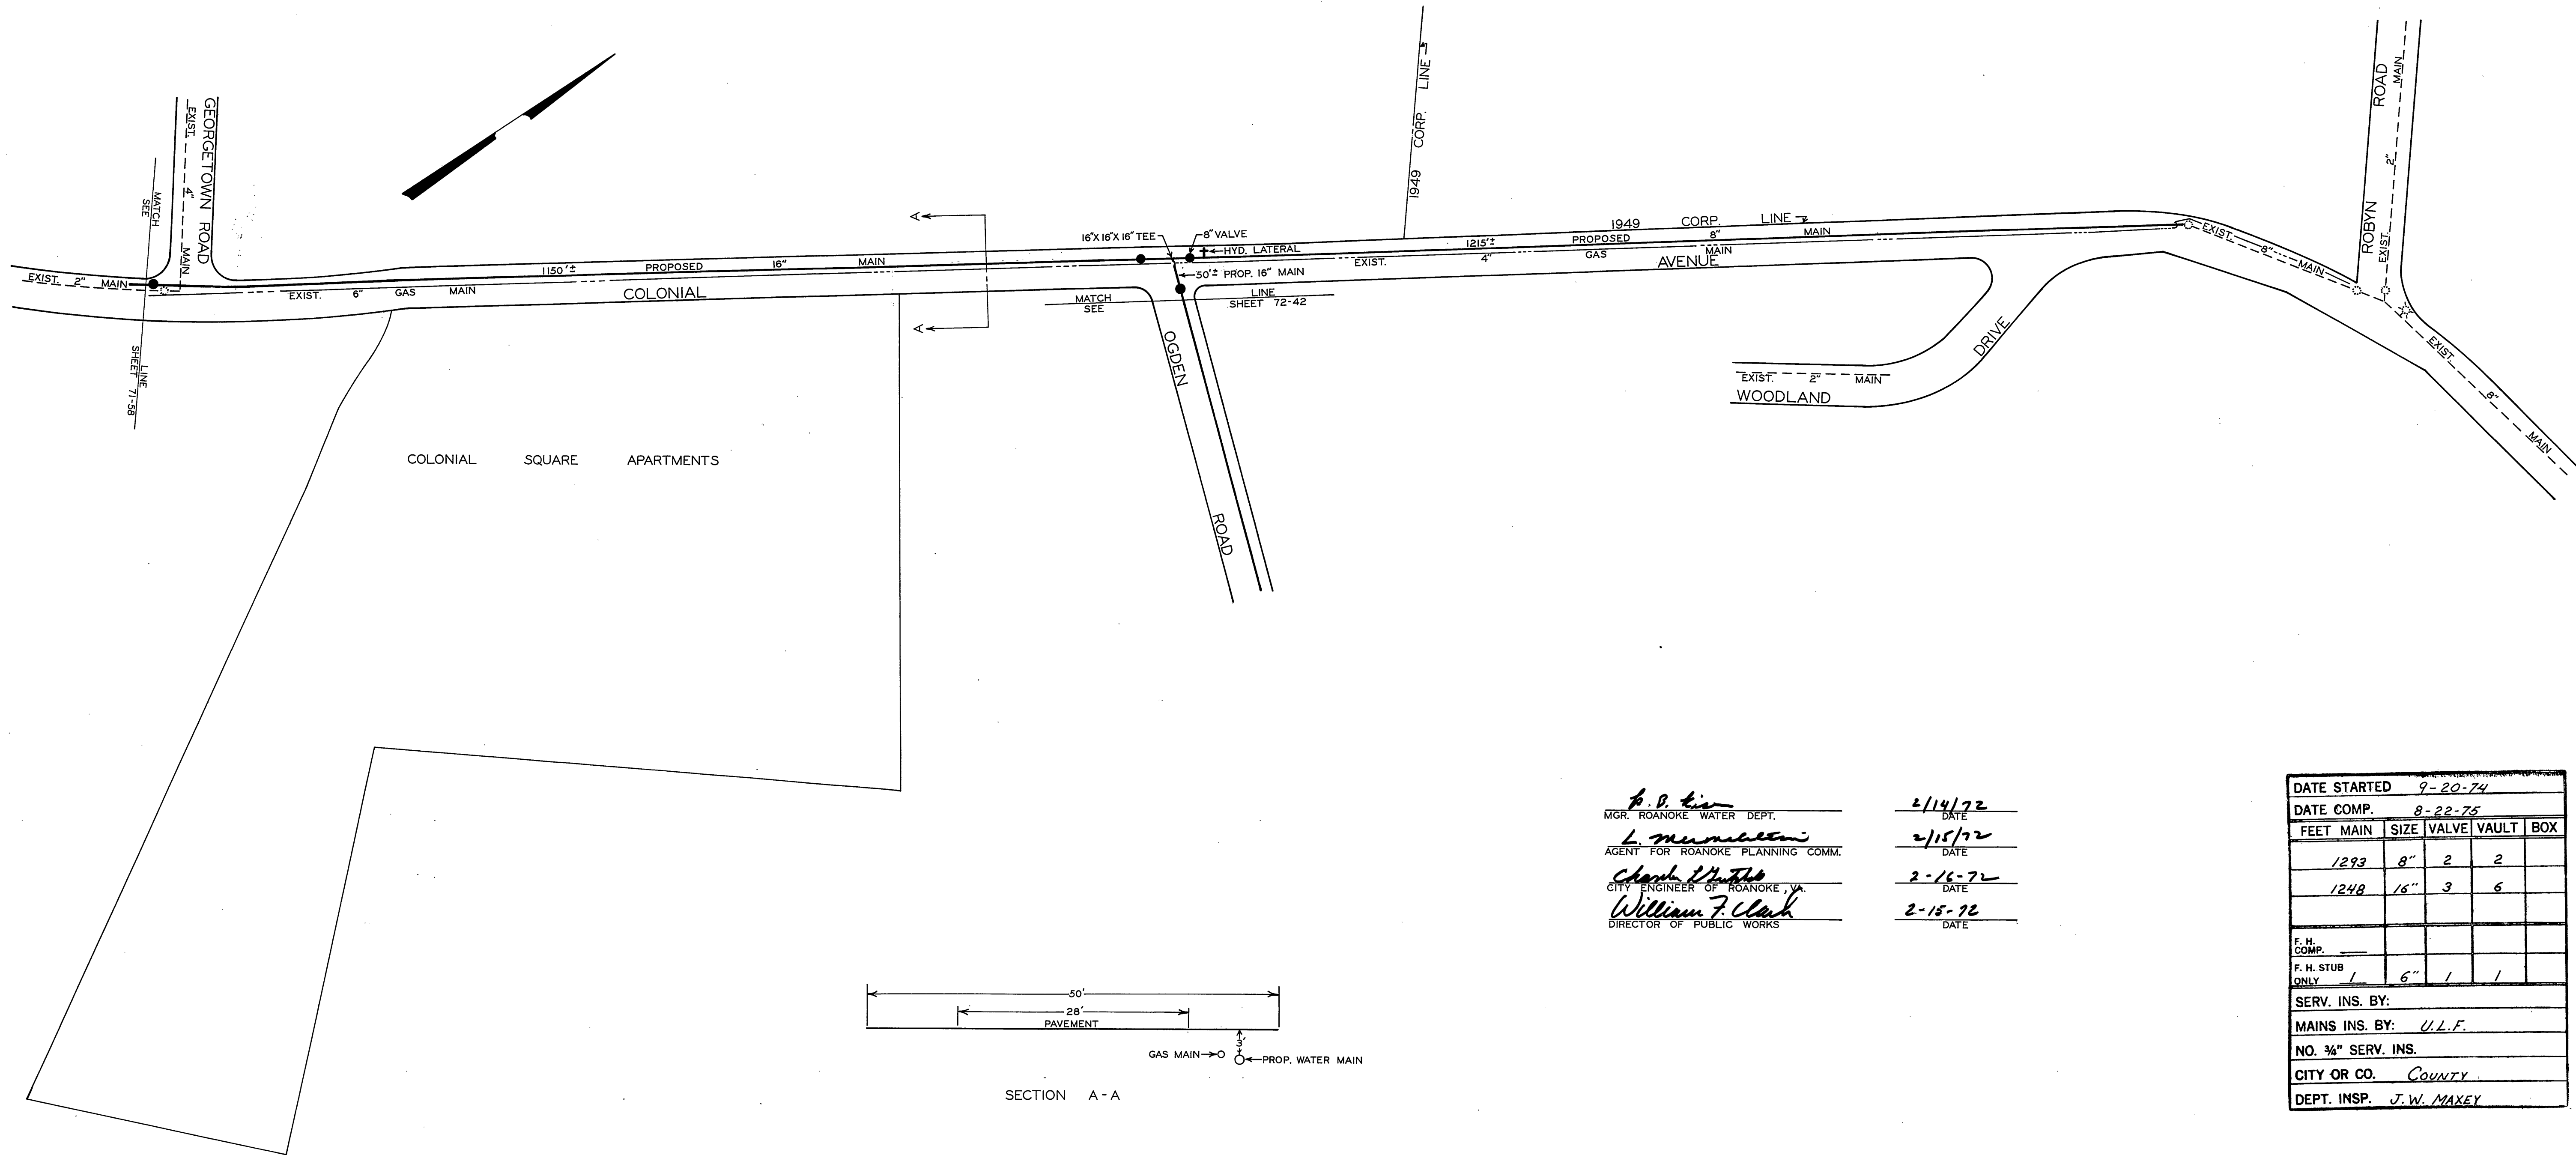


SECTION A - A

P. D. Linn
MGR. ROANOKE WATER DEPT.
L. M. M. M. M.
AGENT FOR ROANOKE PLANNING COMM.
Charles P. H. H.
CITY ENGINEER OF ROANOKE, VA.
William F. Clark
DIRECTOR OF PUBLIC WORKS

2/14/72
DATE
2/15/72
DATE
2-16-72
DATE
2-15-72
DATE

DATE STARTED <i>9-20-74</i>				
DATE COMP. <i>8-22-75</i>				
FEET MAIN	SIZE	VALVE	VAULT	BOX
<i>1293</i>	<i>8"</i>	<i>2</i>	<i>2</i>	
<i>1248</i>	<i>16"</i>	<i>3</i>	<i>6</i>	
F. H. COMP. _____				
F. H. STUB ONLY <i>1</i> <i>6"</i> <i>1</i> <i>1</i>				
SERV. INS. BY: _____				
MAINS INS. BY: <i>U.L.F.</i>				
NO. $\frac{3}{4}$ " SERV. INS. _____				
CITY OR CO. <i>COUNTY</i>				
DEPT. INSP. <i>J.W. MAXEY</i>				

16" MAIN - SOUTHWEST TRUNK LINE

WATER DEPARTMENT
CITY OF ROANOKE, VA.
COLONIAL AVENUE S.W.
SCALE - 1" = 100'
DRAWN BY C.A.H. FEB. 11, 1972
REVISED AUG. 29, 1972