



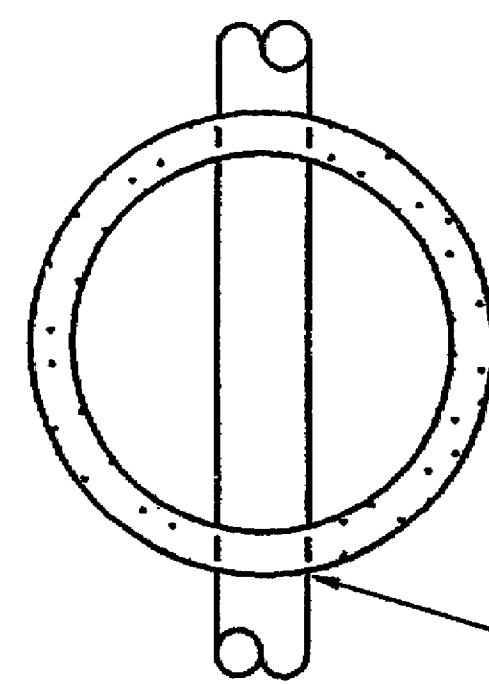

NOTE: CONC SHALL BE AIR-ENTRAINED WITH A STRENGTH OF 4,000 PSI AT 28 DAYS


MANHOLE CONNECTIONS SHALL BE FLEXIBLE BOOT TYPE

SECTION A-A

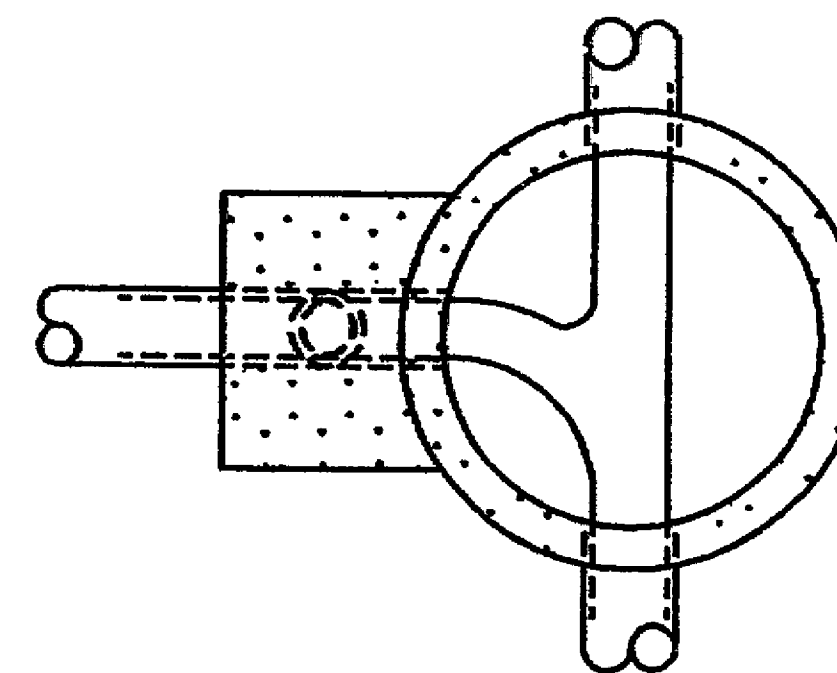


NOTE: CONC SHALL BE AIR-ENTRAINED WITH A STRENGTH OF 4,000 PSI AT 28 DAYS


SECTION B-B

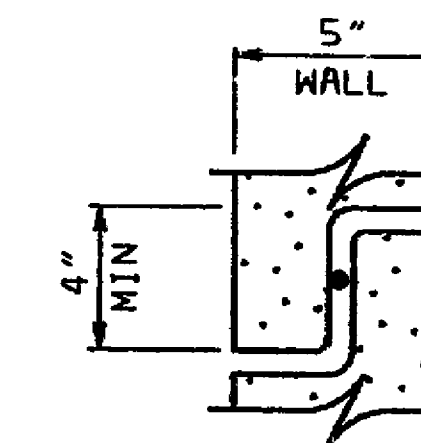


O-RING JOINT DETAIL

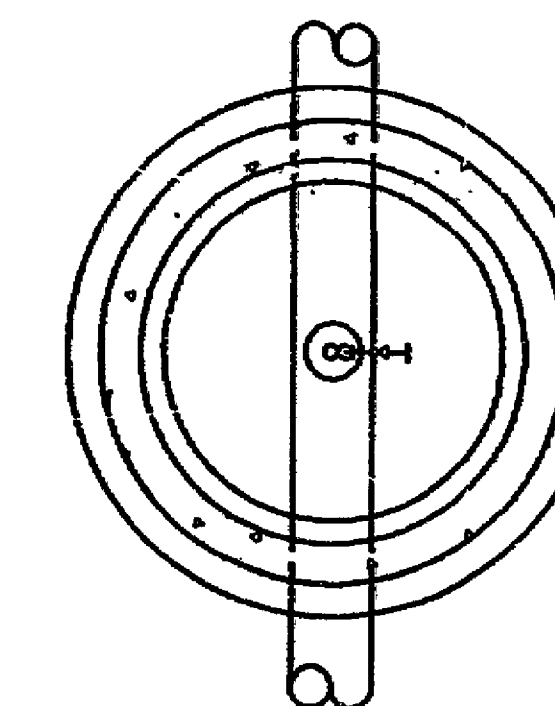


PLAN W/O ECCENTRIC TOP

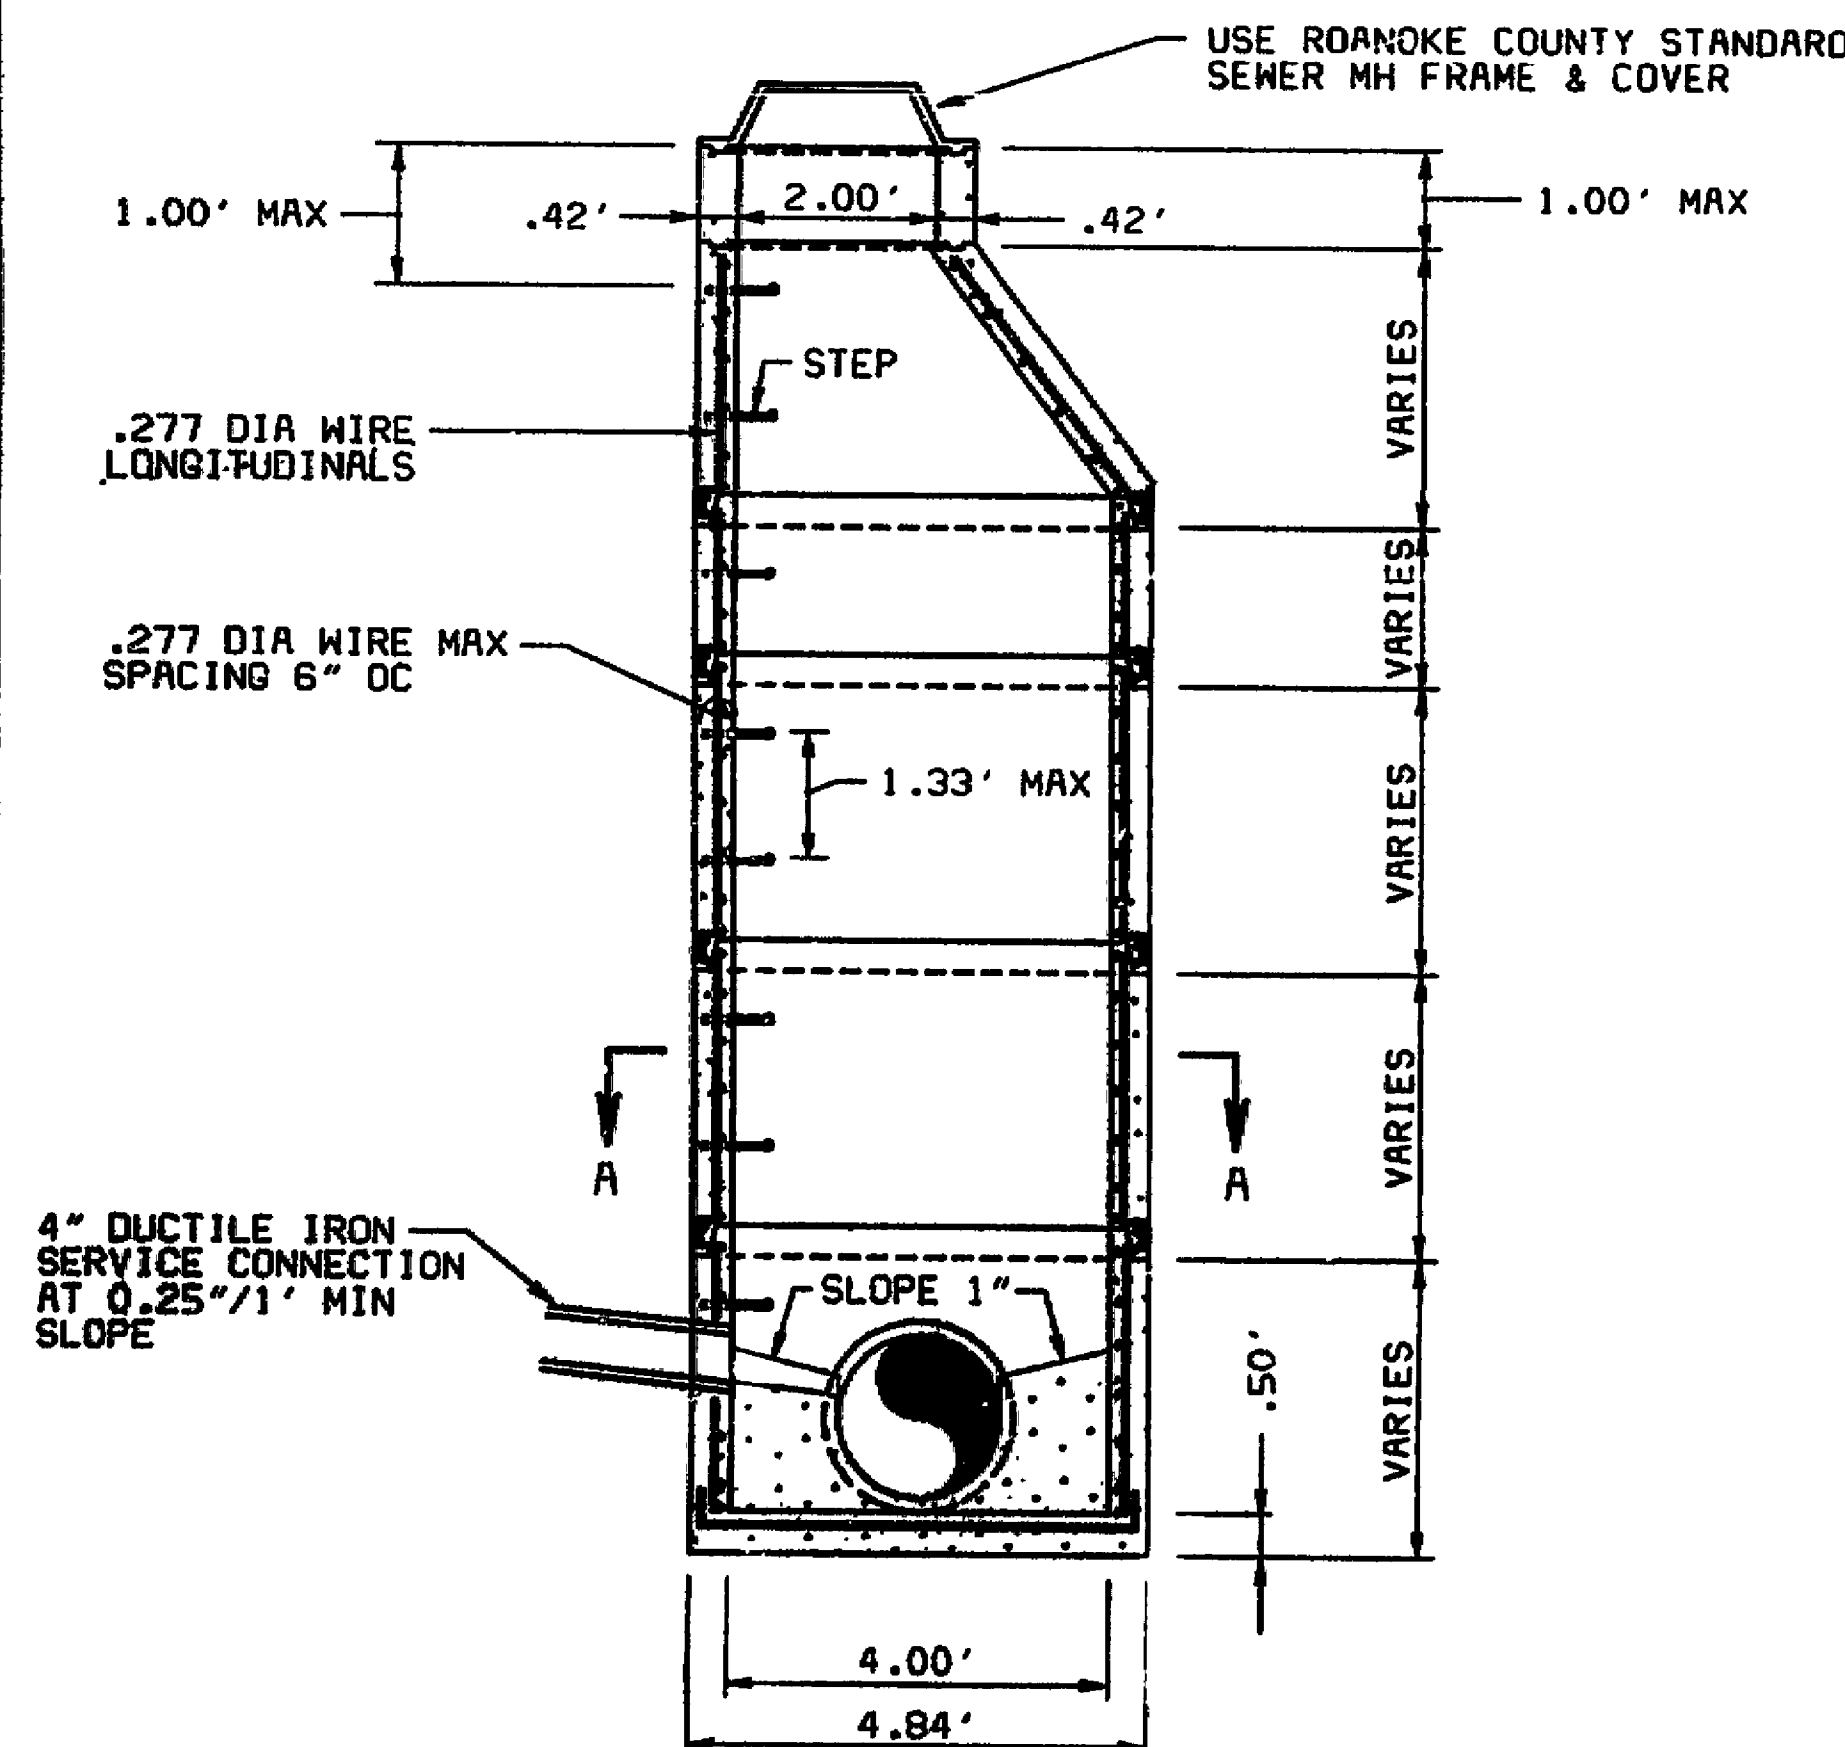

STANDARD MANHOLE
NO SCALE

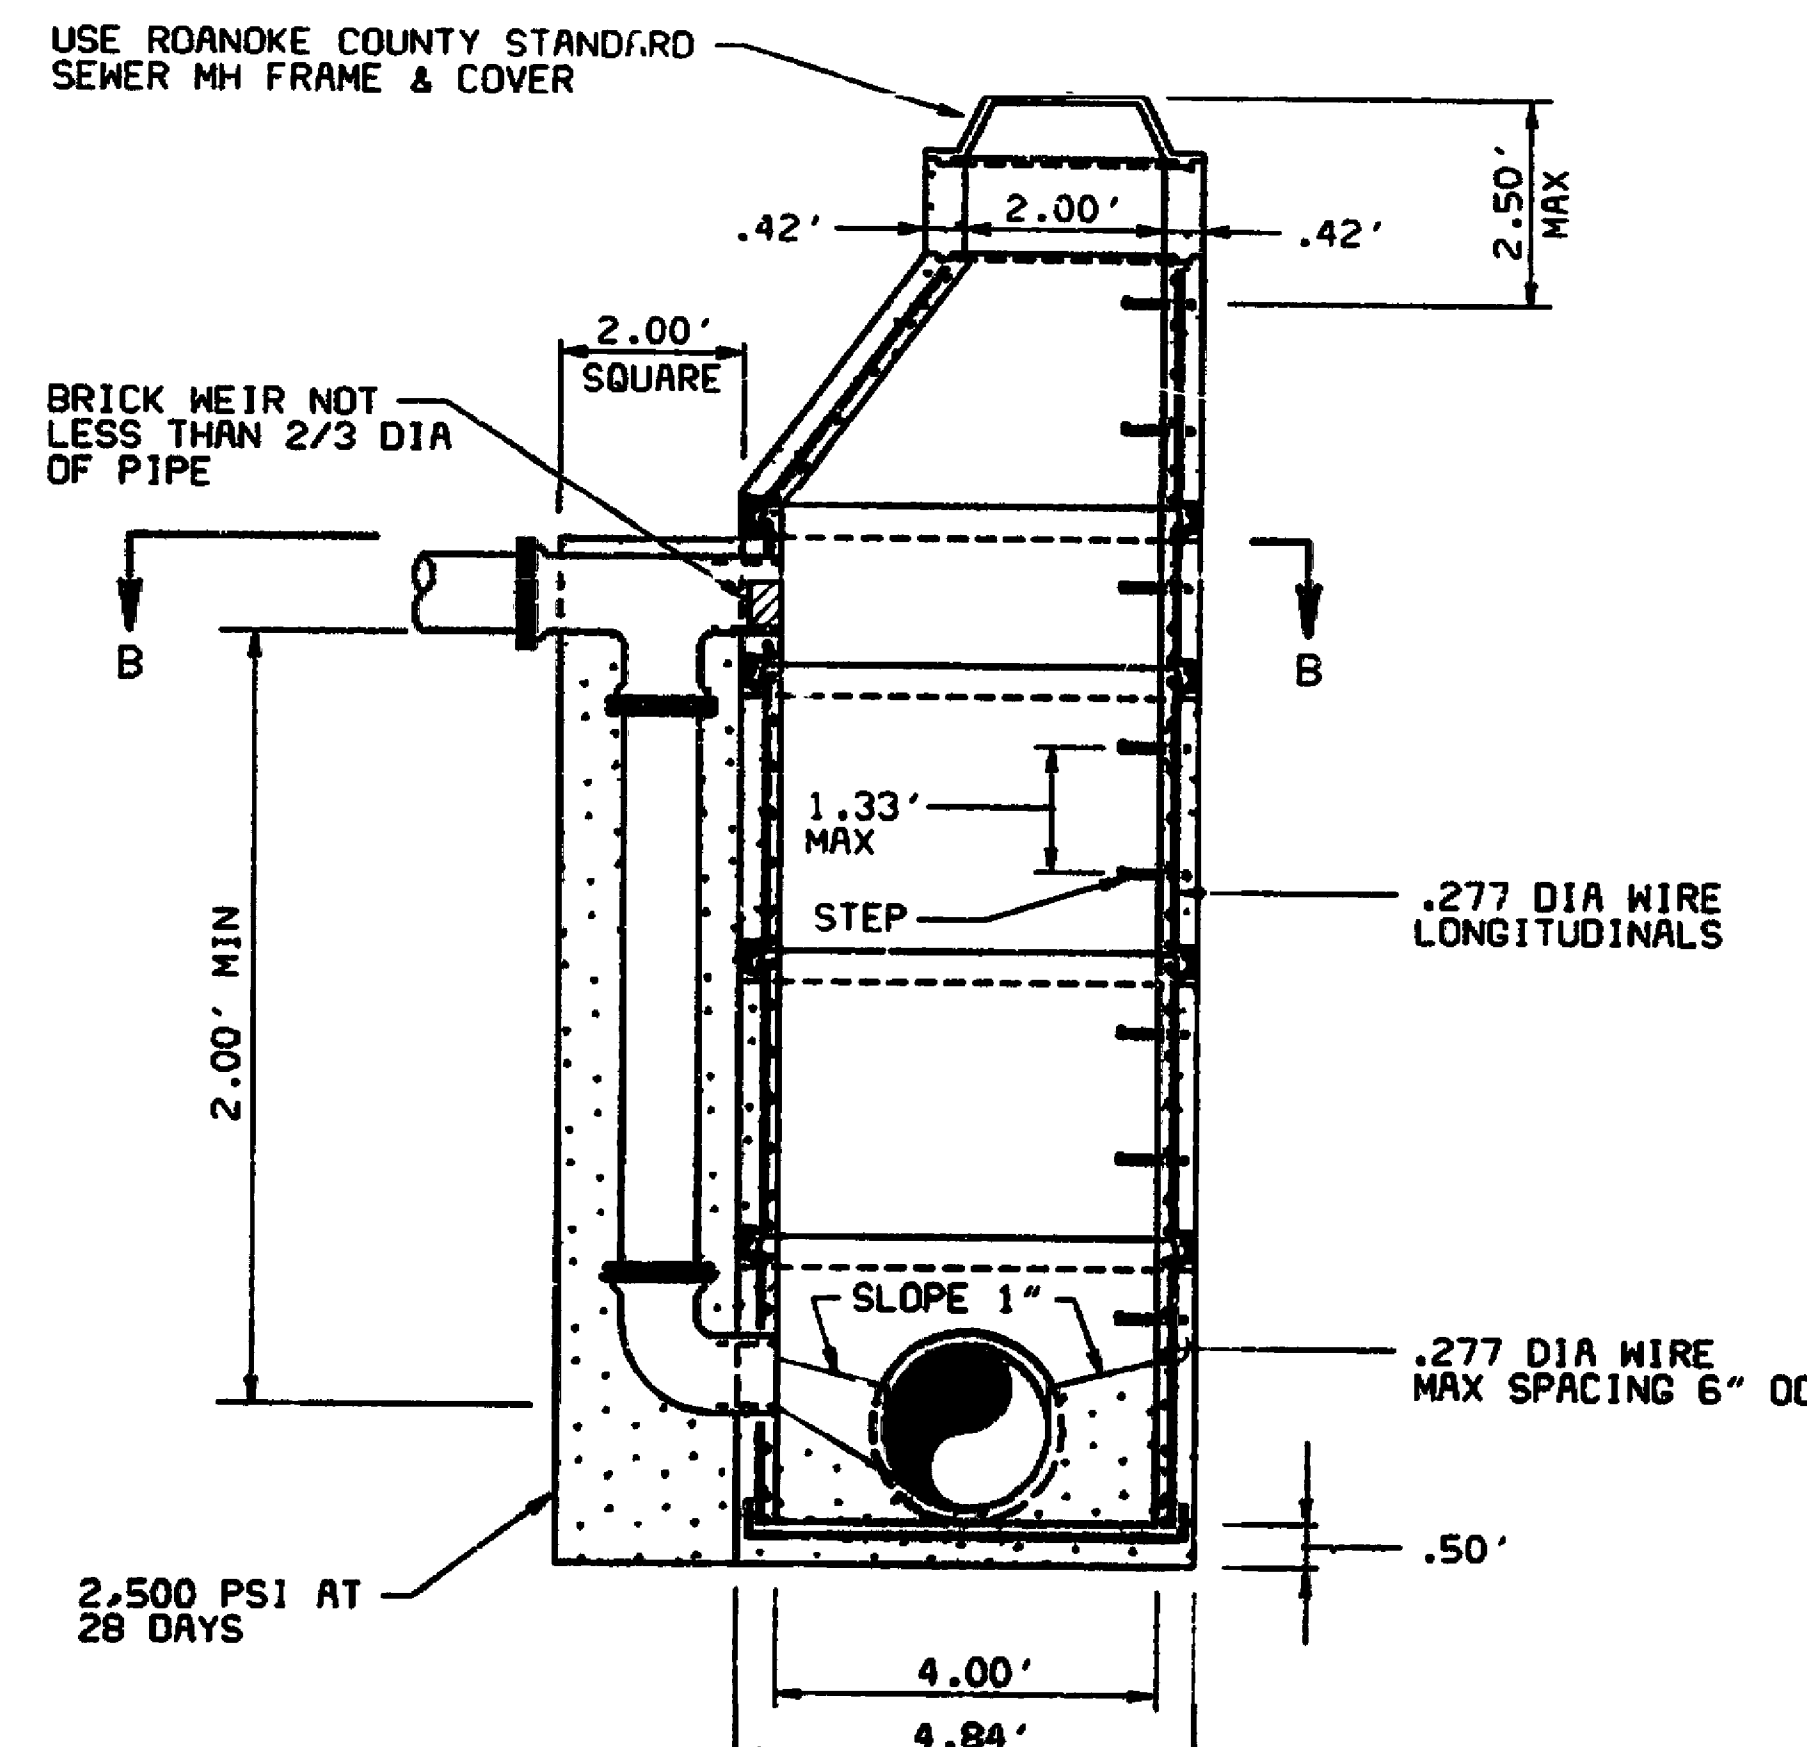

DROP MANHOLE
NO SCALE

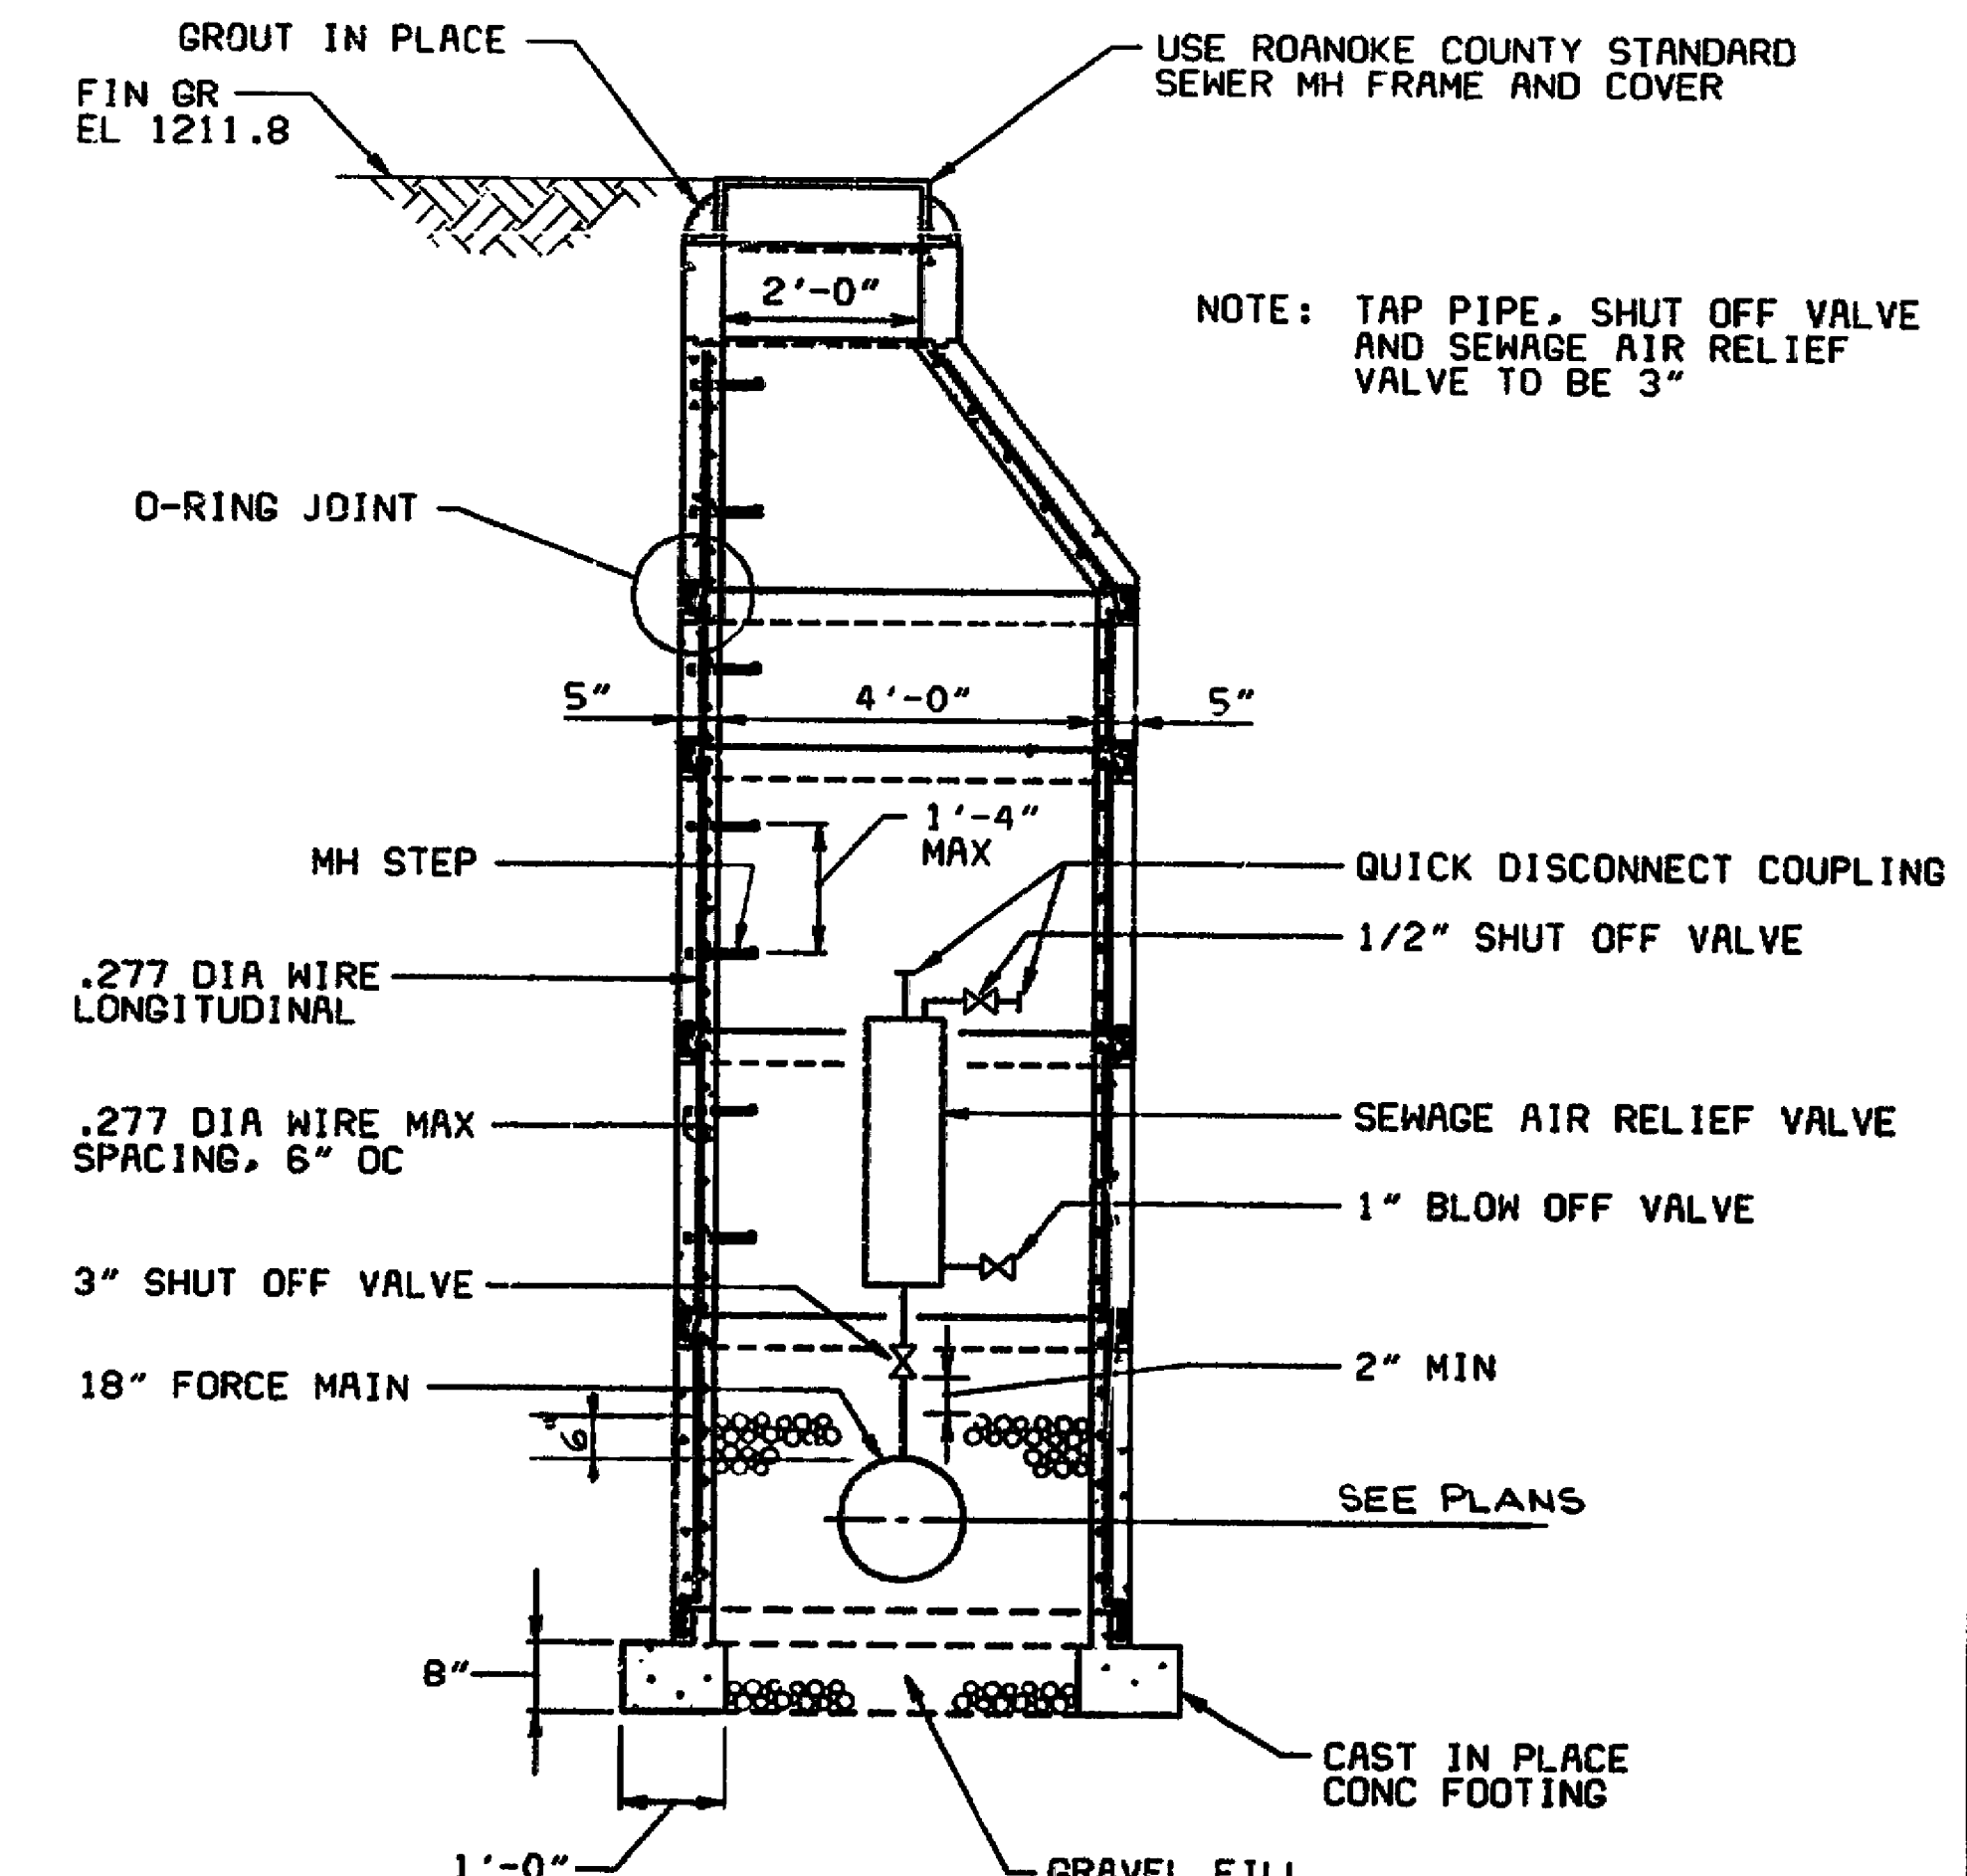

STANDARD MANHOLE
SEWAGE AIR RELIEF VALVE SHOWN
NO SCALE

DESIGNED	DATE	BY	DESCRIPTION	DATE	BY	DESCRIPTION
DRWN						
CHECKED						
APPROVED						



STARKEY SEWAGE PUMP STATION, FORCE MAIN AND GRAVITY SEWER
COUNTY OF ROANOKE, VIRGINIA
11 JANUARY 1985

HAYES, SEAY, MATTERN AND MATTERN
ARCHITECTS - ENGINEERS - PLANNERS

DETAILS

SCALE	COMM. NO.	REVISIONS NO.
NONE	1185	26

FORM 1000

DESIGNED 19A MAR0185.C4405

FINAL PRINT

SE-0272

