


CONTRACTOR MUST
PROVIDE 18" MINIMUM
VERTICAL SEPARATION
BETWEEN WATERLINE AND
ALL STORM AND
SANITARY SEWER.



EXISTING LINE HAS NOT BEEN TESTED OR ACCEPTED BY WVWA. IF THE EXISTING LINE CAN NOT BE UTILIZED, THE CONTRACTOR MUST TAP TO EXISTING WATERLINE IN FLORA FARM DRIVE.

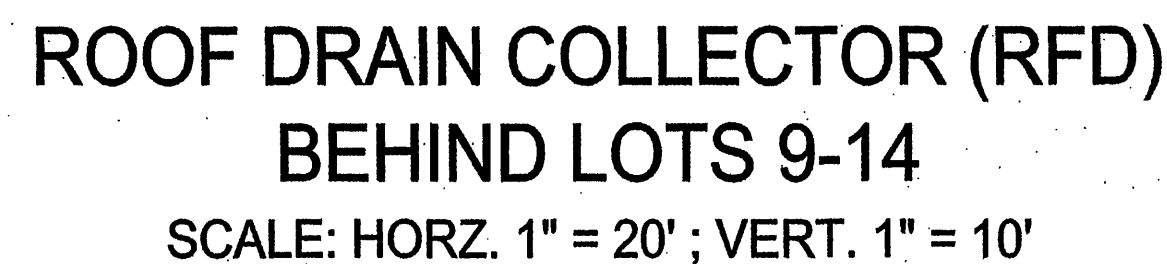