



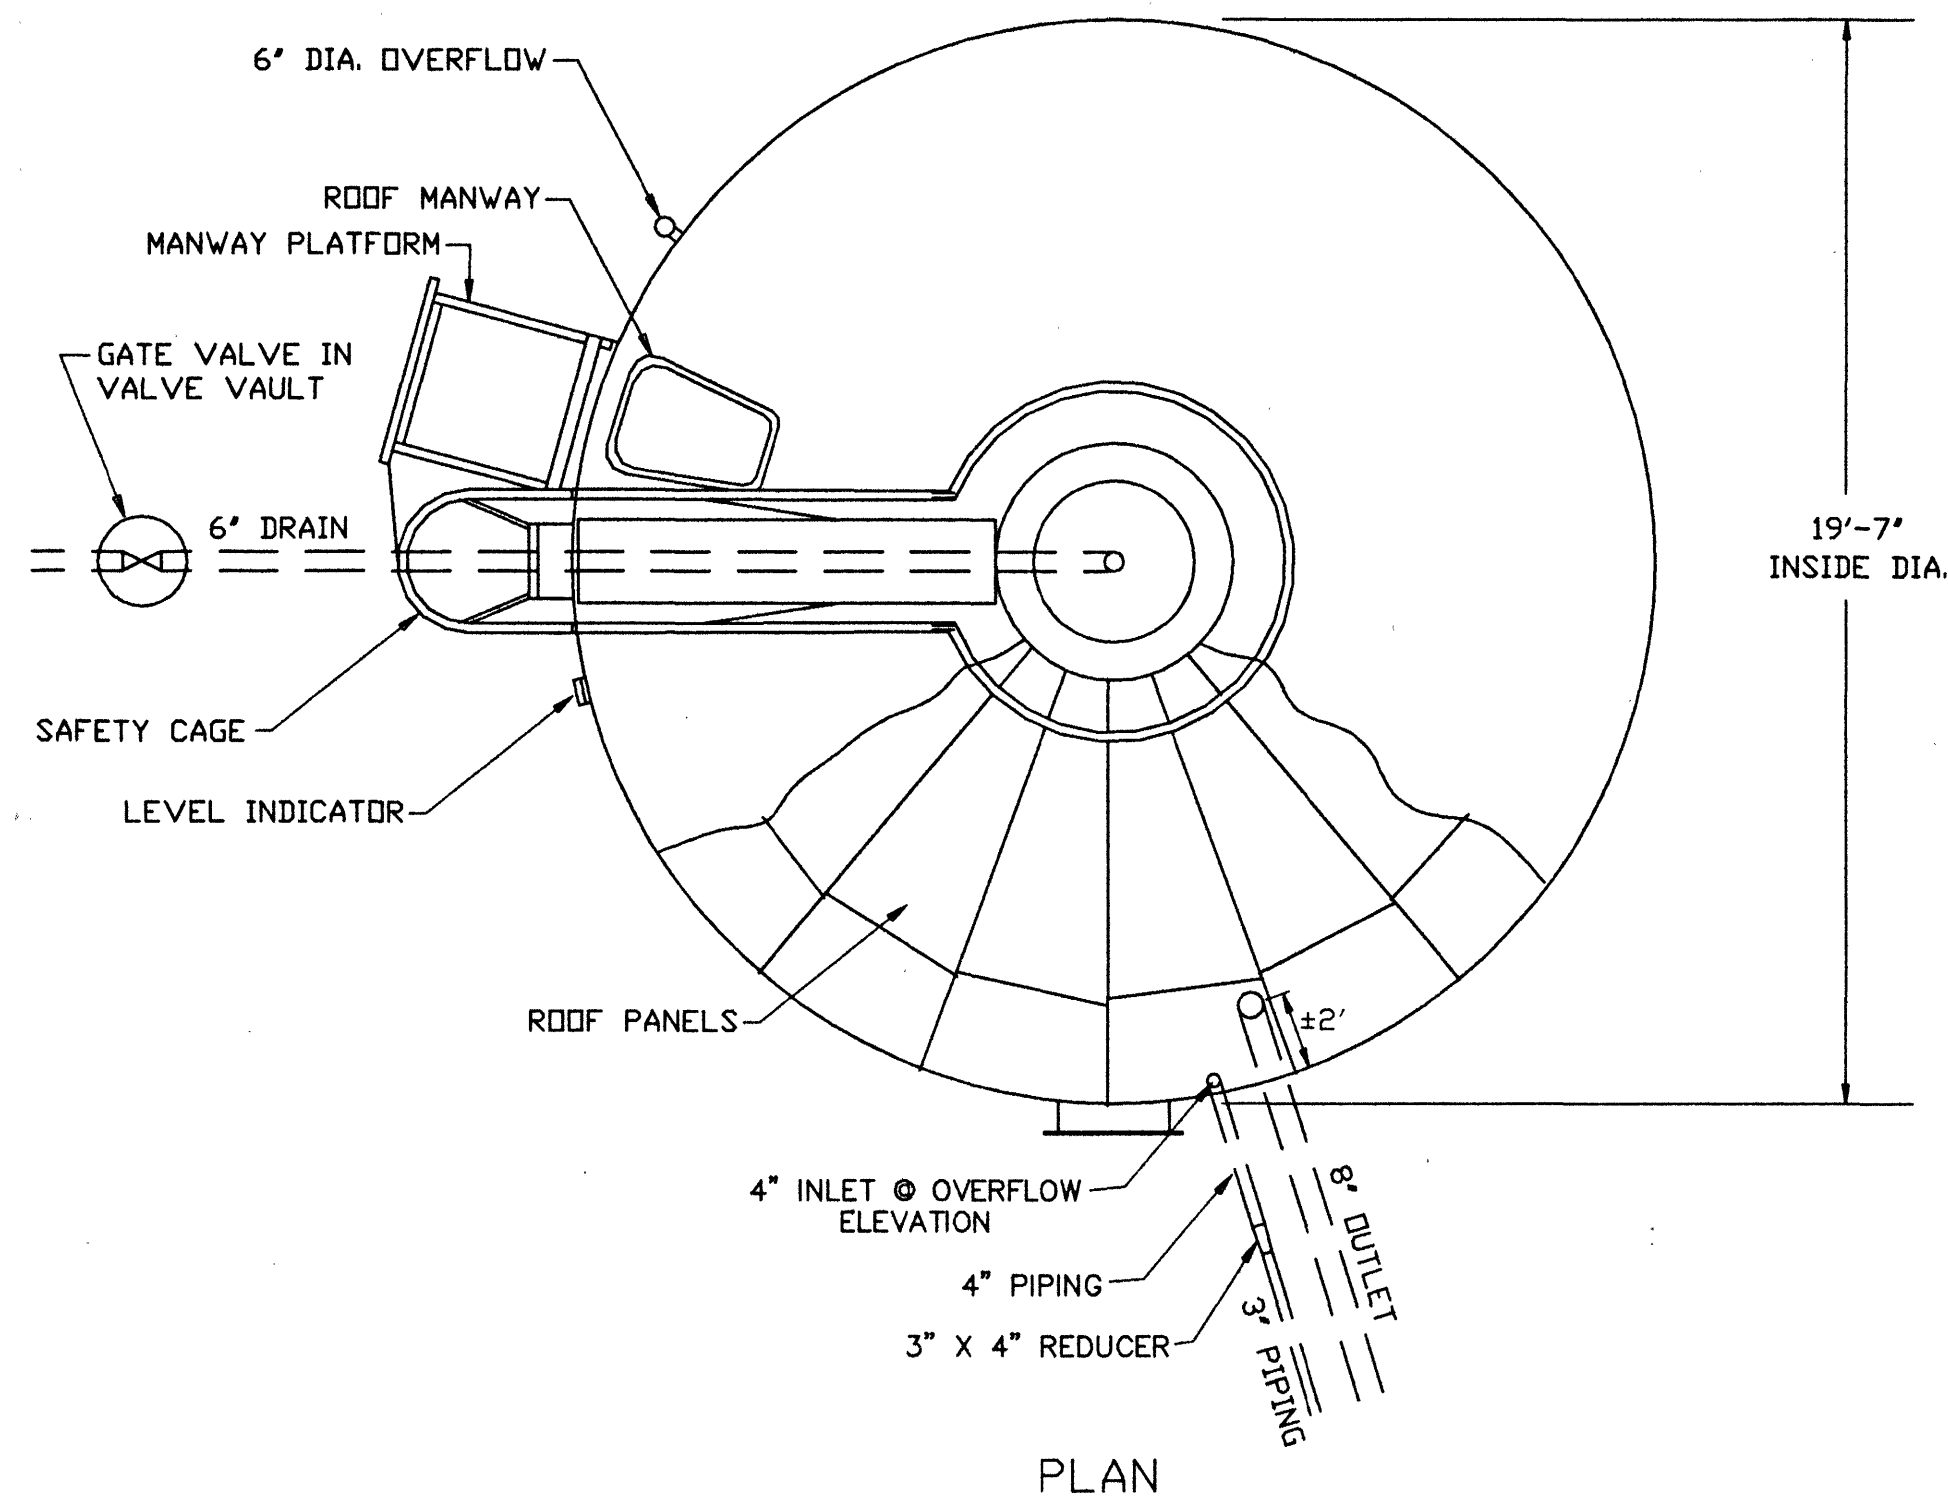


NOTE:
1. SEE SHEET 9 FOR GRADING OF WELL LOT WHERE TANK IS LOCATED.

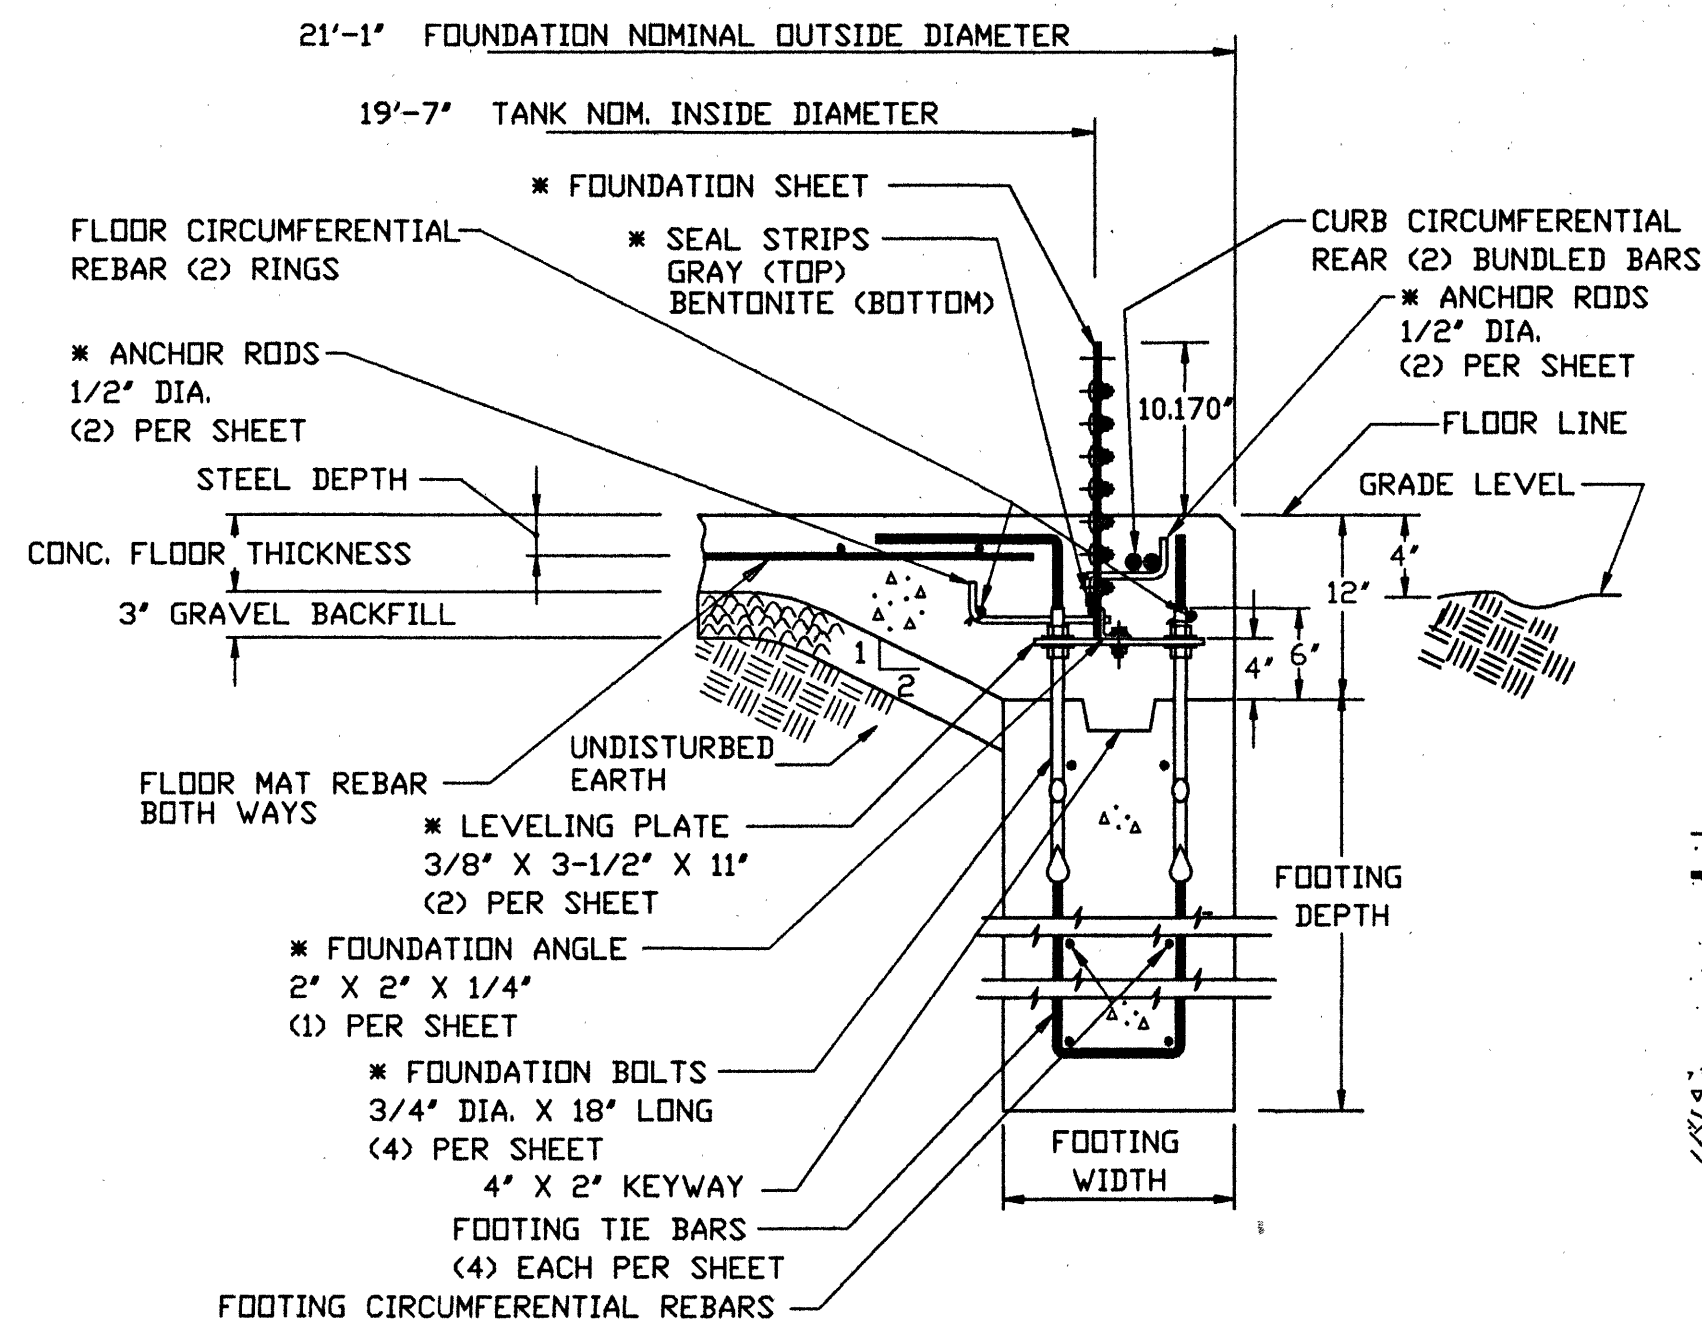


FOUNDATION SECTION

NOTES:
1. * THESE ITEMS TO BE SUPPLIED BY THE TANK MANUFACTURER.
2. TANK MANUFACTURER TO PROVIDE DESIGN FOR TANK FOUNDATION AND SLAB SEALED BY A VIRGINIA REGISTERED PROFESSIONAL ENGINEER.

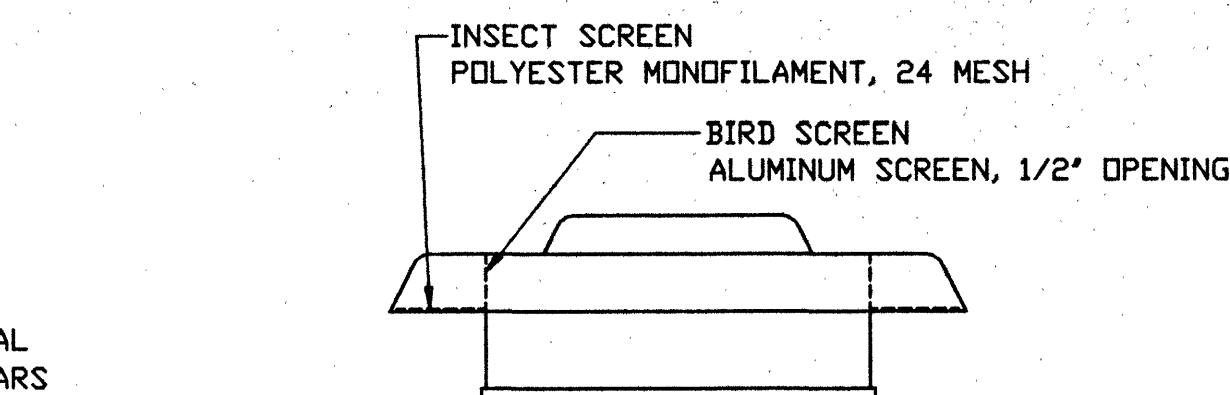


NOTES:
1. VENT DIAMETER SHALL BE AT LEAST 8".
2. INSECT SCREEN SHALL OPEN IF BLOCKED.


GRAVITY VENTILATOR

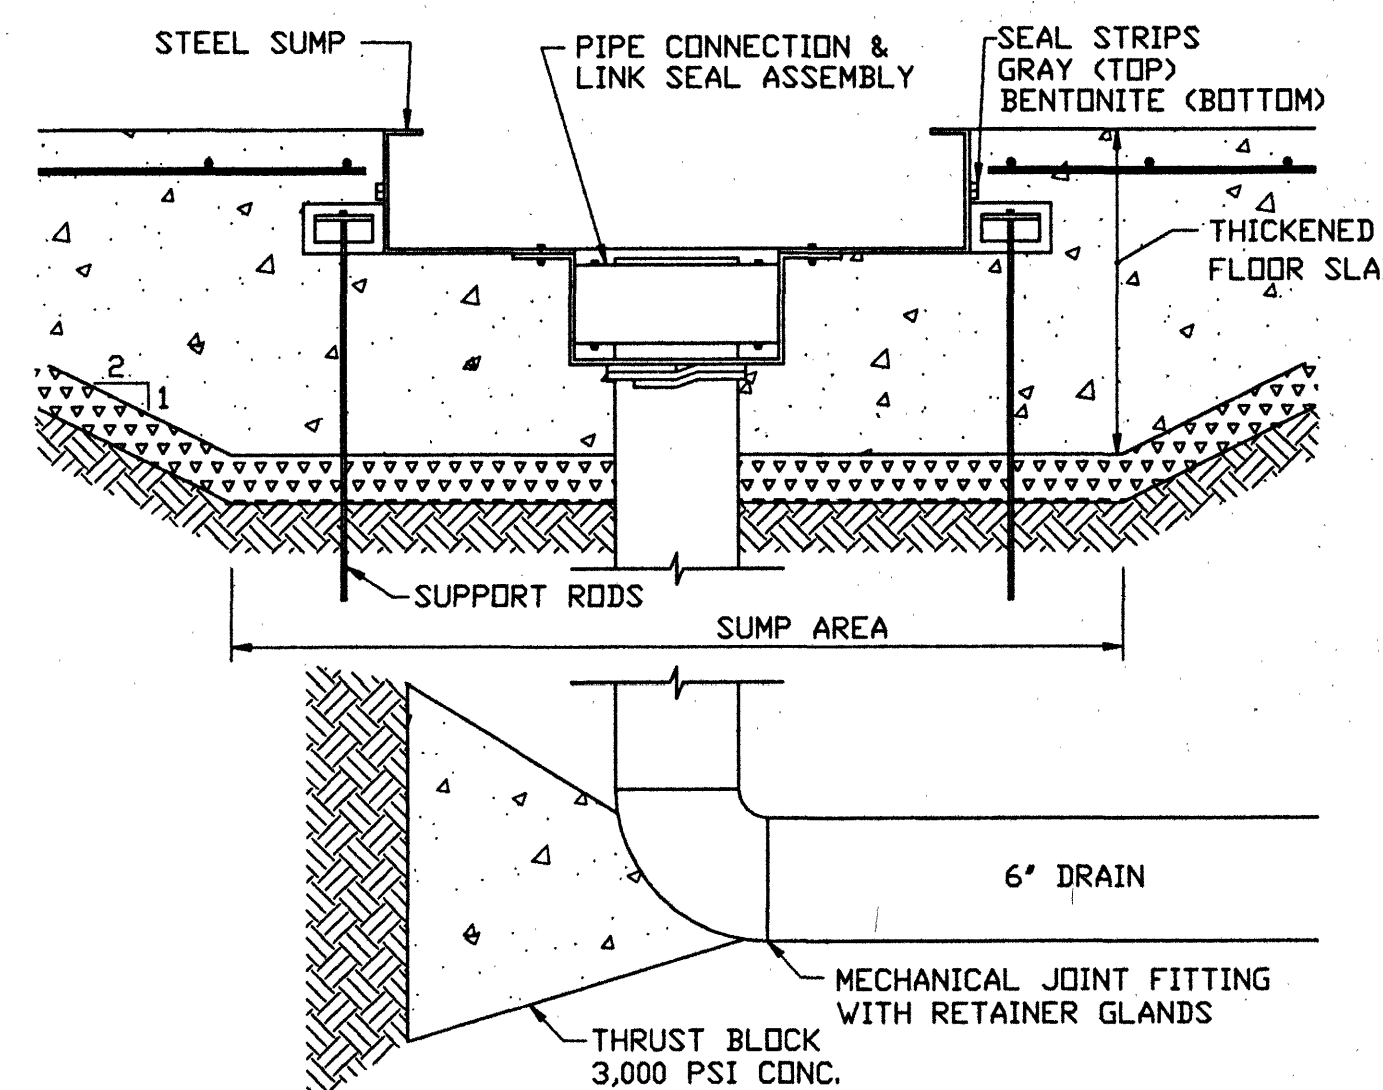


DRAIN PIPING DETAIL

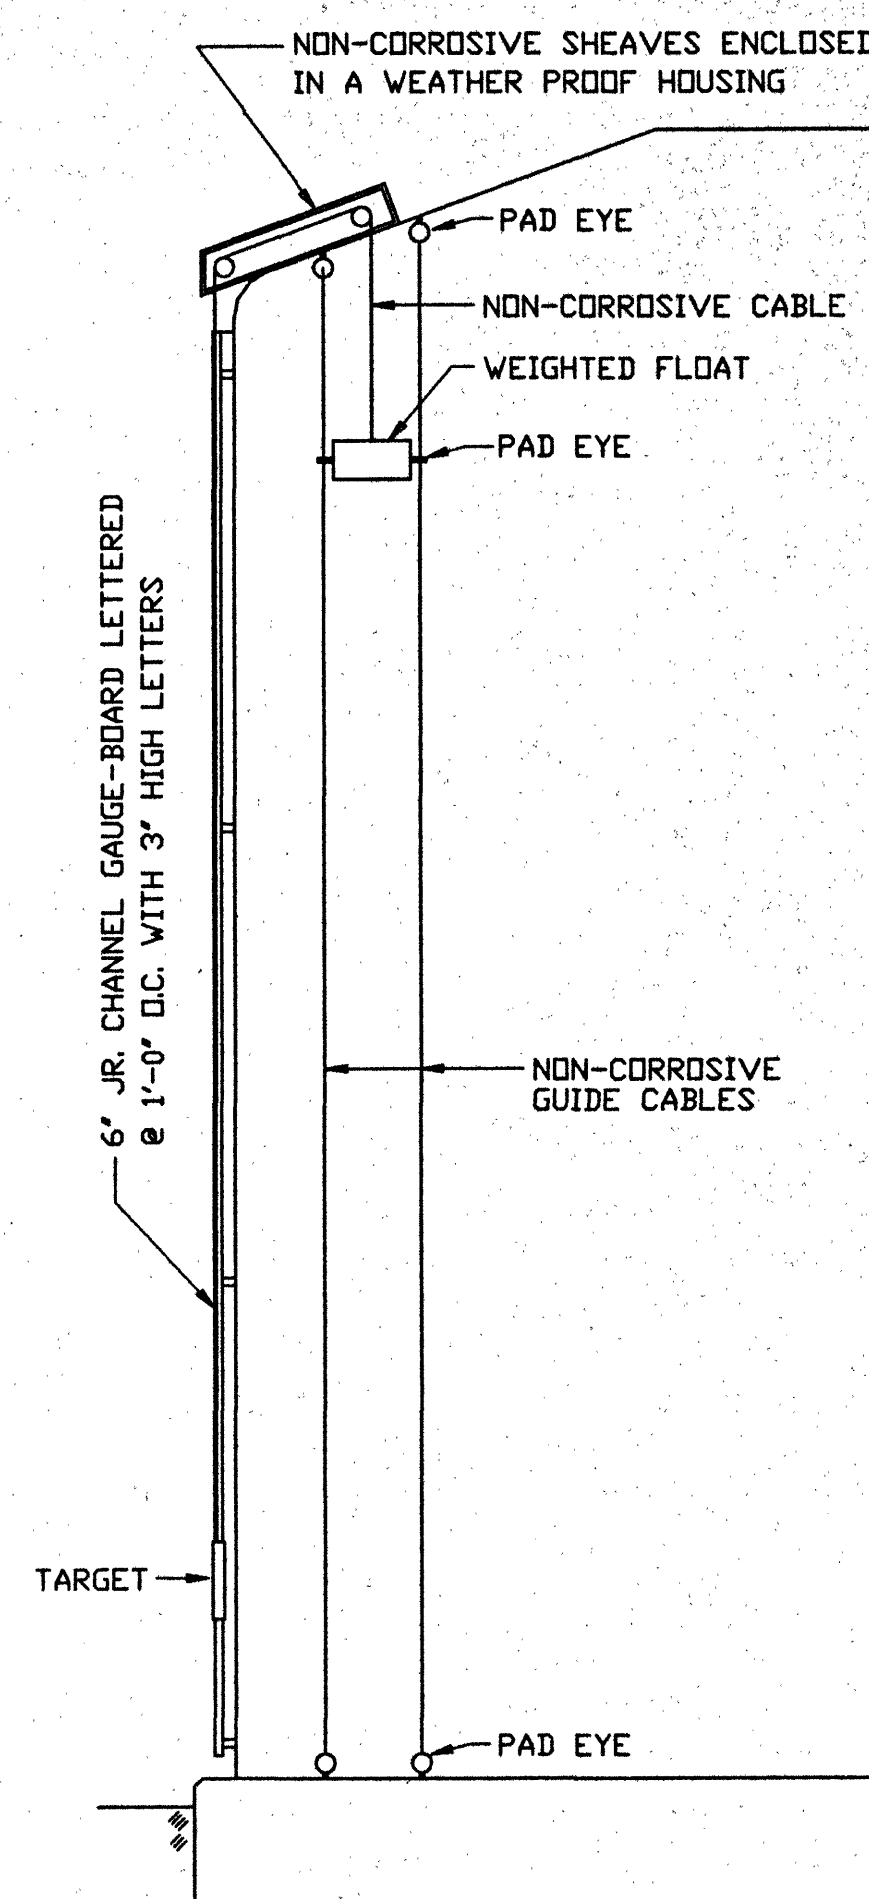


DEPTH INDICATOR DETAIL

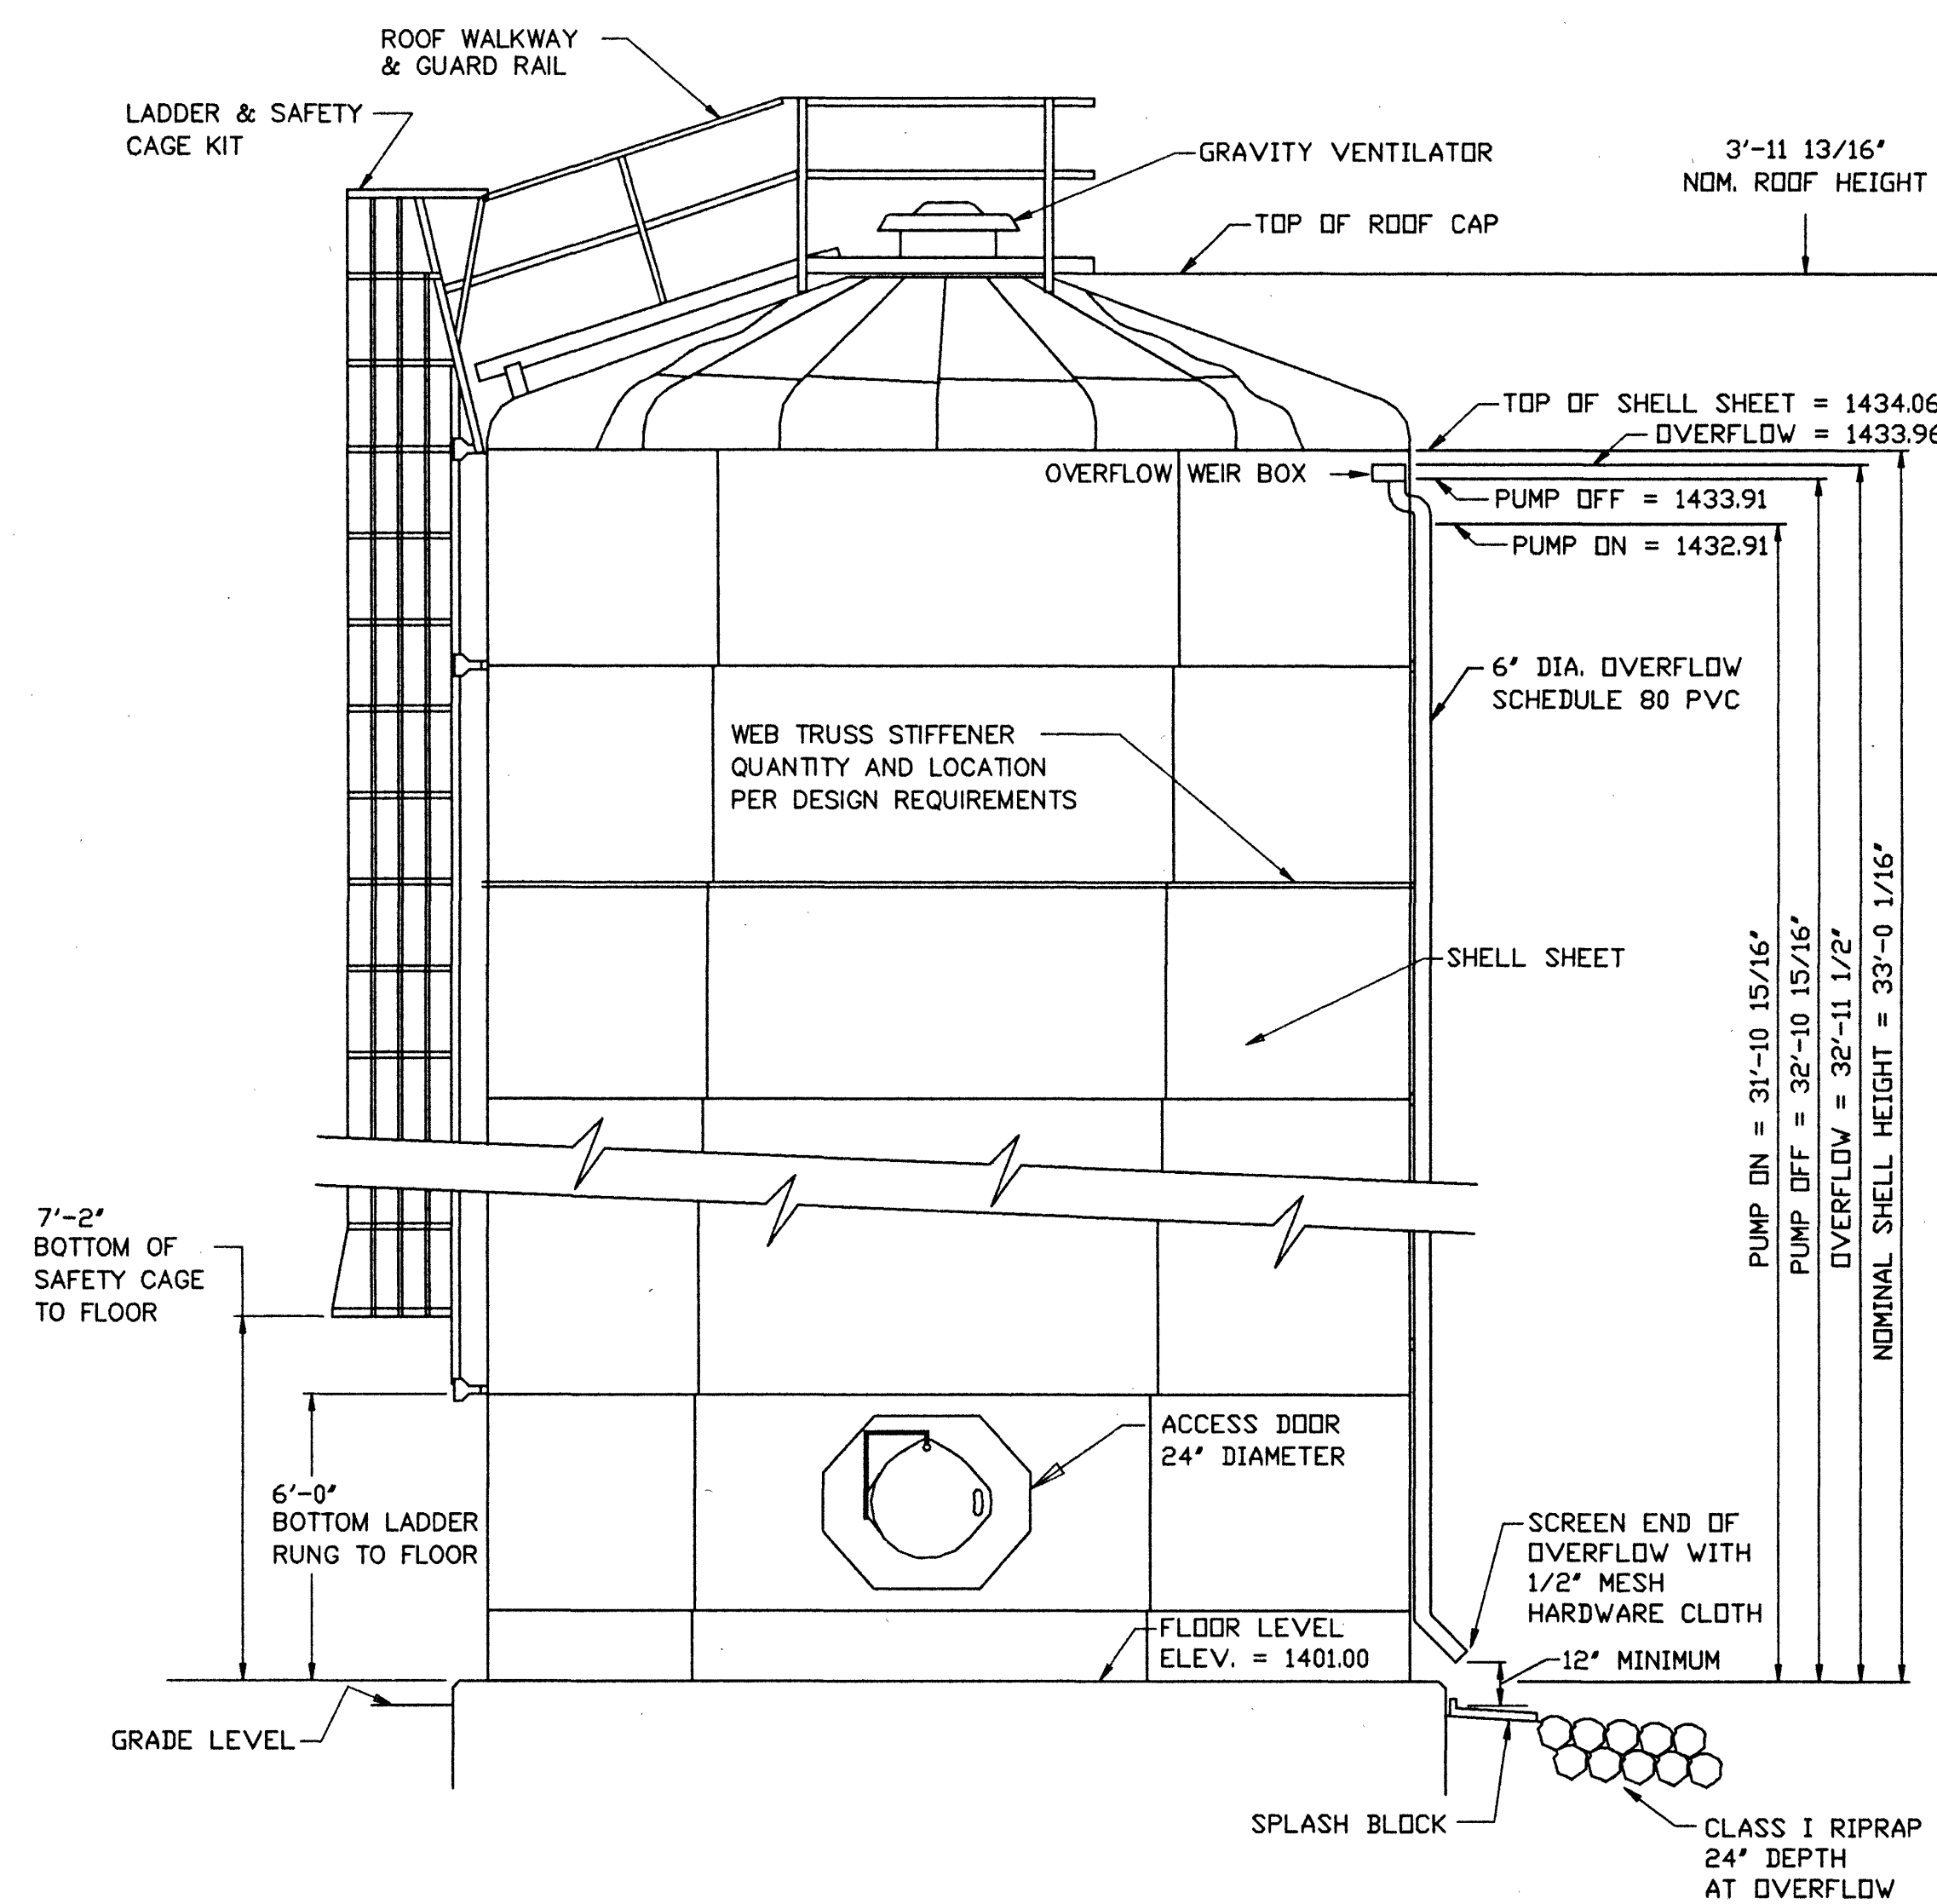


WATER TANK ELEVATION

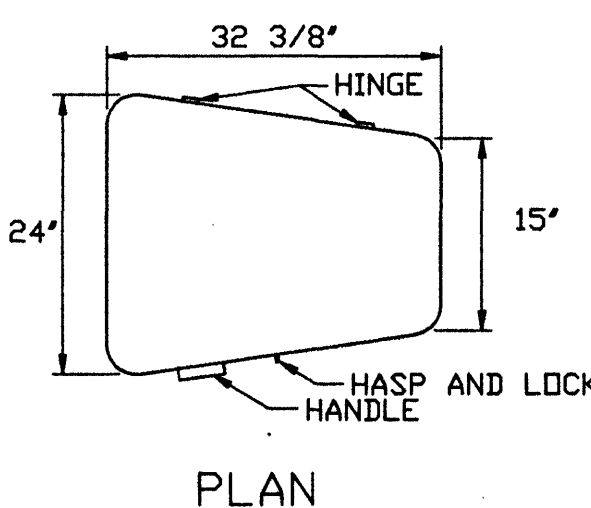


SECTION
ROOF MANWAY

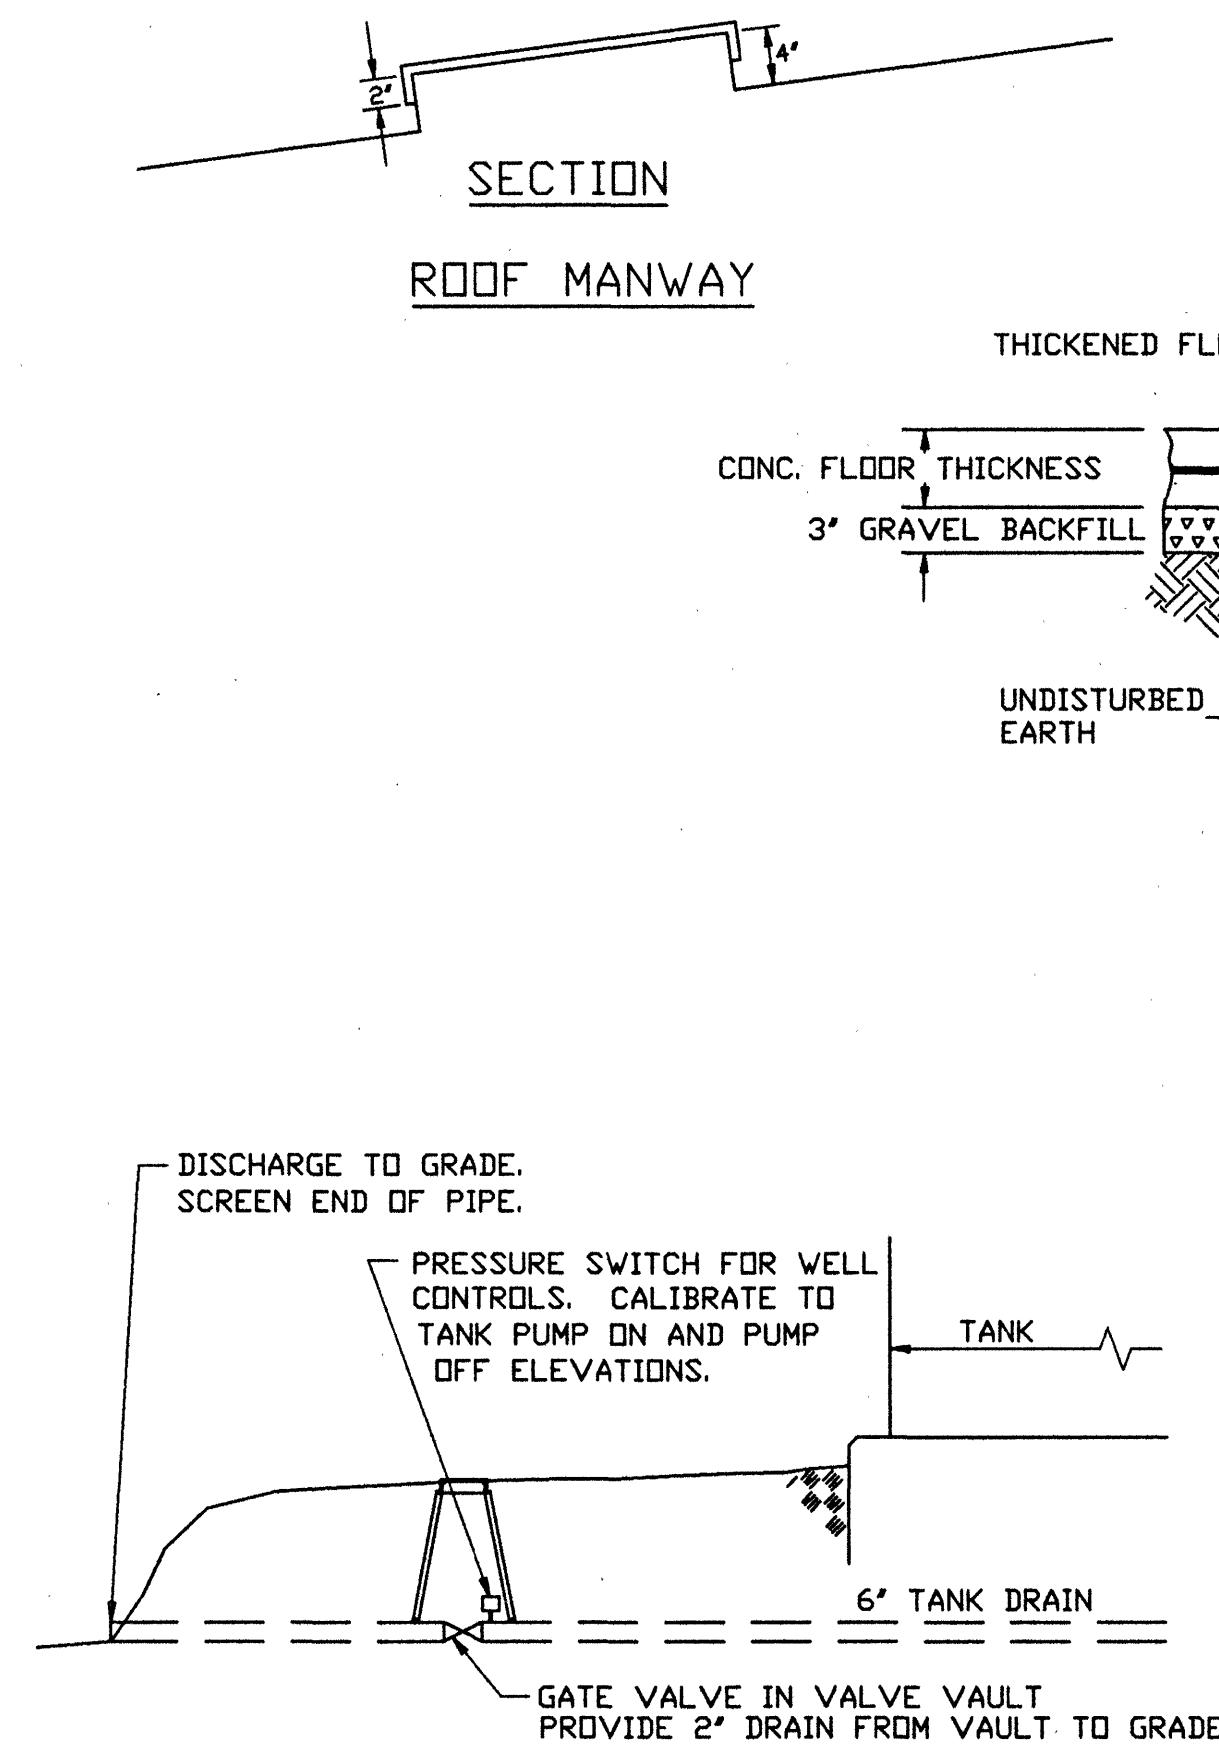

TANK DRAIN DETAIL

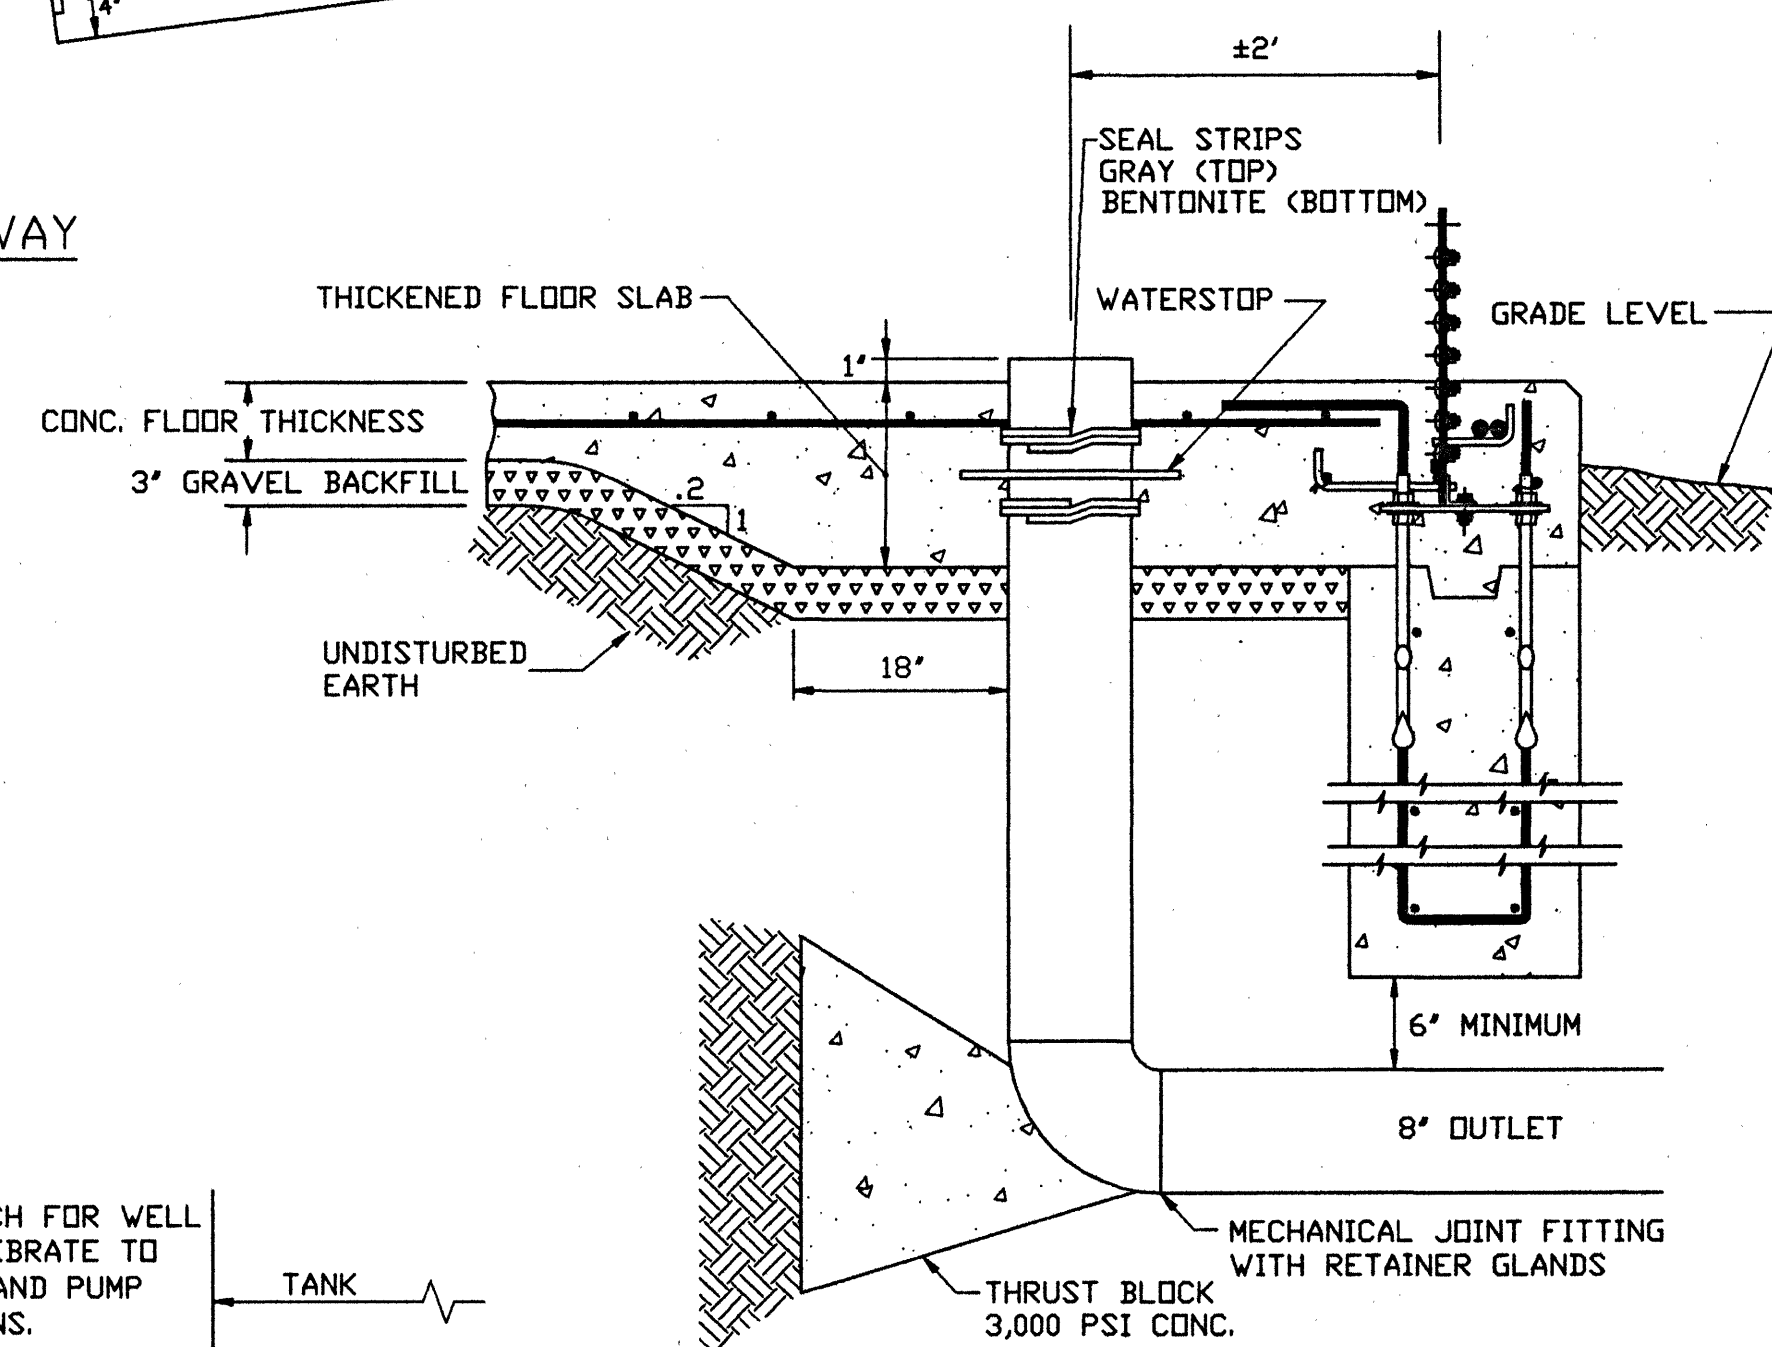

OUTLET PIPING DETAIL

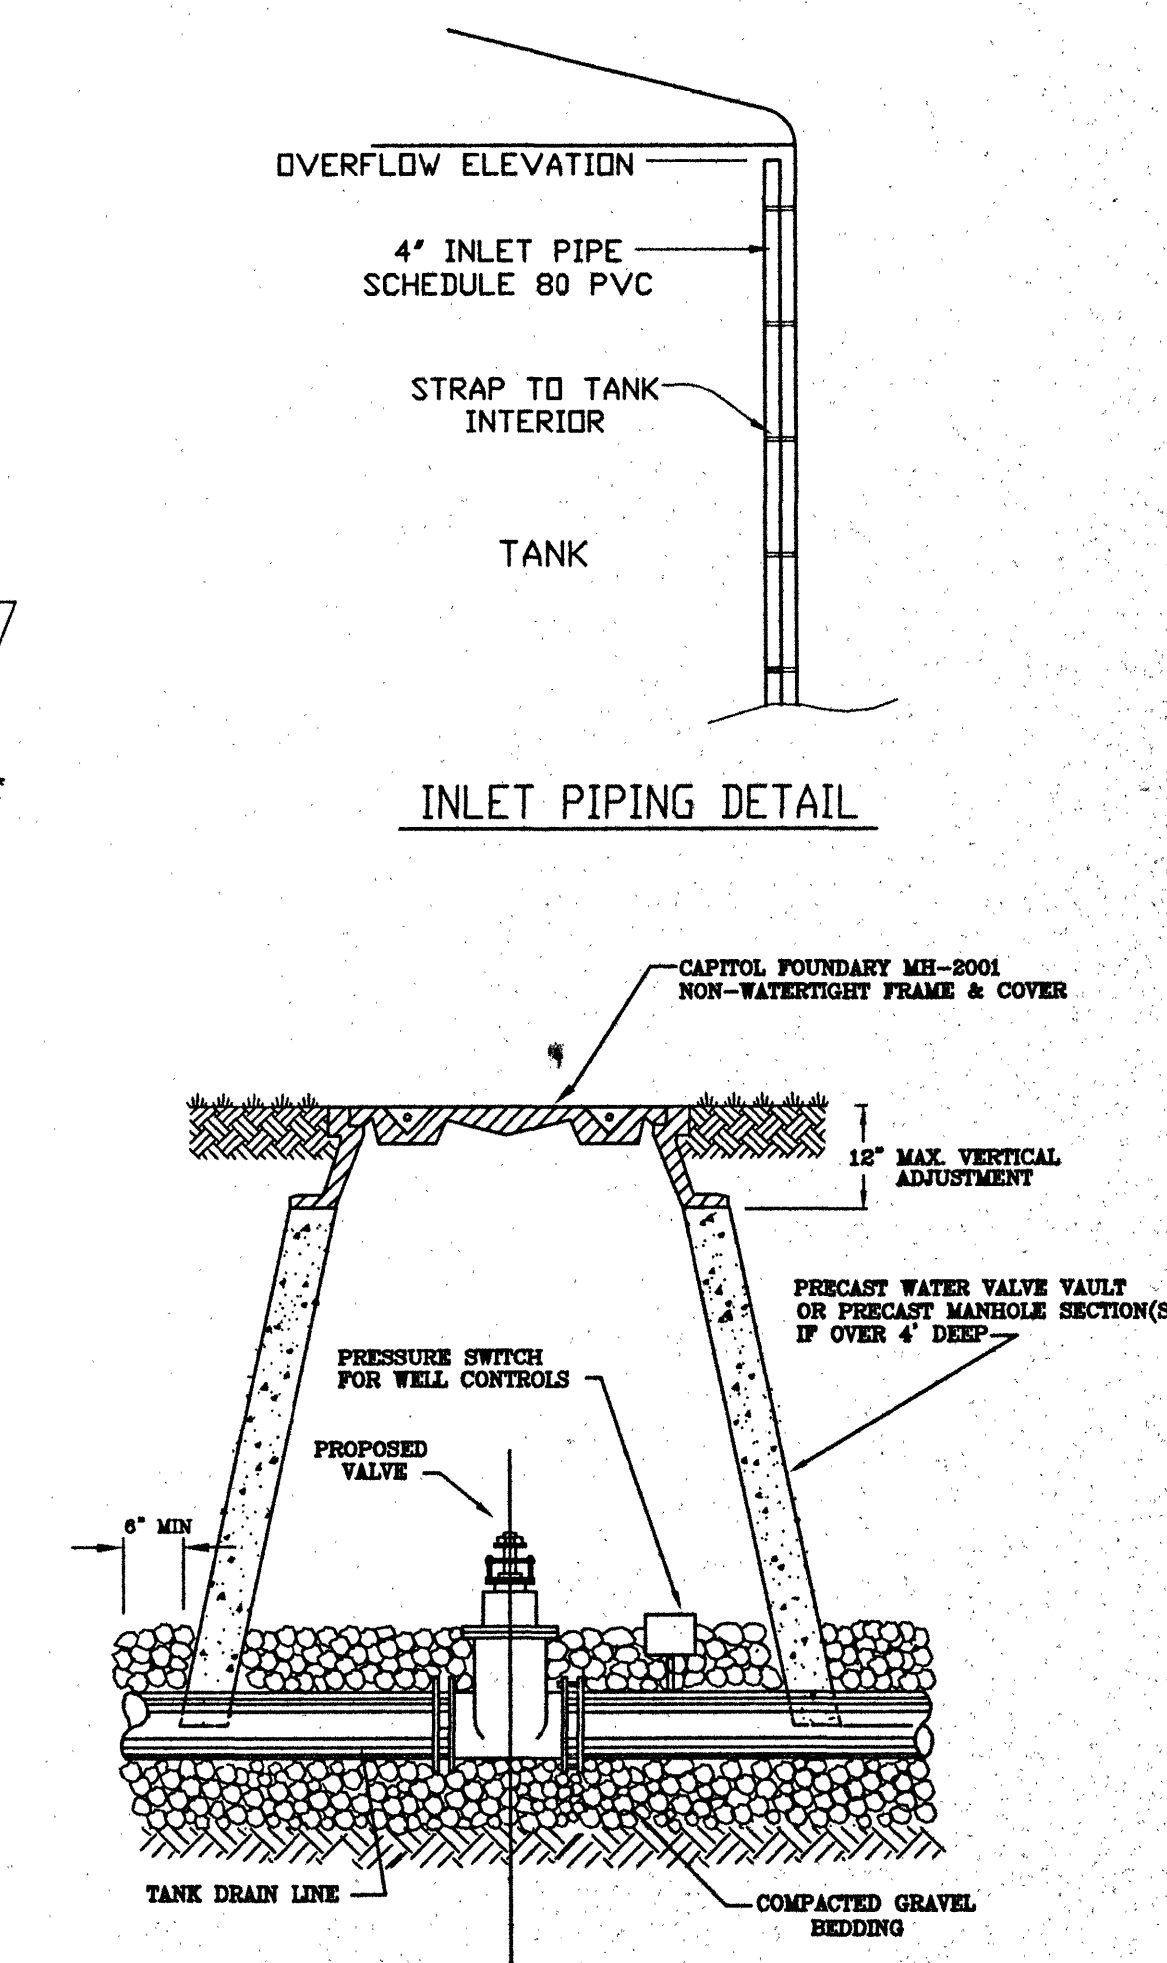

DRAIN LINE VALVE INSTALLATION